

ARLINGTON HIGH SCHOOL
869 MASSACHUSETTS AVENUE
Arlington, MA 02476



STORMWATER REPORT

Submitted to:

Town of Arlington Conservation Commission,
Massachusetts Department of Environmental Protection

Applicant:

Town of Arlington
730 Massachusetts Avenue
Arlington, MA 02476

Architect:


HMFH Architects, Inc.
130 Bishop Allen Dr.
Cambridge, MA 02139

Landscape Architect:

Crosby / Schlessinger / Smallridge LLC
67 Batterymarch St., 2nd Floor
Boston, MA 02110

Civil Engineer/Land Surveyor:

Samiotes Consultants, Inc.
20 A Street
Framingham, MA 01701

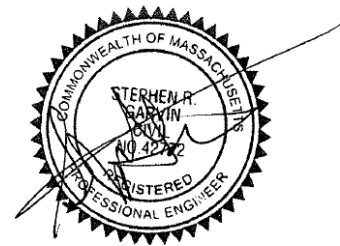

samiotes

07 May 2020; Revised 28 May 2020

ARLINGTON HIGH SCHOOL STORMWATER MANAGEMENT NARRATIVE ARLINGTON, MA

Introduction:

The existing site, located at 869 Massachusetts Avenue, Arlington, MA, consists of the Arlington High School campus, containing the existing Arlington High School Building with an associated paved driveways, landscaped areas, and utilities as well as grass athletic fields, a turf football field, and facilities. There are several accessory structures across the property for equipment storage and bathroom facilities for the fields. The property is abutted by the Minuteman Commuter Bikeway on the north side, a condominium complex, church, and pharmacy on the east side, and a series of residences and the Francis N. O'Hara building on the west side. The site slopes approximately 35 feet from south to north, with the high point of the site being at Massachusetts Ave. and the low point being on the east side of the site at the end of the Mill Brook culvert. Mill Brook flows through the site from west to east between the existing building and the football stadium via a subsurface concrete box culvert, which splits into two corrugated metal culverts on the east side of the existing building before daylighting on the east side of the site adjacent to Mill Street Extension.

The proposed project includes a new 143,025 square foot High School building footprint with associated new paved parking areas, landscaping, athletic fields, bathroom building, utilities and a new stormwater management system in accordance with the Massachusetts DEP Stormwater Standards. The existing football stadium will remain as is and is not within the scope of this project.

Existing Site Hydrology:

In the existing condition, site drainage is handled by a series of "daisy-chained" catch basins that capture stormwater flows and conveys it via underground stormwater piping to the Mill Brook culvert. There is also a large existing culvert, consisting of a 36" reinforced concrete pipe (RCP), that flows under the existing building and discharges to the Mill Brook culvert. This 36" culvert carries a large upgradient offsite watershed from South of the project site that measures over 4,500,000 sf (105+ Ac). See figure within the appendices of this report. Historically this culvert has been shown to be undersized and has caused flooding and floor buckling within the basement of the High School.

From a stormwater treatment perspective, there is an existing oil/water separator unit on the north side of the building, however this structure only treats a single catchment area of a much larger impervious area on-site. The field areas and football stadium have underdrainage system that ties into the Mill Brook culvert as well.

According to FEMA flood mapping, the site is located within Zones X and AE (see FEMA Firmette Map within the appendices of this report). These flood zones are depicted graphically on the civil design plans and existing conditions plans per the FEMA delineation. However, after a field survey of elevations present at the site, we have concluded that the flood elevations shown on the FEMA mapping are held within the banks of the Mill Brook and do not encroach on the site. During the last major renovation at the school, there was a small area on the east side of the school dedicated for compensatory storage.

Methodology/ Procedure

The proposed Stormwater Management system will include several stormwater Best Management Practices (BMPs) consisting of deep sump catch basins, water quality treatment units, an underground

infiltration system, and three (3) lined rain gardens used for filtration. See the Proposed Watersheds section within this report for detailed information about the proposed BMPs for each watershed included in the stormwater management design.

Watershed Routing

Below is a summary of the various existing and proposed watersheds with a brief narrative describing the routing. The watersheds are depicted in sketches Ex-HYD and P-HYD located in the appendices of this report. The hydrology maps show a single point of analysis (POA) in both the existing conditions and the proposed conditions. POA-1 represents the culmination point of stormwater flows across the site within Mill Brook on the east side of the site.

Existing Watersheds:

Ex- Watershed-1: This watershed consists of the existing high school building, fields, paved parking areas and landscaped areas across the site. Stormwater from this watershed sheet flows overland to existing catch basins across the site, which are conveyed via existing underground piping to the existing drainage systems on the north side of the site before discharging to Mill Brook, defined as POA-1.

Proposed Watersheds:

P- Watershed-1: This watershed consists of paved parking areas, pedestrian walkways, and landscaped areas that sheet flow overland to the proposed deep sump catch basins, where it is then conveyed to a proposed water quality unit prior to discharging to the culvertized portion of Mill Brook on the east side of the site, defined as Point of Analysis 1 (POA-1).

P- Watershed-1A: This watershed consists of a portion of the paved parking area and landscaped area on the east side of the site. Stormwater sheet flows overland to proposed deep sump catch basins, where it is then conveyed to a proposed water quality unit prior to discharging to Mill Brook on the east side of the site, defined as Point of Analysis 1 (POA-1).

P- Watershed-1B: This watershed consists of the northwest portion of the proposed building. Stormwater is collected and piped underground via roof drain piping to the culvertized portion of Mill Brook, defined as Point of Analysis 1 (POA-1).

P- Watershed-1C: This watershed consists of pedestrian walkways, landscaped areas, and wooded areas on the east edge of the site. Stormwater sheet flows that do not discharge directly to Mill Brook flow overland to the abutting property where they eventually culminate at Mill Brook on the east side of the site, defined as Point of Analysis 1 (POA-1).

P- Watershed-1D: This watershed consists of the southern portion of the proposed building. Stormwater is collected and piped underground via roof drain piping to an existing drain pipe that discharges to Mill Brook on the east side of the site, defined as Point of Analysis 1 (POA-1).

P- Watershed-1E: This watershed consists of pedestrian walkways and landscaped areas that sheet flow overland to the proposed area drains, where it is then conveyed to the culvertized portion of Mill Brook on the east side of the site via underground piping, defined as Point of Analysis 1 (POA-1).

P- Watershed-2: This watershed consists of stormwater flows from the parking area, play area, and landscaped area on the east side of the site. Stormwater flows overland to proposed deep sump catch basins and is conveyed via underground pipe to a proposed underground infiltration system (UGS-1). In larger storm events, flows will discharge via an outlet control structure (OCS-1) and underground piping to an existing drain pipe that discharges to Mill Brook, defined as POA-1.

P- Watershed-2B: This watershed consists of the eastern portion of the proposed building. Stormwater is collected and piped underground via roof drain piping to a proposed underground infiltration system (UGS-1). In larger storm events, flows will discharge via an outlet control structure (OCS-1) and underground piping to an existing drain pipe that discharges to Mill Brook, defined as POA-1.

P- Watershed-3A: This watershed consists of paved parking areas, the Shouler Court paved roadway, pedestrian walkways, amphitheater area, and landscaped areas on the west side of the site that sheet flow overland to proposed deep sump catch basins. Stormwater flows are conveyed via underground piping to a proposed lined Rain Garden (RG-1). Stormwater passes through the soil media and the lined bioretention area channels the filtered stormwater through a perforated underdrain pipe at the bottom of the bioretention system that discharges to another proposed Rain Garden (RG-2), which also has an underdrain pipe collecting flow and discharging to the third Rain Garden (RG-3). This bioretention area has an underdrain and outlet control structure (OCS-2) discharging to the stormwater trunk line running along the north side of the proposed building. Flows from this trunk line are discharged to the culvertized portion of Mill Brook on the east side of the site, defined as Point of Analysis 1 (POA-1). Note that the proposed Rain Garden (RG-1) has an emergency spillway weir for larger storm events, which discharges to RG-2.

P- Watershed-3B: This watershed consists of paved parking areas and landscaped areas, as well as flows from the upstream RG-1 (see P-Watershed-3A description) on the west side of the site that sheet flow overland to proposed deep sump catch basins. Stormwater flows are conveyed via underground piping to a proposed lined Rain Garden (RG-2). Stormwater passes through the soil media and the lined rain garden channels the filtered stormwater through a perforated underdrain pipe at the bottom of the rain garden that discharges to another proposed Rain Garden (RG-3), which also has an underdrain pipe and outlet control structure (OCS-2) discharging to the stormwater trunk line running along the north side of the proposed building. Flows from this trunk line are discharged to the culvertized portion of Mill Brook on the east side of the site, defined as Point of Analysis 1 (POA-1). Note that the proposed Rain Garden (RG-2) has an emergency spillway weir for larger storm events, which discharges to RG-3.

P- Watershed-3C: This watershed consists of landscaped areas, as well as flows from the upstream RG-2 (see P-Watershed-3B description) on the west side of the site that sheet flow overland to proposed deep sump catch basins. Stormwater flows are conveyed via underground piping to a proposed lined Rain Garden (RG-3). Stormwater passes through the soil media and the lined rain garden channels the filtered stormwater through a perforated underdrain pipe at the bottom of the rain garden and is collected via an underdrain perforated pipe at the bottom of the rain garden that discharges to the stormwater trunk line running along the north side of the proposed building. Flows from this trunk line are discharged to the culvertized portion of Mill Brook on the east side of the site, defined as Point of Analysis 1 (POA-1). Note that the proposed Rain Garden (RG-3) has an outlet control structure associated with its design for larger storm events, which discharges to the outlet pipe and trunk line.

P- Watershed-4: This watershed consists of pedestrian walkways and synthetic turf soccer field areas on the west side of the site that are collected via underdrain piping and area drains and passed through a series of small detention basins prior to discharging to the trunk line on the north side of the proposed building and ultimately discharging to the culvertized portion of Mill Brook on the east side of the site, defined as Point of Analysis 1 (POA-1).

P- Watershed-5: This watershed consists of pedestrian walkways and synthetic turf baseball field areas on the east side of the site that are collected via underdrain piping and area drains and passed through a series of small detention basins prior to discharging to the culvertized portion of Mill Brook on the east side of the site, defined as Point of Analysis 1 (POA-1).

Flood Storage

As discussed previously within this report the site is graphically located within Flood Zones X and AE per FEMA mapping, but the actual elevations per the Flood Impact Study occur within the banks of the Mill Brook. There is a small compensatory storage area on the east side of the existing building that was for a previous project but not defined by elevations or compensatory storage volumes. This area will be disturbed by the proposed High School project. The proposed project even though not within flood plain elevations will emulate the existing compensatory storage by providing compensatory storage within the stone of the turf fields that far exceed the volume held by the existing flood storage area.

Results/ Summary

Analysis:

The analysis was based on the pre and post development peak discharge rates at the point of analysis. The proposed construction of the school campus will result in an increase in impervious area, therefore the proposed stormwater management system will be designed to mitigate any increase in the rate of runoff and improve stormwater quality in accordance with the requirements of the Massachusetts Stormwater Management Policy Standards.

Results of Analysis:

Through the use of the HydroCAD Software, the curve numbers, times of concentrations, and peak discharge rates were determined for both the existing conditions and the proposed conditions. The results of the study shows that both the post-development peak rates of runoff are equal or less than the existing rates. The rainfall data used to develop the analysis in Table 1 is based on NOAA Atlas 14 point precipitation frequency estimates for the site.

As shown in Table 1, the post development peak rates of runoff from the site to each POA will be mitigated.

Table 1 – POA-1 : Peak Rates of Runoff				
	2-year storm (cfs)	10-year storm (cfs)	25-year storm (cfs)	100-year storm (cfs)
Existing	22.53	49.33	67.06	94.91
Proposed	21.54	46.88	64.17	86.42

Stormwater Management Standards

The Department of Environmental Protection has implemented the Stormwater Management Standards as of November 18, 1996 and updated them in April 2008. The standards met are described below and in the Stormwater Management Form as provided by DEP.

Standard #1: Untreated Stormwater

The project is designed so that stormwater conveyances (outfalls/discharges) do not discharge untreated stormwater into, or cause erosion to, wetlands or waters.

Therefore Standard #1 is met.

Standard #2: Post-development peak discharge rates

The proposed construction of Arlington High School will result in an overall site increase in impervious area. The proposed stormwater management system has been designed so that there is no increase in post construction discharge rates from the site for each point of analysis by the introduction of stormwater BMPS such as bioretention areas and underground infiltration basins. See Table 1 of this report for existing and proposed flows to the Point of Analysis, showing that Standard #2 is met.

Therefore Standard #2 is met.

Standard #3: Recharge to groundwater

Loss of annual recharge to groundwater shall be eliminated or minimized through the use of environmentally sensitive site design, stormwater best management practices, and good operation and maintenance procedures. At a minimum, the annual recharge from the post- development site shall approximate the annual recharge from pre-development conditions based on soil type. This Standard is met when the stormwater management system is designed to infiltrate the required recharge volume as determined in accordance with the Massachusetts Stormwater Handbook.

Soil types have been identified based on the information contained in the Soil Report (see Soil Report within appendices of this report). Based on the available soil information provided in the appendices of this report, we have determined that the soils are consistent with Hydrologic soil type "B" which require runoff to be infiltrated (as listed in the table below) from new impervious areas. Test pit data from testing done on site confirms the Soil Report information in the appendices of this report.

Hydrologic Group Volume to Recharge x (Total Impervious Area)	
Hydrologic Group	Volume to Recharge x Total Impervious Area
A	0.60 inches of runoff
B	0.35 inches of runoff
C	0.25 inches of runoff
D	0.10 inches of runoff

"B" Soils

Infiltration Rate: 0.35 inches of runoff
Existing Impervious Area: 7.78 Ac. (338,984 sf)
Proposed Impervious Area: 8.63 Ac. (375,923 sf)
Proposed Site New Impervious Area in "B" Soils: 36,939 sf
 $36,939 \text{ sf} \times 0.35 \times (1/12) = 1,077 \text{ cf}$

Total required recharge volume: 1,077 cf

Proposed Recharge Volume:
Infiltration System UGS-1 = 3,251 cf

Total provided recharge volume: 3,251 cf

Drawdown Time:

UGS-1 (maximum time 72 hours)= $3,251 \text{ cf} / (1.02 \text{ in/hr} \times 1,672 \text{ sf} / 12 \text{ in/ft}) = 22.88 \text{ hours}$

Therefore Standard #3 is met.

Standard #4: TSS removal

The BMP's selected to remove TSS from impervious areas for this include: Deep Sump Catch Basins (CB), Water Quality Units (WQU), three (3) bioretention areas & an Infiltration System (UGS-1). Building roof runoff is considered "clean" and therefore does not require TSS removal.

P-Watershed-1: (Parking, Walkways)
Deep Sump Catch Basin: $(1.00)(1.00-0.25) = 0.75$
Water Quality Unit: $(0.75)(1.00-0.80) = 0.15$
Total TSS Removal= 85%

P-Watershed-1A: (Parking, Walkways)
Deep Sump Catch Basin: $(1.00)(1.00-0.25) = 0.75$
Water Quality Unit: $(0.75)(1.00-0.80) = 0.15$
Total TSS Removal= 85%

P-Watershed-2: (Parking, Walkways)
Deep Sump Catch Basin: $(1.00)(1.00-0.25) = 0.75$
Infiltration Basin: $(0.75)(1.00-0.80) = 0.15$
Total TSS Removal= 85%

P-Watershed-3A: (Parking, Walkways)
Deep Sump Catch Basin: $(1.00)(1.00-0.25) = 0.75$
Bioretention Area: $(0.75)(1.00-0.90) = 0.075$
Bioretention Area: $(0.08)(1.00-0.90) = 0.008$
Bioretention Area: $(0.01)(1.00-0.90) = 0.001$
Total TSS Removal= 99.9%

P-Watershed-3B: (Parking)
Deep Sump Catch Basin: $(1.00)(1.00-0.25) = 0.75$
Bioretention Area: $(0.75)(1.00-0.90) = 0.075$
Bioretention Area: $(0.08)(1.00-0.90) = 0.008$
Total TSS Removal= 99%

Water Quality Volume:

The project qualifies for the 0.5" runoff rate applied to the total impervious area for the water quality volume, as shown in the calculations provided below. The calculations for the infiltration stormwater BMPs are shown below. Where site topography and groundwater elevation precluded the use of infiltration BMPs, proprietary water quality unit are proposed which are specifically designed to address water quality prior to discharge. Roof runoff is considered "clean" and has therefore been excluded from this calculation.

Impervious area requiring water quality treatment= 82,241 sf
 $82,241 \text{ sf} \times .0417 \text{ ft} = 3,429 \text{ CF}$

Total Water Quality Volume Required = 3,429 CF

Proposed Water Quality Volume:

Infiltration System UGS-1 = 3,251 cf

Bioretention System RG-1 = 551 cf

Bioretention System RG-2 = 1,200 cf

Bioretention System RG-3 = 2,283 cf

Total provided water quality volume: 7,285 cf

Therefore Standard #4 is met.

Standard #5: Higher potential pollutant loads

The project site does not contain Land Uses with Higher Potential Pollutant Loads, therefore Standard #5 is met.

Standard #6: Protection of critical areas

Critical areas are Outstanding Resource Waters (ORW) as designated in 314 CMR 4.00, Special Resource Waters as designated in 314 CMR 4.00, recharge areas for public water supplies as defined in 310 CMR 22.02 (Zone Is, Zone IIs and Interim Wellhead Protection Areas for groundwater sources and Zone As for surface water sources), bathing beaches as defined in 105 CMR 445.000, cold-water fisheries as defined in 314 CMR 9.02 and 310 CMR 10.04, and shellfish growing areas as defined in 314 CMR 9.02 and 310 CMR 10.04.

The site is not located within critical areas, therefore Standard #6 is met.

Standard #7: Redevelopment projects

While a portion of the site is being redeveloped, there is an increase in impervious area, thus the project is considered New Construction and all of the Standards will be met.

Standard #8: Construction Period Pollution Prevention and Erosion and Sedimentation Control

Soil Erosion and Sediment Control Plan:

The objectives of the Soil Erosion and Sediment Control Plan are to control erosion at its source with temporary control structures, minimize the runoff from areas of disturbance, and de-concentrate and distribute stormwater runoff through natural vegetation before discharge to critical zones such as streams or wetlands. Soil erosion control does not begin with the perimeter sediment trap. It begins at the source of the sediment, the disturbed land areas, and extends down to the control structure.

The Soil Erosion and Sediment Control Plan will be enacted in order to protect the resource areas during construction. The erosion control devices will remain in place until all exposed areas have been stabilized with vegetation or impervious surfaces.

The objective of the Soil Erosion & Sediment Control Plan that will be enacted on site is to control the vulnerability of the soil to the erosion process or the capability of moving water to detach soil particles during the construction phase(s).

The soil erosion and sediment control BMP's for the site are straw wattles with silt fence, catch basin filters, and a construction entrance as shown on design plans prepared by Samiotes Consultants, Inc.

Therefore Standard #8 is met.

Standard #9: Operation/maintenance plan

An operation and maintenance plan for both construction and post-development stormwater controls has been developed. The plan includes owner(s); parties responsible for operation and maintenance; schedule for inspection and maintenance; routine and non-routine maintenance tasks. A copy of the O&M is included in the appendices of this report.

Therefore Standard #9 is met.

Standard #10: All illicit discharges to the stormwater management system are prohibited


It is not anticipated that there will be any Illicit discharges for the project as it will be new construction, therefore Standard #10 is met.



Checklist for Stormwater Report

A. Introduction

Important: When filling out forms on the computer, use only the tab key to move your cursor - do not use the return key.



A Stormwater Report must be submitted with the Notice of Intent permit application to document compliance with the Stormwater Management Standards. The following checklist is NOT a substitute for the Stormwater Report (which should provide more substantive and detailed information) but is offered here as a tool to help the applicant organize their Stormwater Management documentation for their Report and for the reviewer to assess this information in a consistent format. As noted in the Checklist, the Stormwater Report must contain the engineering computations and supporting information set forth in Volume 3 of the [Massachusetts Stormwater Handbook](#). The Stormwater Report must be prepared and certified by a Registered Professional Engineer (RPE) licensed in the Commonwealth.

The Stormwater Report must include:

- The Stormwater Checklist completed and stamped by a Registered Professional Engineer (see page 2) that certifies that the Stormwater Report contains all required submittals.¹ This Checklist is to be used as the cover for the completed Stormwater Report.
- Applicant/Project Name
- Project Address
- Name of Firm and Registered Professional Engineer that prepared the Report
- Long-Term Pollution Prevention Plan required by Standards 4-6
- Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan required by Standard 8²
- Operation and Maintenance Plan required by Standard 9

In addition to all plans and supporting information, the Stormwater Report must include a brief narrative describing stormwater management practices, including environmentally sensitive site design and LID techniques, along with a diagram depicting runoff through the proposed BMP treatment train. Plans are required to show existing and proposed conditions, identify all wetland resource areas, NRCS soil types, critical areas, Land Uses with Higher Potential Pollutant Loads (LUHPPL), and any areas on the site where infiltration rate is greater than 2.4 inches per hour. The Plans shall identify the drainage areas for both existing and proposed conditions at a scale that enables verification of supporting calculations.

As noted in the Checklist, the Stormwater Management Report shall document compliance with each of the Stormwater Management Standards as provided in the Massachusetts Stormwater Handbook. The soils evaluation and calculations shall be done using the methodologies set forth in Volume 3 of the Massachusetts Stormwater Handbook.

To ensure that the Stormwater Report is complete, applicants are required to fill in the Stormwater Report Checklist by checking the box to indicate that the specified information has been included in the Stormwater Report. If any of the information specified in the checklist has not been submitted, the applicant must provide an explanation. The completed Stormwater Report Checklist and Certification must be submitted with the Stormwater Report.

¹ The Stormwater Report may also include the Illicit Discharge Compliance Statement required by Standard 10. If not included in the Stormwater Report, the Illicit Discharge Compliance Statement must be submitted prior to the discharge of stormwater runoff to the post-construction best management practices.

² For some complex projects, it may not be possible to include the Construction Period Erosion and Sedimentation Control Plan in the Stormwater Report. In that event, the issuing authority has the discretion to issue an Order of Conditions that approves the project and includes a condition requiring the proponent to submit the Construction Period Erosion and Sedimentation Control Plan before commencing any land disturbance activity on the site.



Checklist for Stormwater Report

B. Stormwater Checklist and Certification

The following checklist is intended to serve as a guide for applicants as to the elements that ordinarily need to be addressed in a complete Stormwater Report. The checklist is also intended to provide conservation commissions and other reviewing authorities with a summary of the components necessary for a comprehensive Stormwater Report that addresses the ten Stormwater Standards.


Note: Because stormwater requirements vary from project to project, it is possible that a complete Stormwater Report may not include information on some of the subjects specified in the Checklist. If it is determined that a specific item does not apply to the project under review, please note that the item is not applicable (N.A.) and provide the reasons for that determination.

A complete checklist must include the Certification set forth below signed by the Registered Professional Engineer who prepared the Stormwater Report.

Registered Professional Engineer's Certification

I have reviewed the Stormwater Report, including the soil evaluation, computations, Long-term Pollution Prevention Plan, the Construction Period Erosion and Sedimentation Control Plan (if included), the Long-term Post-Construction Operation and Maintenance Plan, the Illicit Discharge Compliance Statement (if included) and the plans showing the stormwater management system, and have determined that they have been prepared in accordance with the requirements of the Stormwater Management Standards as further elaborated by the Massachusetts Stormwater Handbook. I have also determined that the information presented in the Stormwater Checklist is accurate and that the information presented in the Stormwater Report accurately reflects conditions at the site as of the date of this permit application.

Registered Professional Engineer Block and Signature

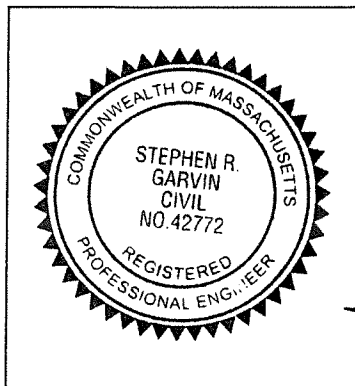

[Handwritten Signature]
Signature and Date

5/7/20

Checklist

Project Type: Is the application for new development, redevelopment, or a mix of new and redevelopment?

- ☐ New development
- ☐ Redevelopment
- ☒ Mix of New Development and Redevelopment



Checklist for Stormwater Report


Checklist (continued)

LID Measures: Stormwater Standards require LID measures to be considered. Document what environmentally sensitive design and LID Techniques were considered during the planning and design of the project:

- ☒ No disturbance to any Wetland Resource Areas
- ☐ Site Design Practices (e.g. clustered development, reduced frontage setbacks)
- ☐ Reduced Impervious Area (Redevelopment Only)
- ☐ Minimizing disturbance to existing trees and shrubs
- ☐ LID Site Design Credit Requested:
 - ☐ Credit 1
 - ☐ Credit 2
 - ☐ Credit 3
- ☐ Use of "country drainage" versus curb and gutter conveyance and pipe
- ☒ Bioretention Cells (includes Rain Gardens)
- ☐ Constructed Stormwater Wetlands (includes Gravel Wetlands designs)
- ☐ Treebox Filter
- ☐ Water Quality Swale
- ☐ Grass Channel
- ☐ Green Roof
- ☐ Other (describe): _____

Standard 1: No New Untreated Discharges

- ☒ No new untreated discharges
- ☒ Outlets have been designed so there is no erosion or scour to wetlands and waters of the Commonwealth
- ☒ Supporting calculations specified in Volume 3 of the Massachusetts Stormwater Handbook included.



Checklist for Stormwater Report

Checklist (continued)

Standard 2: Peak Rate Attenuation

- ☐ Standard 2 waiver requested because the project is located in land subject to coastal storm flowage and stormwater discharge is to a wetland subject to coastal flooding.
- ☐ Evaluation provided to determine whether off-site flooding increases during the 100-year 24-hour storm.
- ☒ Calculations provided to show that post-development peak discharge rates do not exceed pre-development rates for the 2-year and 10-year 24-hour storms. If evaluation shows that off-site flooding increases during the 100-year 24-hour storm, calculations are also provided to show that post-development peak discharge rates do not exceed pre-development rates for the 100-year 24-hour storm.

Standard 3: Recharge

- ☒ Soil Analysis provided.
- ☒ Required Recharge Volume calculation provided.
- ☐ Required Recharge volume reduced through use of the LID site Design Credits.
- ☒ Sizing the infiltration, BMPs is based on the following method: Check the method used.
 - ☒ Static
 - ☐ Simple Dynamic
 - ☐ Dynamic Field¹
- ☐ Runoff from all impervious areas at the site discharging to the infiltration BMP.
- ☒ Runoff from all impervious areas at the site is *not* discharging to the infiltration BMP and calculations are provided showing that the drainage area contributing runoff to the infiltration BMPs is sufficient to generate the required recharge volume.
- ☒ Recharge BMPs have been sized to infiltrate the Required Recharge Volume.
- ☐ Recharge BMPs have been sized to infiltrate the Required Recharge Volume *only* to the maximum extent practicable for the following reason:
 - ☐ Site is comprised solely of C and D soils and/or bedrock at the land surface
 - ☐ M.G.L. c. 21E sites pursuant to 310 CMR 40.0000
 - ☐ Solid Waste Landfill pursuant to 310 CMR 19.000
 - ☐ Project is otherwise subject to Stormwater Management Standards only to the maximum extent practicable.
- ☒ Calculations showing that the infiltration BMPs will drain in 72 hours are provided.
- ☐ Property includes a M.G.L. c. 21E site or a solid waste landfill and a mounding analysis is included.

¹ 80% TSS removal is required prior to discharge to infiltration BMP if Dynamic Field method is used.



Checklist for Stormwater Report

Checklist (continued)

Standard 3: Recharge (continued)

- ☐ The infiltration BMP is used to attenuate peak flows during storms greater than or equal to the 10-year 24-hour storm and separation to seasonal high groundwater is less than 4 feet and a mounding analysis is provided.
- ☐ Documentation is provided showing that infiltration BMPs do not adversely impact nearby wetland resource areas.

Standard 4: Water Quality

The Long-Term Pollution Prevention Plan typically includes the following:

- Good housekeeping practices;
 - Provisions for storing materials and waste products inside or under cover;
 - Vehicle washing controls;
 - Requirements for routine inspections and maintenance of stormwater BMPs;
 - Spill prevention and response plans;
 - Provisions for maintenance of lawns, gardens, and other landscaped areas;
 - Requirements for storage and use of fertilizers, herbicides, and pesticides;
 - Pet waste management provisions;
 - Provisions for operation and management of septic systems;
 - Provisions for solid waste management;
 - Snow disposal and plowing plans relative to Wetland Resource Areas;
 - Winter Road Salt and/or Sand Use and Storage restrictions;
 - Street sweeping schedules;
 - Provisions for prevention of illicit discharges to the stormwater management system;
 - Documentation that Stormwater BMPs are designed to provide for shutdown and containment in the event of a spill or discharges to or near critical areas or from LUHPPL;
 - Training for staff or personnel involved with implementing Long-Term Pollution Prevention Plan;
 - List of Emergency contacts for implementing Long-Term Pollution Prevention Plan.
- ☒ A Long-Term Pollution Prevention Plan is attached to Stormwater Report and is included as an attachment to the Wetlands Notice of Intent.
 - ☐ Treatment BMPs subject to the 44% TSS removal pretreatment requirement and the one inch rule for calculating the water quality volume are included, and discharge:
 - ☐ is within the Zone II or Interim Wellhead Protection Area
 - ☐ is near or to other critical areas
 - ☐ is within soils with a rapid infiltration rate (greater than 2.4 inches per hour)
 - ☐ involves runoff from land uses with higher potential pollutant loads.
 - ☐ The Required Water Quality Volume is reduced through use of the LID site Design Credits.
 - ☒ Calculations documenting that the treatment train meets the 80% TSS removal requirement and, if applicable, the 44% TSS removal pretreatment requirement, are provided.



Checklist for Stormwater Report

Checklist (continued)

Standard 4: Water Quality (continued)

- ☒ The BMP is sized (and calculations provided) based on:
 - ☒ The ½" or 1" Water Quality Volume or
 - ☐ The equivalent flow rate associated with the Water Quality Volume and documentation is provided showing that the BMP treats the required water quality volume.
- ☒ The applicant proposes to use proprietary BMPs, and documentation supporting use of proprietary BMP and proposed TSS removal rate is provided. This documentation may be in the form of the propriety BMP checklist found in Volume 2, Chapter 4 of the Massachusetts Stormwater Handbook and submitting copies of the TARP Report, STEP Report, and/or other third party studies verifying performance of the proprietary BMPs.
- ☐ A TMDL exists that indicates a need to reduce pollutants other than TSS and documentation showing that the BMPs selected are consistent with the TMDL is provided.

Standard 5: Land Uses With Higher Potential Pollutant Loads (LUHPPLs)

- ☐ The NPDES Multi-Sector General Permit covers the land use and the Stormwater Pollution Prevention Plan (SWPPP) has been included with the Stormwater Report.
- ☒ The NPDES Multi-Sector General Permit covers the land use and the SWPPP will be submitted **prior to** the discharge of stormwater to the post-construction stormwater BMPs.
- ☐ The NPDES Multi-Sector General Permit does **not** cover the land use.
- ☐ LUHPPLs are located at the site and industry specific source control and pollution prevention measures have been proposed to reduce or eliminate the exposure of LUHPPLs to rain, snow, snow melt and runoff, and been included in the long term Pollution Prevention Plan.
- ☐ All exposure has been eliminated.
- ☐ All exposure has **not** been eliminated and all BMPs selected are on MassDEP LUHPPL list.
- ☐ The LUHPPL has the potential to generate runoff with moderate to higher concentrations of oil and grease (e.g. all parking lots with >1000 vehicle trips per day) and the treatment train includes an oil grit separator, a filtering bioretention area, a sand filter or equivalent.

Standard 6: Critical Areas

- ☐ The discharge is near or to a critical area and the treatment train includes only BMPs that MassDEP has approved for stormwater discharges to or near that particular class of critical area.
- ☐ Critical areas and BMPs are identified in the Stormwater Report.



Checklist for Stormwater Report

Checklist (continued)

Standard 7: Redevelopments and Other Projects Subject to the Standards only to the maximum extent practicable

- ☒ The project is subject to the Stormwater Management Standards only to the maximum Extent Practicable as a:
 - ☐ Limited Project
 - ☐ Small Residential Projects: 5-9 single family houses or 5-9 units in a multi-family development provided there is no discharge that may potentially affect a critical area.
 - ☐ Small Residential Projects: 2-4 single family houses or 2-4 units in a multi-family development with a discharge to a critical area
 - ☐ Marina and/or boatyard provided the hull painting, service and maintenance areas are protected from exposure to rain, snow, snow melt and runoff
 - ☐ Bike Path and/or Foot Path
 - ☐ Redevelopment Project
- ☒ Redevelopment portion of mix of new and redevelopment.
- ☐ Certain standards are not fully met (Standard No. 1, 8, 9, and 10 must always be fully met) and an explanation of why these standards are not met is contained in the Stormwater Report.
- ☐ The project involves redevelopment and a description of all measures that have been taken to improve existing conditions is provided in the Stormwater Report. The redevelopment checklist found in Volume 2 Chapter 3 of the Massachusetts Stormwater Handbook may be used to document that the proposed stormwater management system (a) complies with Standards 2, 3 and the pretreatment and structural BMP requirements of Standards 4-6 to the maximum extent practicable and (b) improves existing conditions.

Standard 8: Construction Period Pollution Prevention and Erosion and Sedimentation Control

A Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan must include the following information:

- Narrative;
 - Construction Period Operation and Maintenance Plan;
 - Names of Persons or Entity Responsible for Plan Compliance;
 - Construction Period Pollution Prevention Measures;
 - Erosion and Sedimentation Control Plan Drawings;
 - Detail drawings and specifications for erosion control BMPs, including sizing calculations;
 - Vegetation Planning;
 - Site Development Plan;
 - Construction Sequencing Plan;
 - Sequencing of Erosion and Sedimentation Controls;
 - Operation and Maintenance of Erosion and Sedimentation Controls;
 - Inspection Schedule;
 - Maintenance Schedule;
 - Inspection and Maintenance Log Form.
- ☒ A Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan containing the information set forth above has been included in the Stormwater Report.



Checklist for Stormwater Report

Checklist (continued)

Standard 8: Construction Period Pollution Prevention and Erosion and Sedimentation Control (continued)

- ☐ The project is highly complex and information is included in the Stormwater Report that explains why it is not possible to submit the Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan with the application. A Construction Period Pollution Prevention and Erosion and Sedimentation Control has **not** been included in the Stormwater Report but will be submitted **before** land disturbance begins.
- ☐ The project is **not** covered by a NPDES Construction General Permit.
- ☐ The project is covered by a NPDES Construction General Permit and a copy of the SWPPP is in the Stormwater Report.
- ☒ The project is covered by a NPDES Construction General Permit but no SWPPP been submitted. The SWPPP will be submitted BEFORE land disturbance begins.

Standard 9: Operation and Maintenance Plan

- ☒ The Post Construction Operation and Maintenance Plan is included in the Stormwater Report and includes the following information:
 - ☒ Name of the stormwater management system owners;
 - ☒ Party responsible for operation and maintenance;
 - ☒ Schedule for implementation of routine and non-routine maintenance tasks;
 - ☒ Plan showing the location of all stormwater BMPs maintenance access areas;
 - ☐ Description and delineation of public safety features;
 - ☐ Estimated operation and maintenance budget; and
 - ☒ Operation and Maintenance Log Form.
- ☐ The responsible party is **not** the owner of the parcel where the BMP is located and the Stormwater Report includes the following submissions:
 - ☐ A copy of the legal instrument (deed, homeowner's association, utility trust or other legal entity) that establishes the terms of and legal responsibility for the operation and maintenance of the project site stormwater BMPs;
 - ☐ A plan and easement deed that allows site access for the legal entity to operate and maintain BMP functions.

Standard 10: Prohibition of Illicit Discharges

- ☐ The Long-Term Pollution Prevention Plan includes measures to prevent illicit discharges;
- ☐ An Illicit Discharge Compliance Statement is attached;
- ☒ NO Illicit Discharge Compliance Statement is attached but will be submitted **prior to** the discharge of any stormwater to post-construction BMPs.

APPENDIX 1:
Existing Hydrology Calculations

APPENDIX 2:
Proposed Hydrology Calculations


APPENDIX 3:
Test Pit Logs
Soils Report

APPENDIX 4:
Operations and Maintenance Plan



APPENDIX 5:
Calculations

APPENDIX 6:
Sketches



APPENDIX 1:
Existing Hydrology Calculations



Existing Watershed 1

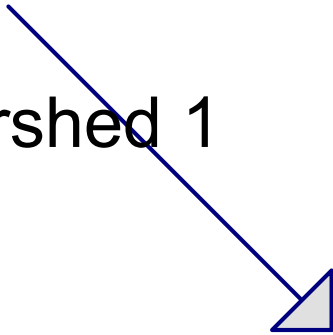

POA



Routing Diagram for 17211.00 Arlington HS - Existing Conditions - NOI Resubmission

Prepared by Samiotes Engineering, Printed 5/28/2020
HydroCAD® 10.00-24 s/n 03575 © 2018 HydroCAD Software Solutions LLC

17211.00 Arlington HS - Existing Conditions - NOI Resubmission

Prepared by Samiotes Engineering

Printed 5/28/2020

HydroCAD® 10.00-24 s/n 03575 © 2018 HydroCAD Software Solutions LLC

Page 2

Area Listing (all nodes)

Area (acres)	CN	Description (subcatchment-numbers)
9.598	61	>75% Grass cover, Good, HSG B (EX-WS-1)
5.051	98	Impervious (EX-WS-1)
2.731	98	Roofs, HSG B (EX-WS-1)
0.020	55	Woods, Good, HSG B (EX-WS-1)
17.400	78	TOTAL AREA

Summary for Subcatchment EX-WS-1: Existing Watershed 1


Runoff = 22.53 cfs @ 12.16 hrs, Volume= 1.932 af, Depth= 1.33"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
 Type III 24-hr 2 yr Rainfall=3.28"

Area (ac)	CN	Description
* 5.051	98	Impervious
2.731	98	Roofs, HSG B
9.598	61	>75% Grass cover, Good, HSG B
0.020	55	Woods, Good, HSG B
17.400	78	Weighted Average
9.618		55.28% Pervious Area
7.782		44.72% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.4	50	0.0100	0.11		Sheet Flow, 50' SF Grass: Short n= 0.150 P2= 3.20"
1.9	220	0.0140	1.90		Shallow Concentrated Flow, 220' SCF Unpaved Kv= 16.1 fps
0.9	140	0.0150	2.49		Shallow Concentrated Flow, 140' SCF (paved) Paved Kv= 20.3 fps
0.1	20	0.0100	4.91	3.86	Pipe Channel, 12" Pipe Flow 12.0" Round Area= 0.8 sf Perim= 3.1' r= 0.25' n= 0.012
0.7	500	0.0050	11.67	466.77	Pipe Channel, Box Culvert Flow 96.0" x 60.0" Box Area= 40.0 sf Perim= 26.0' r= 1.54' n= 0.012
11.0	930	Total			

Subcatchment EX-WS-1: Existing Watershed 1

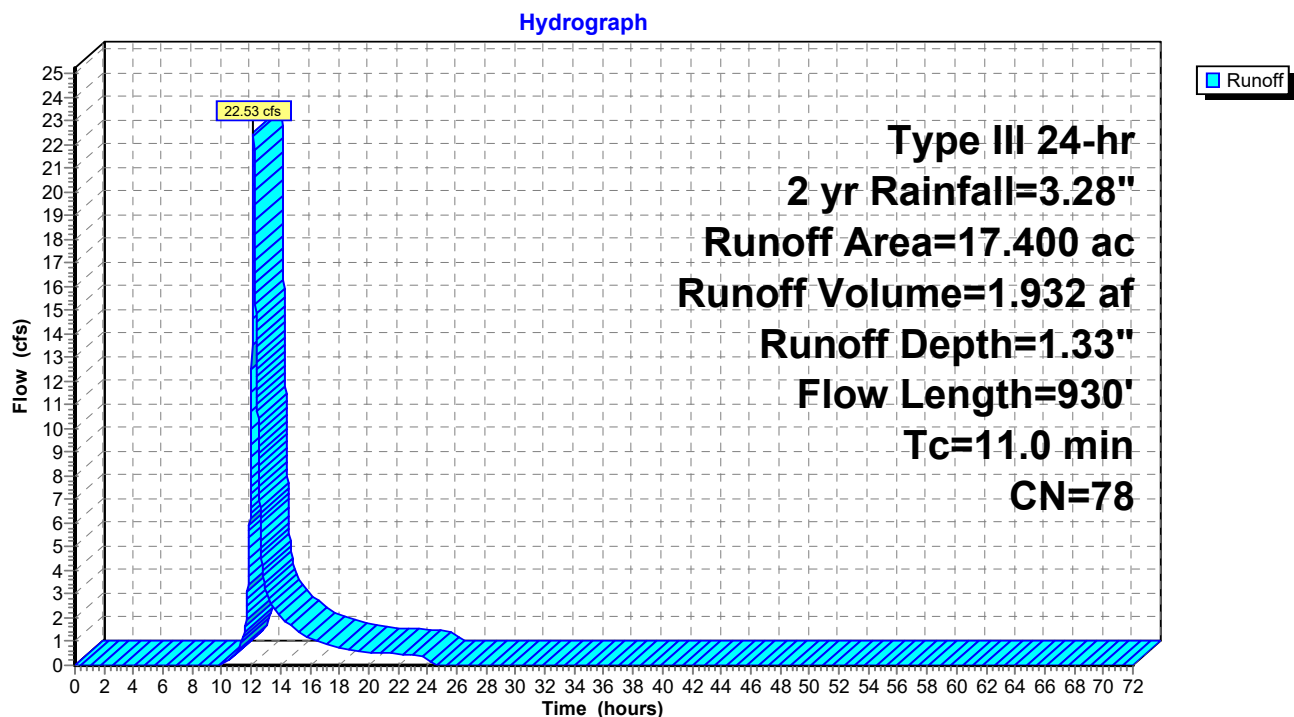


Summary for Link POA: POA

Inflow Area = 17.400 ac, 44.72% Impervious, Inflow Depth = 1.33" for 2 yr event
Inflow = 22.53 cfs @ 12.16 hrs, Volume= 1.932 af
Primary = 22.53 cfs @ 12.16 hrs, Volume= 1.932 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Link POA: POA

Hydrograph

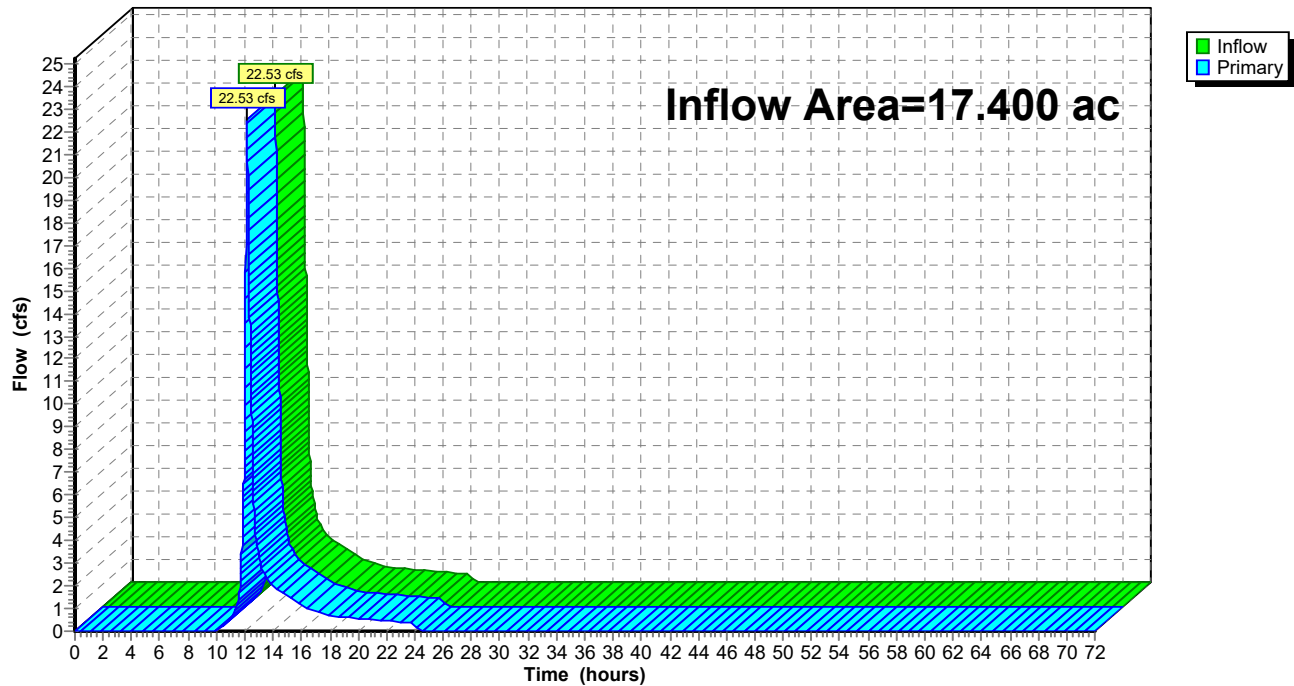

Summary for Subcatchment EX-WS-1: Existing Watershed 1


Runoff = 49.33 cfs @ 12.15 hrs, Volume= 4.142 af, Depth= 2.86"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
 Type III 24-hr 10 yr Rainfall=5.17"

Area (ac)	CN	Description
* 5.051	98	Impervious
2.731	98	Roofs, HSG B
9.598	61	>75% Grass cover, Good, HSG B
0.020	55	Woods, Good, HSG B
17.400	78	Weighted Average
9.618		55.28% Pervious Area
7.782		44.72% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.4	50	0.0100	0.11		Sheet Flow, 50' SF Grass: Short n= 0.150 P2= 3.20"
1.9	220	0.0140	1.90		Shallow Concentrated Flow, 220' SCF Unpaved Kv= 16.1 fps
0.9	140	0.0150	2.49		Shallow Concentrated Flow, 140' SCF (paved) Paved Kv= 20.3 fps
0.1	20	0.0100	4.91	3.86	Pipe Channel, 12" Pipe Flow 12.0" Round Area= 0.8 sf Perim= 3.1' r= 0.25' n= 0.012
0.7	500	0.0050	11.67	466.77	Pipe Channel, Box Culvert Flow 96.0" x 60.0" Box Area= 40.0 sf Perim= 26.0' r= 1.54' n= 0.012
11.0	930	Total			

Subcatchment EX-WS-1: Existing Watershed 1

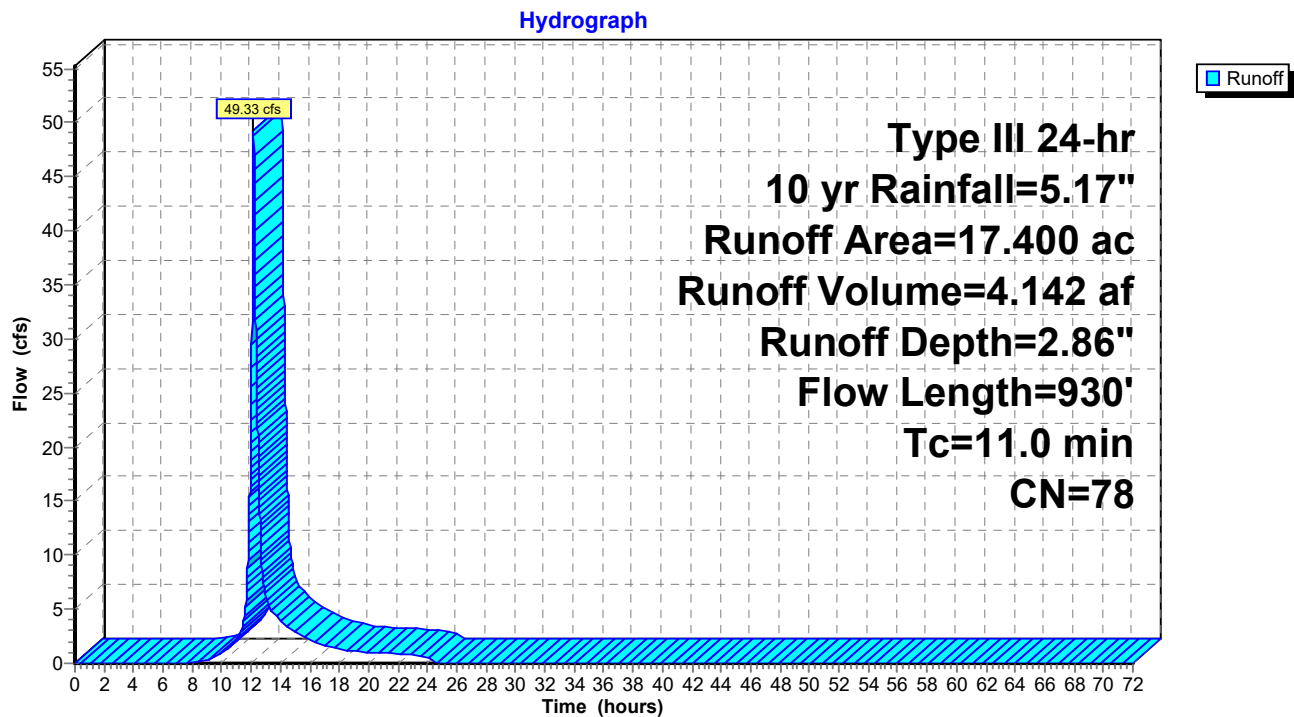


Summary for Link POA: POA

Inflow Area = 17.400 ac, 44.72% Impervious, Inflow Depth = 2.86" for 10 yr event
Inflow = 49.33 cfs @ 12.15 hrs, Volume= 4.142 af
Primary = 49.33 cfs @ 12.15 hrs, Volume= 4.142 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Link POA: POA

Hydrograph

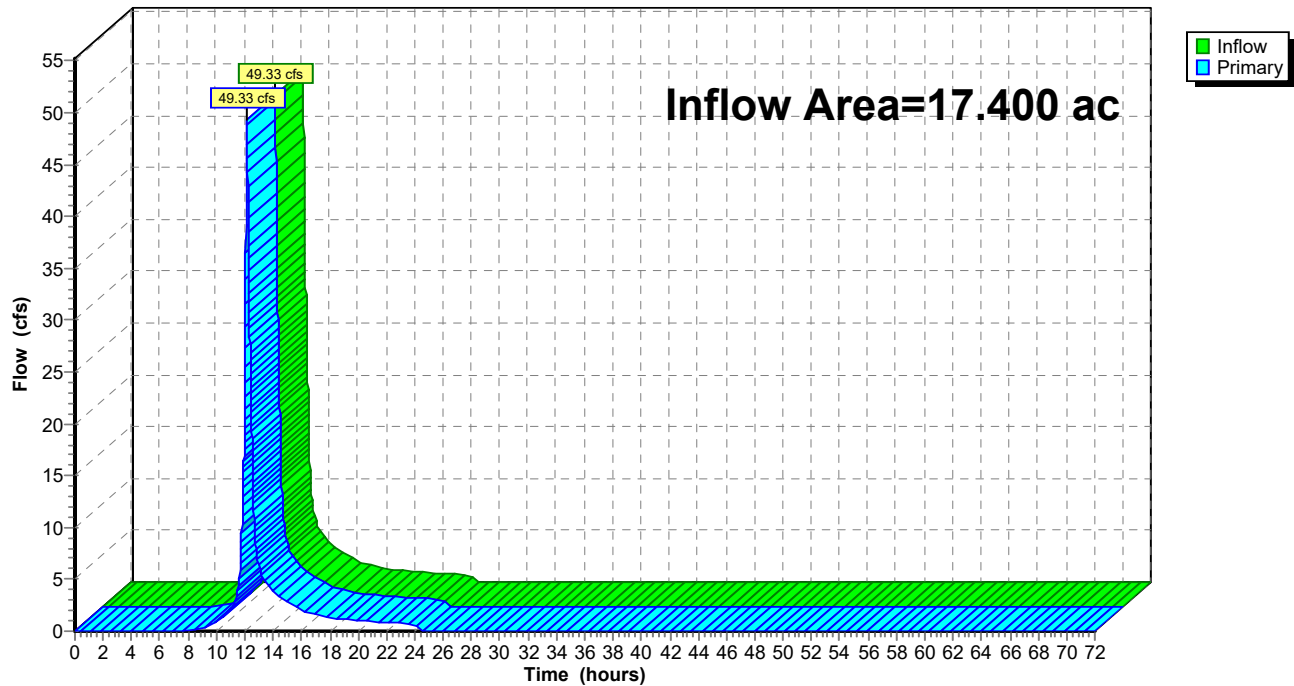

Summary for Subcatchment EX-WS-1: Existing Watershed 1


Runoff = 67.06 cfs @ 12.15 hrs, Volume= 5.640 af, Depth= 3.89"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
 Type III 24-hr 25 yr Rainfall=6.35"

Area (ac)	CN	Description
* 5.051	98	Impervious
2.731	98	Roofs, HSG B
9.598	61	>75% Grass cover, Good, HSG B
0.020	55	Woods, Good, HSG B
17.400	78	Weighted Average
9.618		55.28% Pervious Area
7.782		44.72% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.4	50	0.0100	0.11		Sheet Flow, 50' SF Grass: Short n= 0.150 P2= 3.20"
1.9	220	0.0140	1.90		Shallow Concentrated Flow, 220' SCF Unpaved Kv= 16.1 fps
0.9	140	0.0150	2.49		Shallow Concentrated Flow, 140' SCF (paved) Paved Kv= 20.3 fps
0.1	20	0.0100	4.91	3.86	Pipe Channel, 12" Pipe Flow 12.0" Round Area= 0.8 sf Perim= 3.1' r= 0.25' n= 0.012
0.7	500	0.0050	11.67	466.77	Pipe Channel, Box Culvert Flow 96.0" x 60.0" Box Area= 40.0 sf Perim= 26.0' r= 1.54' n= 0.012
11.0	930	Total			

Subcatchment EX-WS-1: Existing Watershed 1

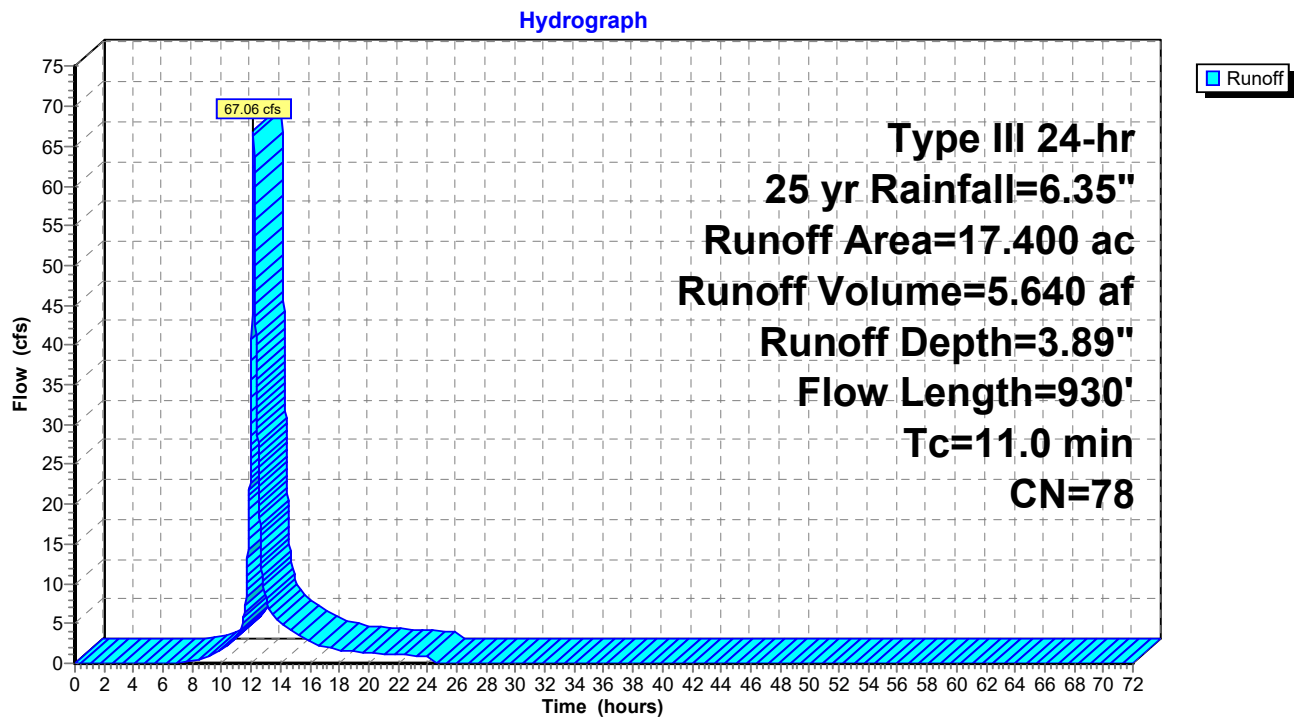


Summary for Link POA: POA

Inflow Area = 17.400 ac, 44.72% Impervious, Inflow Depth = 3.89" for 25 yr event
Inflow = 67.06 cfs @ 12.15 hrs, Volume= 5.640 af
Primary = 67.06 cfs @ 12.15 hrs, Volume= 5.640 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Link POA: POA

Hydrograph

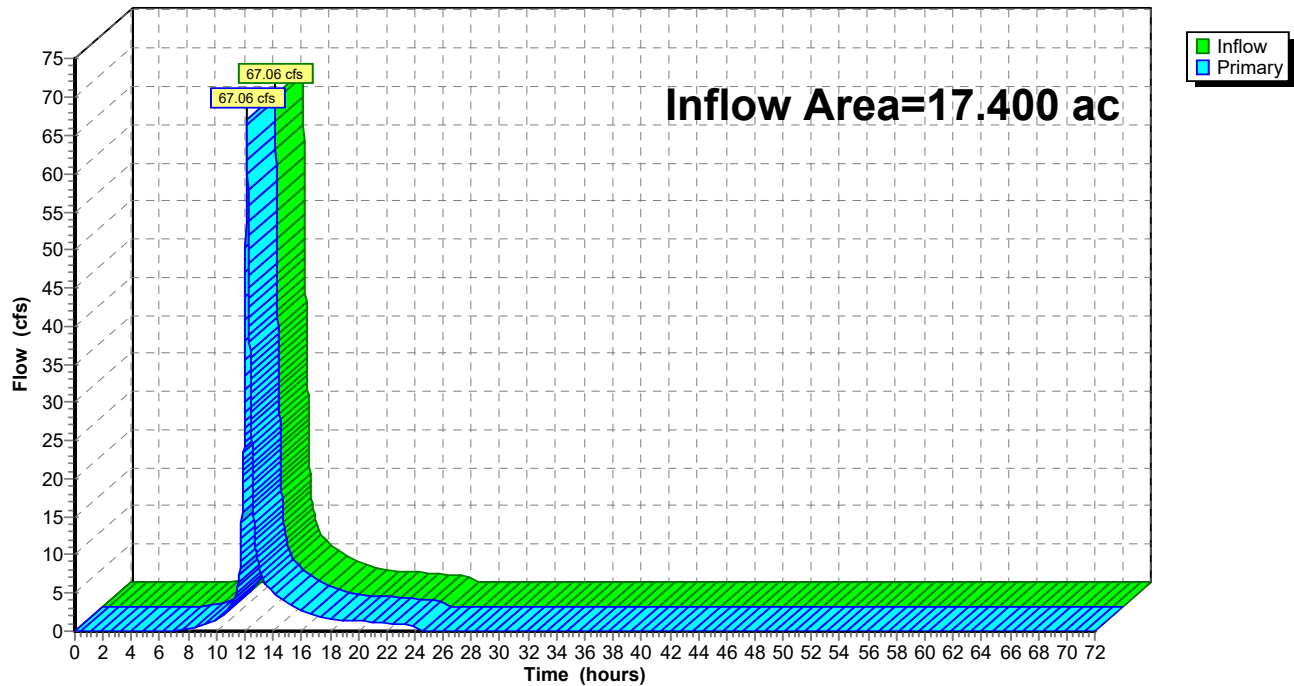

Summary for Subcatchment EX-WS-1: Existing Watershed 1


Runoff = 94.91 cfs @ 12.15 hrs, Volume= 8.045 af, Depth= 5.55"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
 Type III 24-hr 100 yr Rainfall=8.17"

Area (ac)	CN	Description
* 5.051	98	Impervious
2.731	98	Roofs, HSG B
9.598	61	>75% Grass cover, Good, HSG B
0.020	55	Woods, Good, HSG B
17.400	78	Weighted Average
9.618		55.28% Pervious Area
7.782		44.72% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.4	50	0.0100	0.11		Sheet Flow, 50' SF Grass: Short n= 0.150 P2= 3.20"
1.9	220	0.0140	1.90		Shallow Concentrated Flow, 220' SCF Unpaved Kv= 16.1 fps
0.9	140	0.0150	2.49		Shallow Concentrated Flow, 140' SCF (paved) Paved Kv= 20.3 fps
0.1	20	0.0100	4.91	3.86	Pipe Channel, 12" Pipe Flow 12.0" Round Area= 0.8 sf Perim= 3.1' r= 0.25' n= 0.012
0.7	500	0.0050	11.67	466.77	Pipe Channel, Box Culvert Flow 96.0" x 60.0" Box Area= 40.0 sf Perim= 26.0' r= 1.54' n= 0.012
11.0	930	Total			

Subcatchment EX-WS-1: Existing Watershed 1

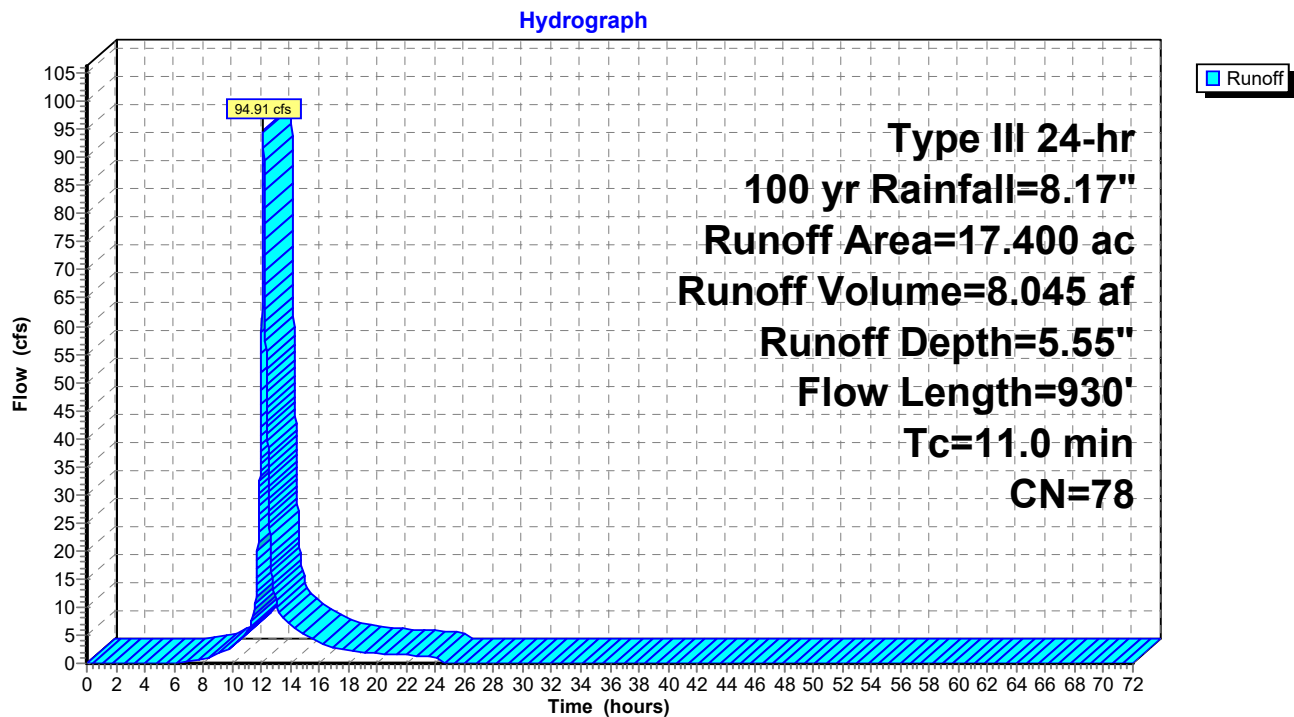


Summary for Link POA: POA

Inflow Area = 17.400 ac, 44.72% Impervious, Inflow Depth = 5.55" for 100 yr event
Inflow = 94.91 cfs @ 12.15 hrs, Volume= 8.045 af
Primary = 94.91 cfs @ 12.15 hrs, Volume= 8.045 af, Atten= 0%, Lag= 0.0 min




Primary outflow = Inflow, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Link POA: POA

Hydrograph

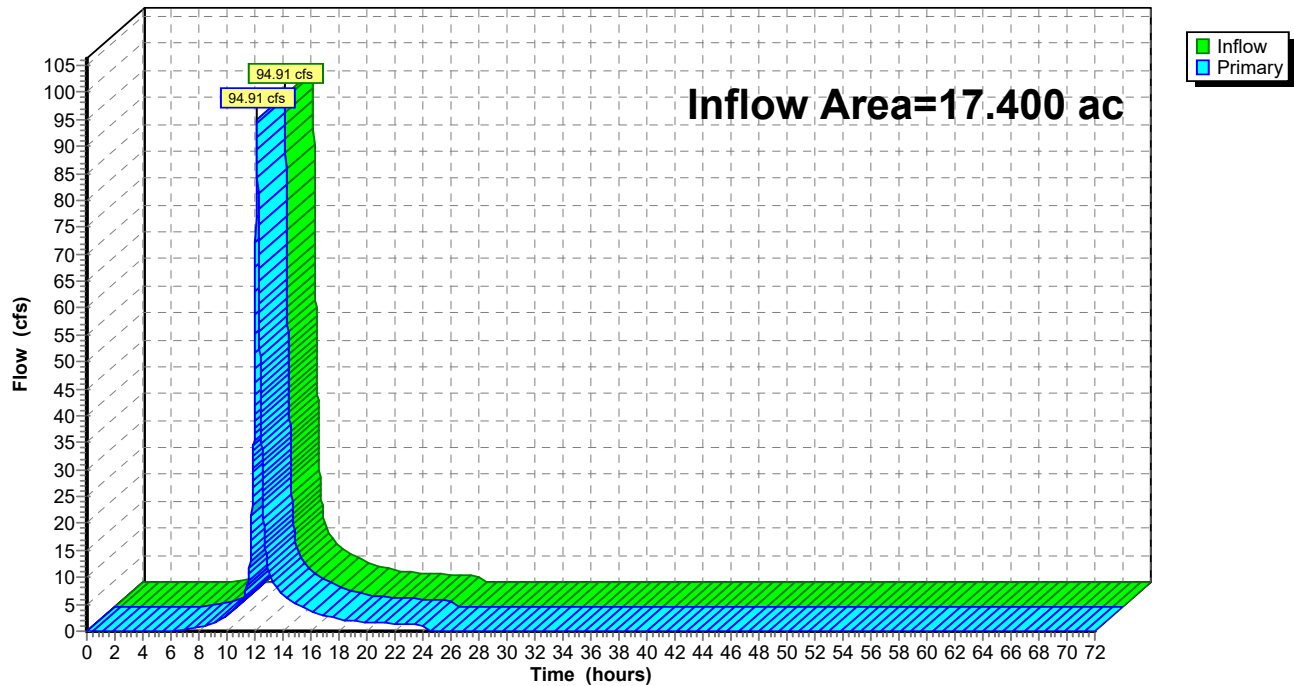

APPENDIX 2:
Proposed Hydrology Calculations

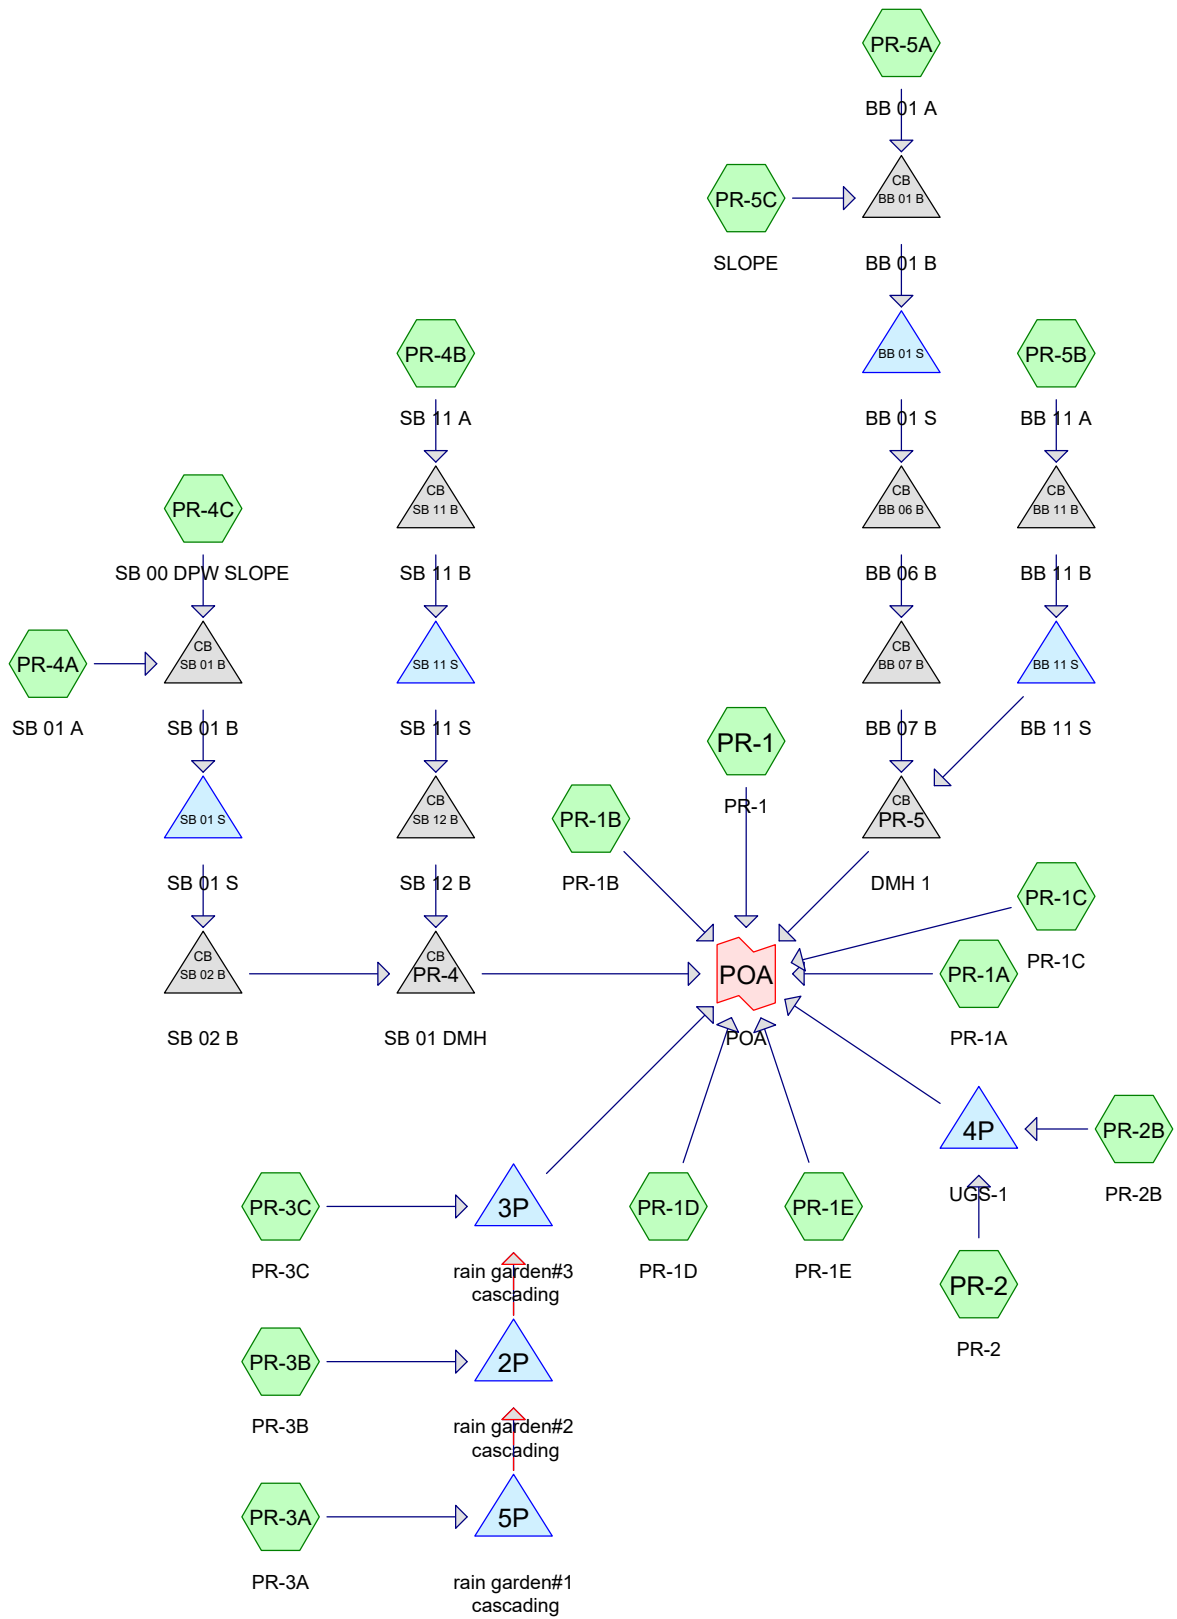

Routing Diagram for 17211.00 Arlington HS - Proposed Conditions - NOI Resubmission
 Prepared by Samiotes Engineering, Printed 5/28/2020
 HydroCAD® 10.00-24 s/n 03575 © 2018 HydroCAD Software Solutions LLC

17211.00 Arlington HS - Proposed Conditions - NOI Resubmission

Prepared by Samiotes Engineering

Printed 5/28/2020

HydroCAD® 10.00-24 s/n 03575 © 2018 HydroCAD Software Solutions LLC

Page 2

Area Listing (all nodes)

Area (acres)	CN	Description (subcatchment-numbers)
4.473	61	>75% Grass cover, Good, HSG B (PR-1, PR-1A, PR-1C, PR-1E, PR-2, PR-3A, PR-3B, PR-3C)
0.220	74	>75% Grass cover, Good, HSG C (PR-4C, PR-5C)
4.964	98	Paved parking, HSG B (PR-1, PR-1A, PR-1C, PR-1E, PR-2, PR-3A, PR-3B)
3.627	98	Roofs, HSG B (PR-1B, PR-1D, PR-2B)
4.056	85	SYNTHETIC TURF- PAD- LINER (PR-4A, PR-4B, PR-5A, PR-5B)
0.025	98	Unconnected pavement, HSG A (PR-4C)
0.014	98	Unconnected roofs, HSG C (PR-5C)
0.020	55	Woods, Good, HSG B (PR-1C)
17.400	85	TOTAL AREA

Summary for Subcatchment PR-1: PR-1


Runoff = 7.28 cfs @ 12.13 hrs, Volume= 0.588 af, Depth= 1.60"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 2 yr Rainfall=3.28"

Area (ac)	CN	Description
1.892	61	>75% Grass cover, Good, HSG B
2.510	98	Paved parking, HSG B
4.402	82	Weighted Average
1.892		42.98% Pervious Area
2.510		57.02% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.2	50	0.0050	0.69		Sheet Flow, A-B
					Smooth surfaces n= 0.011 P2= 3.20"
7.9	234	0.0050	0.49		Shallow Concentrated Flow, B-C
					Short Grass Pasture Kv= 7.0 fps
9.1	284	Total			

Subcatchment PR-1: PR-1

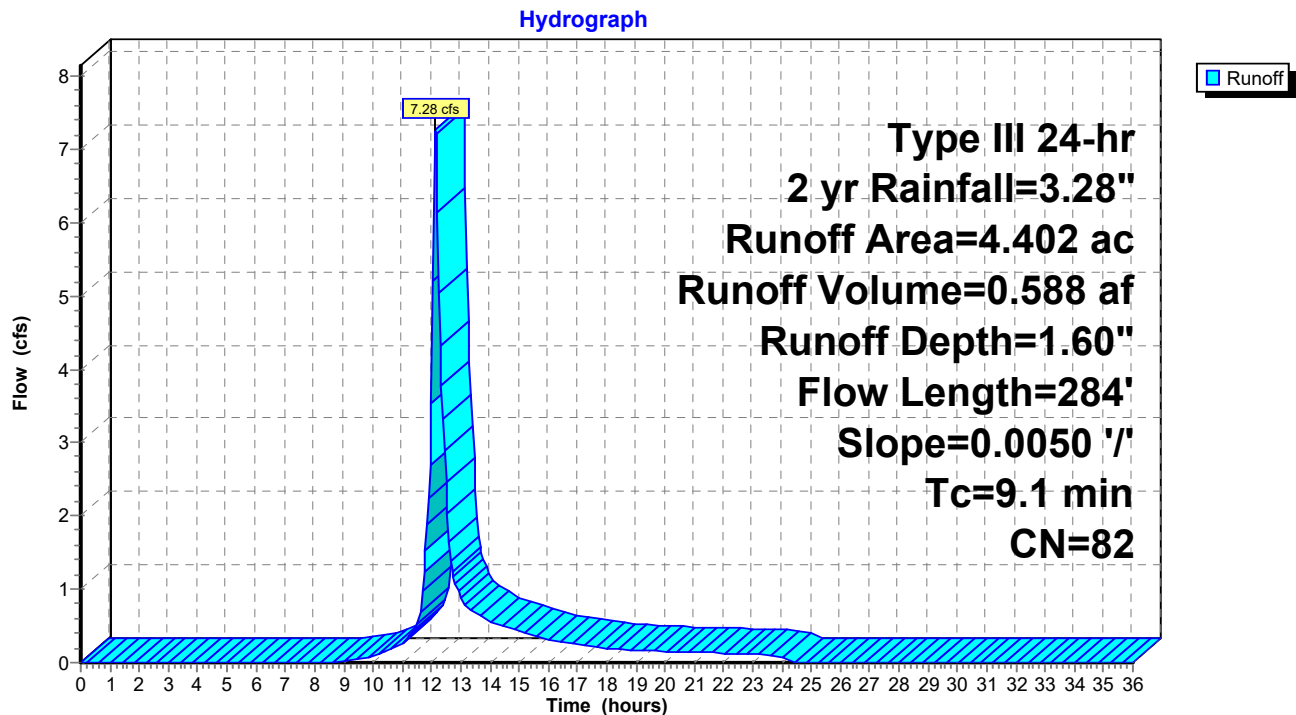

Summary for Subcatchment PR-1A: PR-1A


Runoff = 1.24 cfs @ 12.09 hrs, Volume= 0.091 af, Depth= 2.33"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 2 yr Rainfall=3.28"

Area (ac)	CN	Description
0.090	61	>75% Grass cover, Good, HSG B
0.380	98	Paved parking, HSG B
0.470	91	Weighted Average
0.090		19.15% Pervious Area
0.380		80.85% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-1A: PR-1A

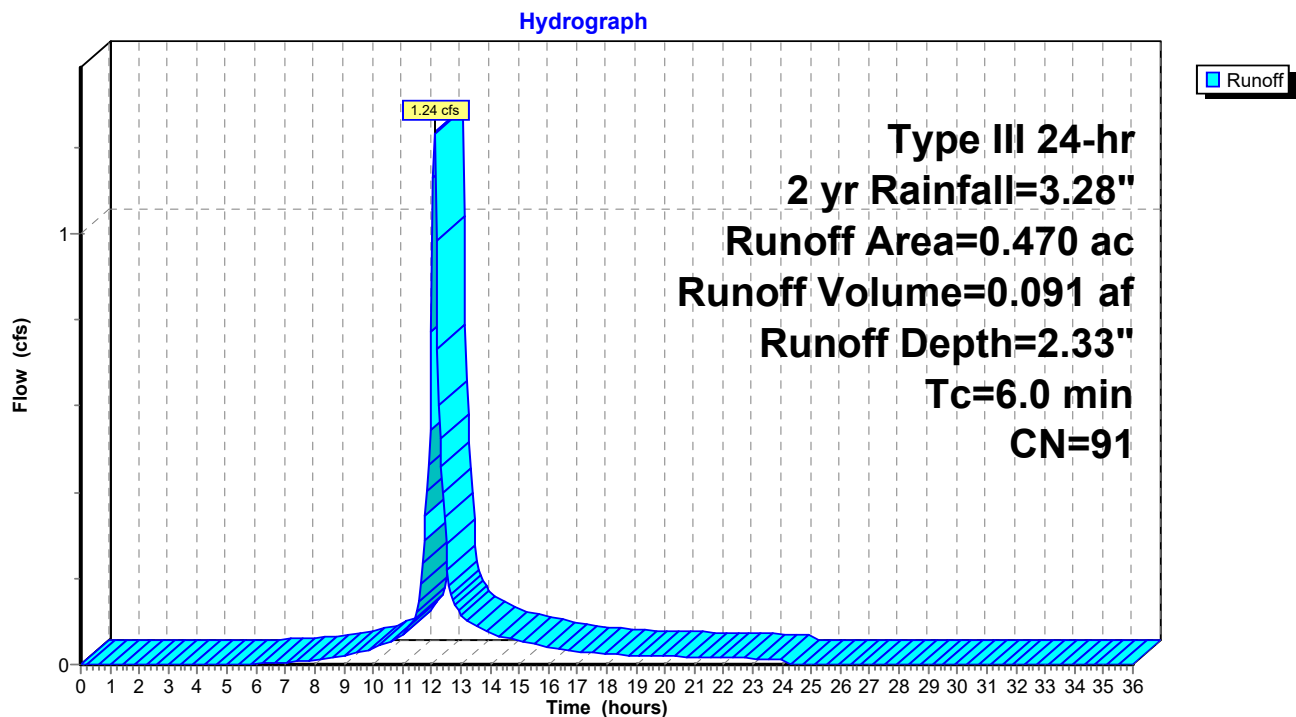

Summary for Subcatchment PR-1B: PR-1B

Runoff = 5.79 cfs @ 12.09 hrs, Volume= 0.473 af, Depth= 3.05"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 2 yr Rainfall=3.28"

Area (ac)	CN	Description
1.861	98	Roofs, HSG B
1.861		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-1B: PR-1B

Hydrograph

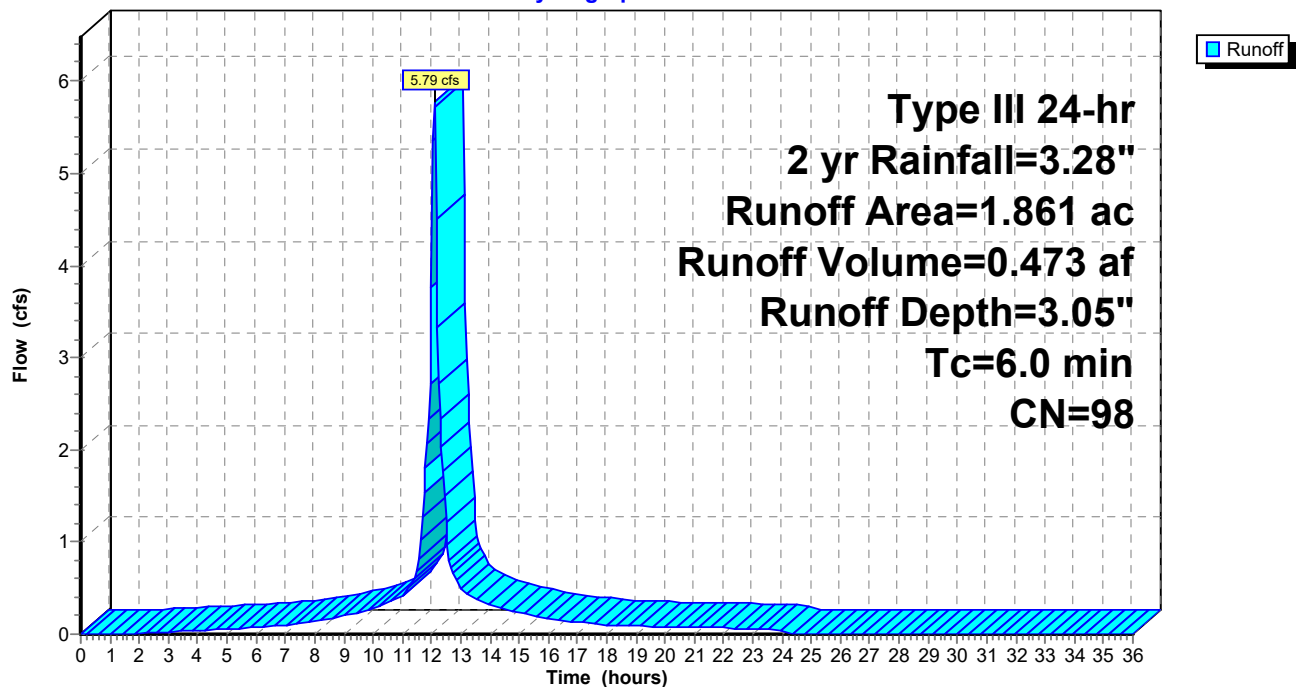

Summary for Subcatchment PR-1C: PR-1C


Runoff = 0.59 cfs @ 12.10 hrs, Volume= 0.044 af, Depth= 1.15"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 2 yr Rainfall=3.28"

Area (ac)	CN	Description
0.020	55	Woods, Good, HSG B
0.260	61	>75% Grass cover, Good, HSG B
0.180	98	Paved parking, HSG B
0.460	75	Weighted Average
0.280		60.87% Pervious Area
0.180		39.13% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.6	20	0.0700	0.09		Sheet Flow, 20' SF Woods: Light underbrush n= 0.400 P2= 3.20"
1.9	40	0.5000	0.35		Sheet Flow, 30' SF Grass: Dense n= 0.240 P2= 3.20"
0.1	12	0.0100	1.61		Shallow Concentrated Flow, 12' SCF Unpaved Kv= 16.1 fps
0.2	48	0.0400	4.06		Shallow Concentrated Flow, 48' SCF Paved Kv= 20.3 fps
5.8	120	Total, Increased to minimum Tc = 6.0 min			

Subcatchment PR-1C: PR-1C

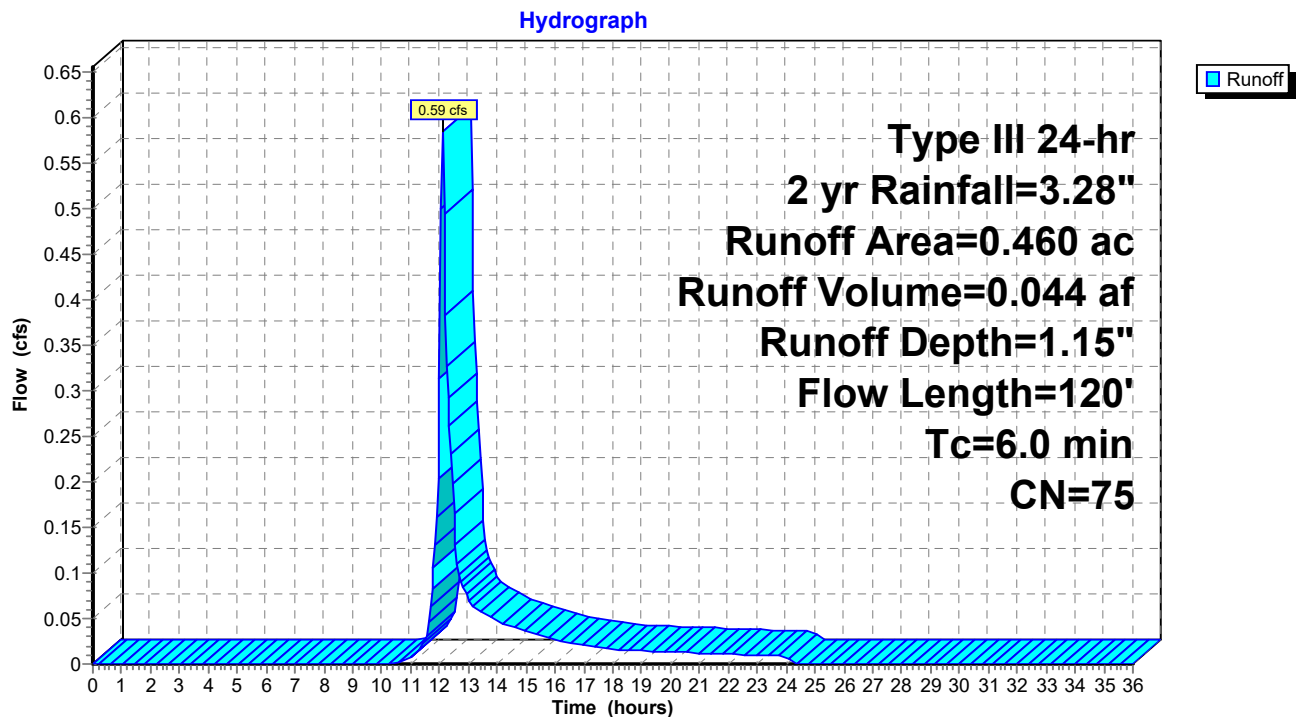

Summary for Subcatchment PR-1D: PR-1D

Runoff = 4.67 cfs @ 12.09 hrs, Volume= 0.381 af, Depth= 3.05"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 2 yr Rainfall=3.28"

Area (ac)	CN	Description
1.501	98	Roofs, HSG B
1.501		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-1D: PR-1D

Hydrograph

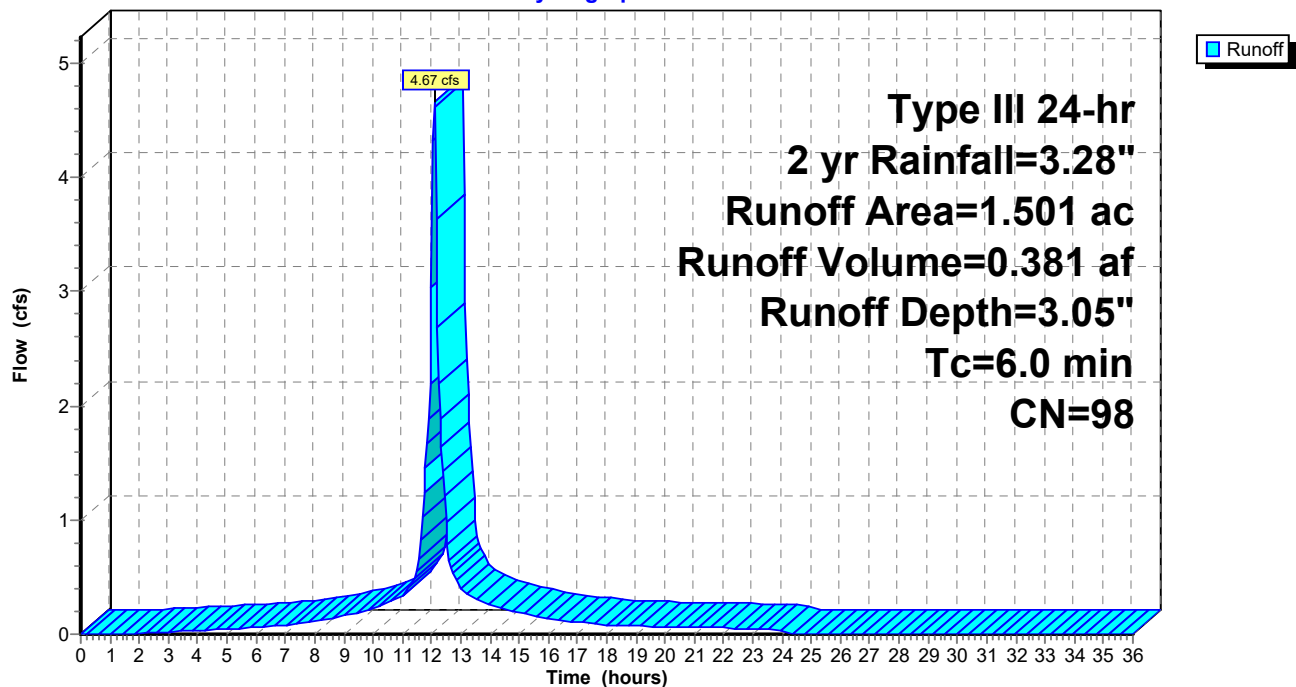

Summary for Subcatchment PR-1E: PR-1E


Runoff = 1.49 cfs @ 12.19 hrs, Volume= 0.139 af, Depth= 1.09"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 2 yr Rainfall=3.28"

Area (ac)	CN	Description
1.000	61	>75% Grass cover, Good, HSG B
0.533	98	Paved parking, HSG B
1.533	74	Weighted Average
1.000		65.23% Pervious Area
0.533		34.77% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.8	50	0.0050	0.09		Sheet Flow, 50' SF
					Grass: Short n= 0.150 P2= 3.20"
2.5	170	0.0050	1.14		Shallow Concentrated Flow, 170' SCF
					Unpaved Kv= 16.1 fps
12.3	220	Total			

Subcatchment PR-1E: PR-1E

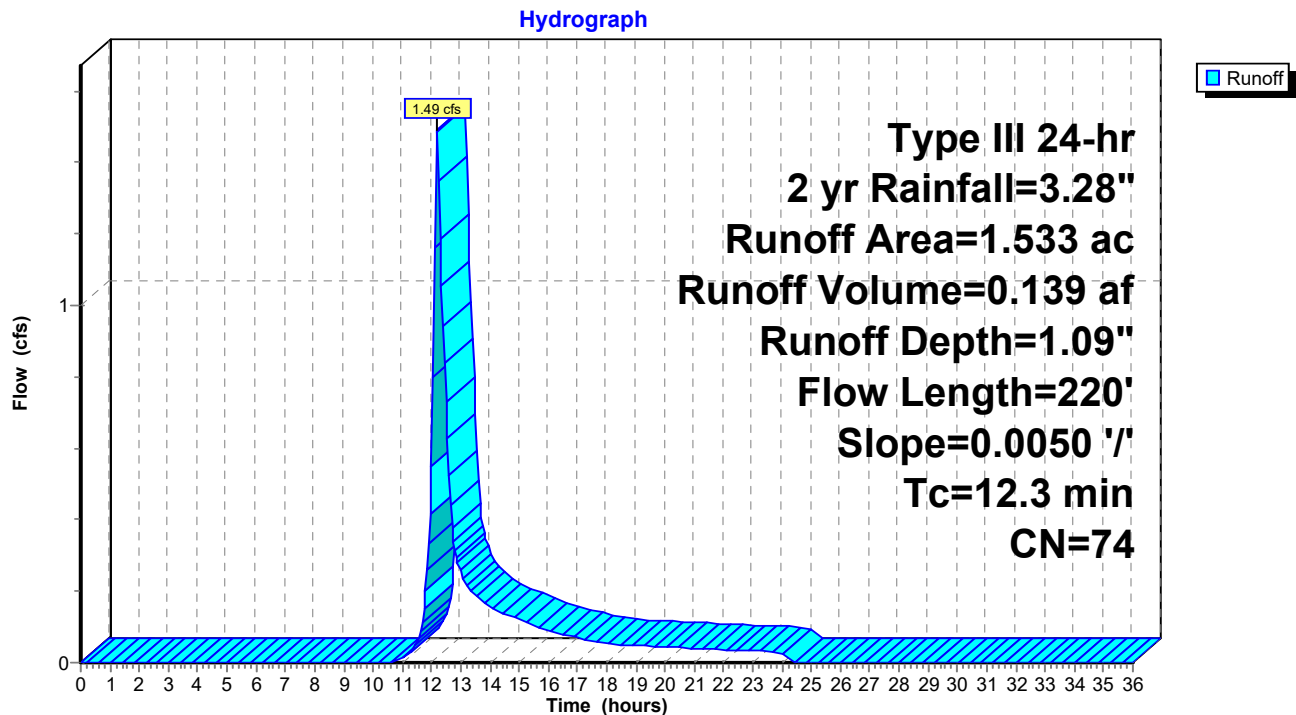

Summary for Subcatchment PR-2: PR-2

Runoff = 2.53 cfs @ 12.09 hrs, Volume= 0.184 af, Depth= 1.53"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 2 yr Rainfall=3.28"

Area (ac)	CN	Description
0.672	61	>75% Grass cover, Good, HSG B
0.768	98	Paved parking, HSG B
1.440	81	Weighted Average
0.672		46.67% Pervious Area
0.768		53.33% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-2: PR-2

Hydrograph

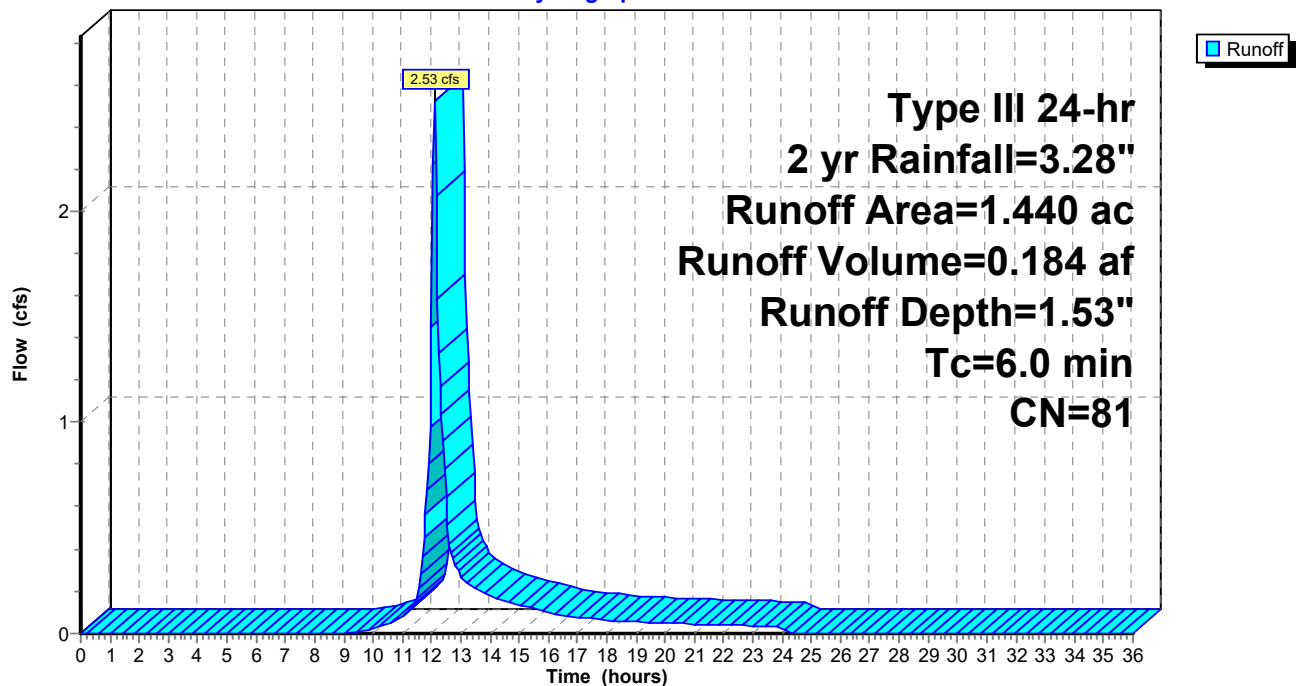

Summary for Subcatchment PR-2B: PR-2B

Runoff = 0.82 cfs @ 12.09 hrs, Volume= 0.067 af, Depth= 3.05"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 2 yr Rainfall=3.28"

Area (ac)	CN	Description
0.265	98	Roofs, HSG B
0.265		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-2B: PR-2B

Hydrograph

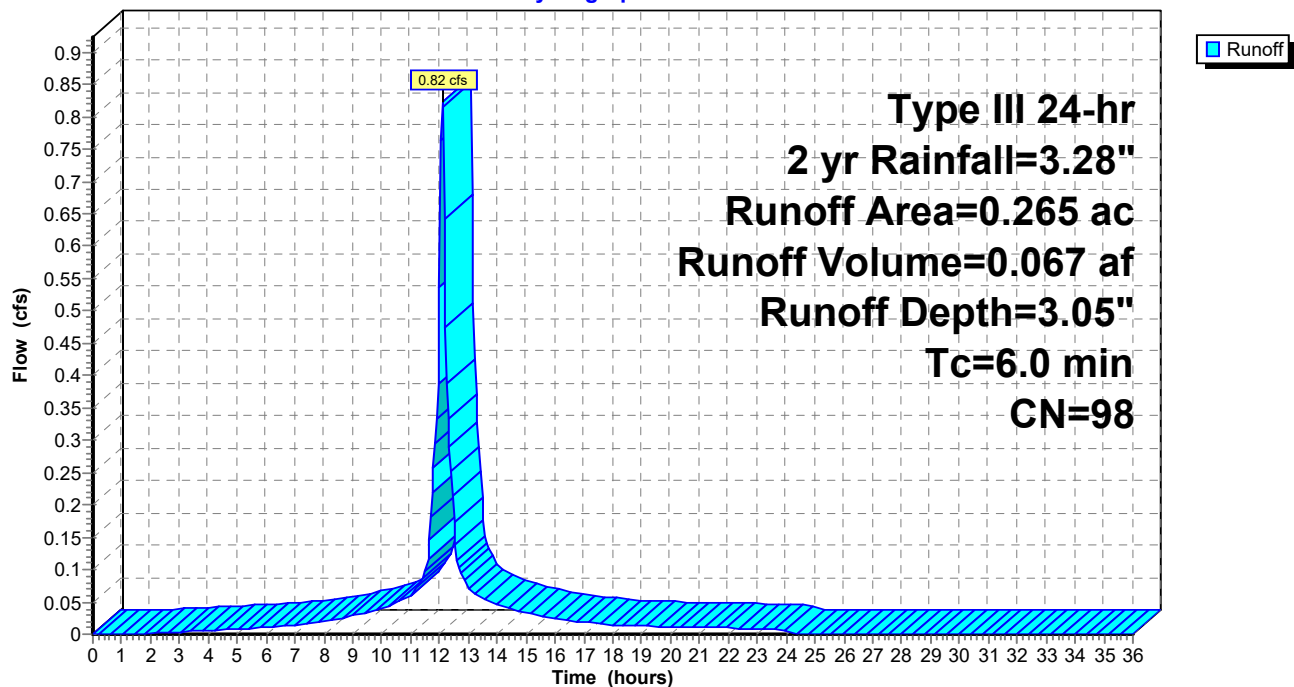

Summary for Subcatchment PR-3A: PR-3A


Runoff = 1.52 cfs @ 12.09 hrs, Volume= 0.110 af, Depth= 1.83"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 2 yr Rainfall=3.28"

Area (ac)	CN	Description
0.249	61	>75% Grass cover, Good, HSG B
0.476	98	Paved parking, HSG B
0.725	85	Weighted Average
0.249		34.34% Pervious Area
0.476		65.66% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-3A: PR-3A

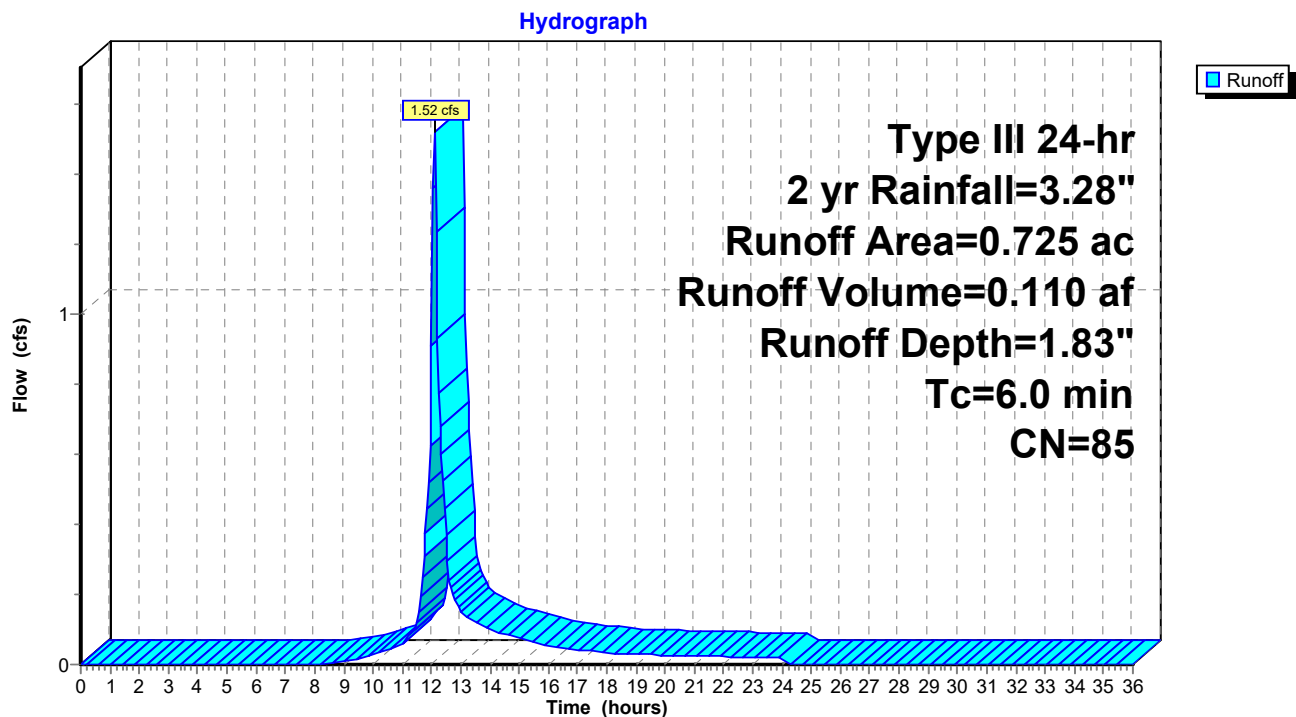

Summary for Subcatchment PR-3B: PR-3B

Runoff = 0.38 cfs @ 12.10 hrs, Volume= 0.028 af, Depth= 1.40"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 2 yr Rainfall=3.28"

Area (ac)	CN	Description
0.124	61	>75% Grass cover, Good, HSG B
0.117	98	Paved parking, HSG B
0.241	79	Weighted Average
0.124		51.45% Pervious Area
0.117		48.55% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-3B: PR-3B

Hydrograph

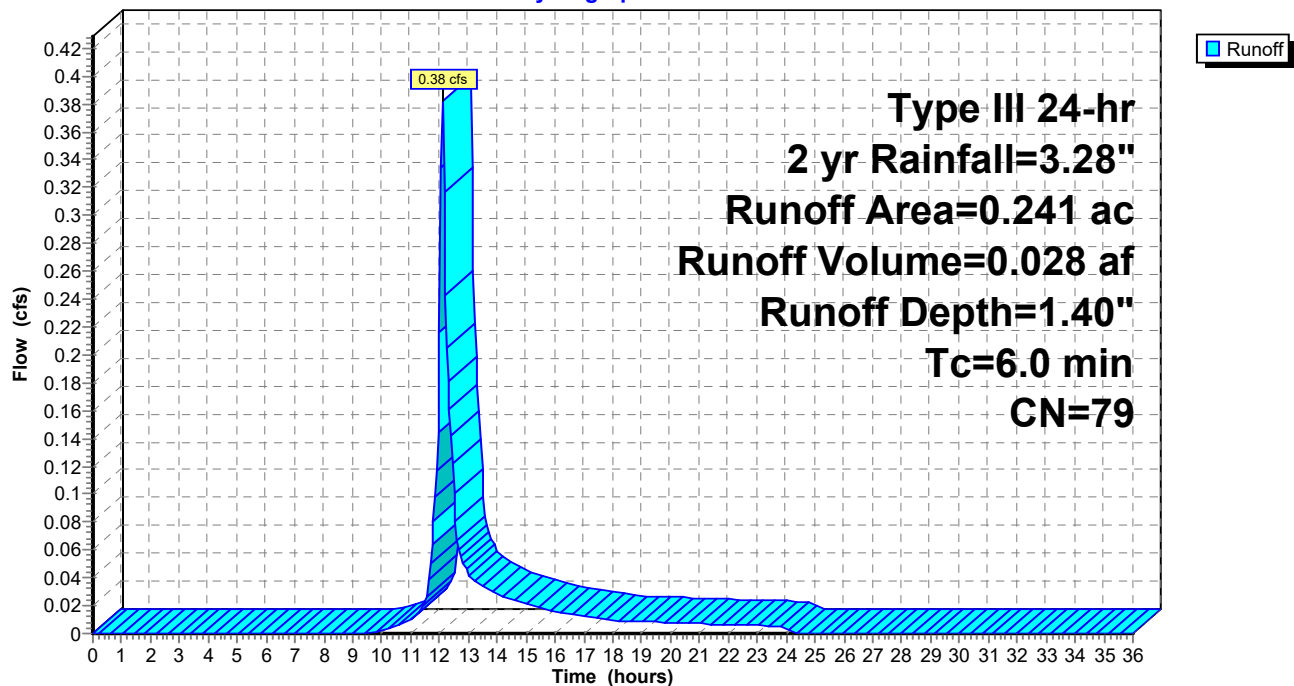

Summary for Subcatchment PR-3C: PR-3C

Runoff = 0.07 cfs @ 12.12 hrs, Volume= 0.007 af, Depth= 0.48"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 2 yr Rainfall=3.28"

Area (ac)	CN	Description
0.186	61	>75% Grass cover, Good, HSG B
0.186		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-3C: PR-3C

Hydrograph

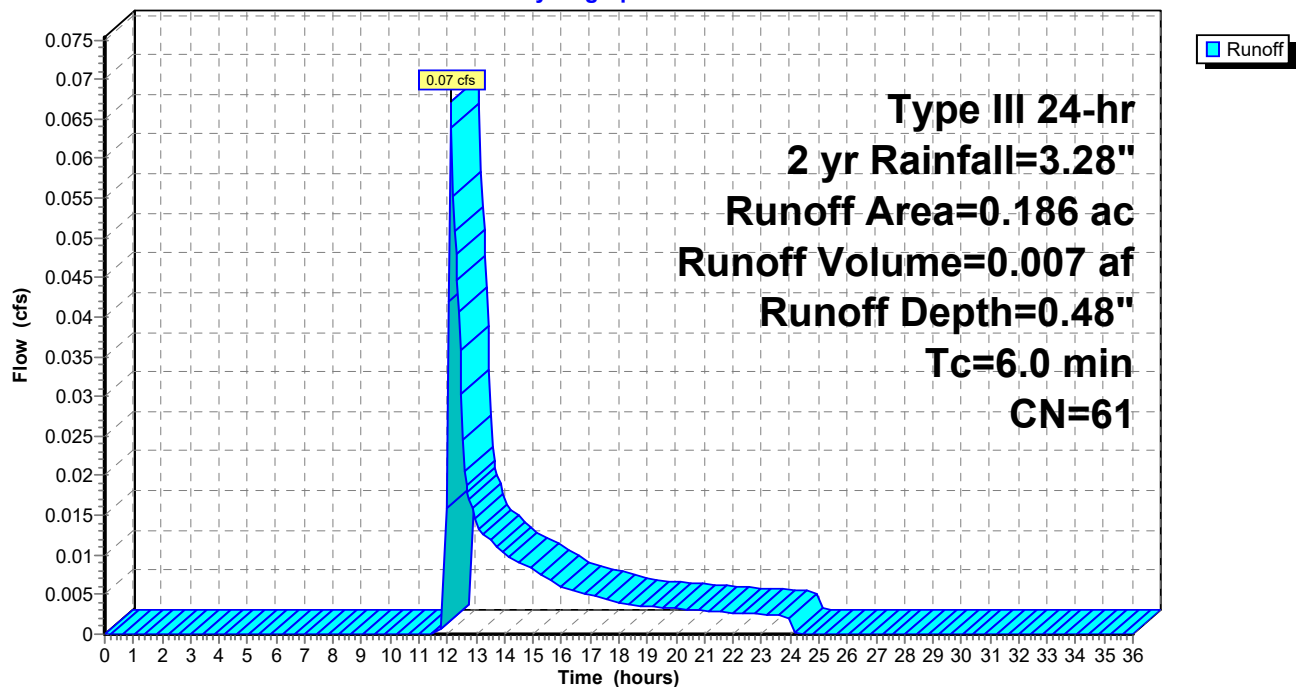

Summary for Subcatchment PR-4A: SB 01 A


Runoff = 0.95 cfs @ 12.60 hrs, Volume= 0.143 af, Depth= 1.83"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 2 yr Rainfall=3.28"

Area (sf)	CN	Description
* 41,000	85	SYNTHETIC TURF- PAD- LINER
41,000		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
39.6	110	0.0055	0.05		Sheet Flow, Through Turf Section Grass: Bermuda n= 0.410 P2= 3.20"
3.7	100	0.0001	0.45	0.16	Pipe Channel, TRENCH DRAIN LEVEL 8.0" Round Area= 0.3 sf Perim= 2.1' r= 0.17' n= 0.010
43.3	210	Total			

Subcatchment PR-4A: SB 01 A

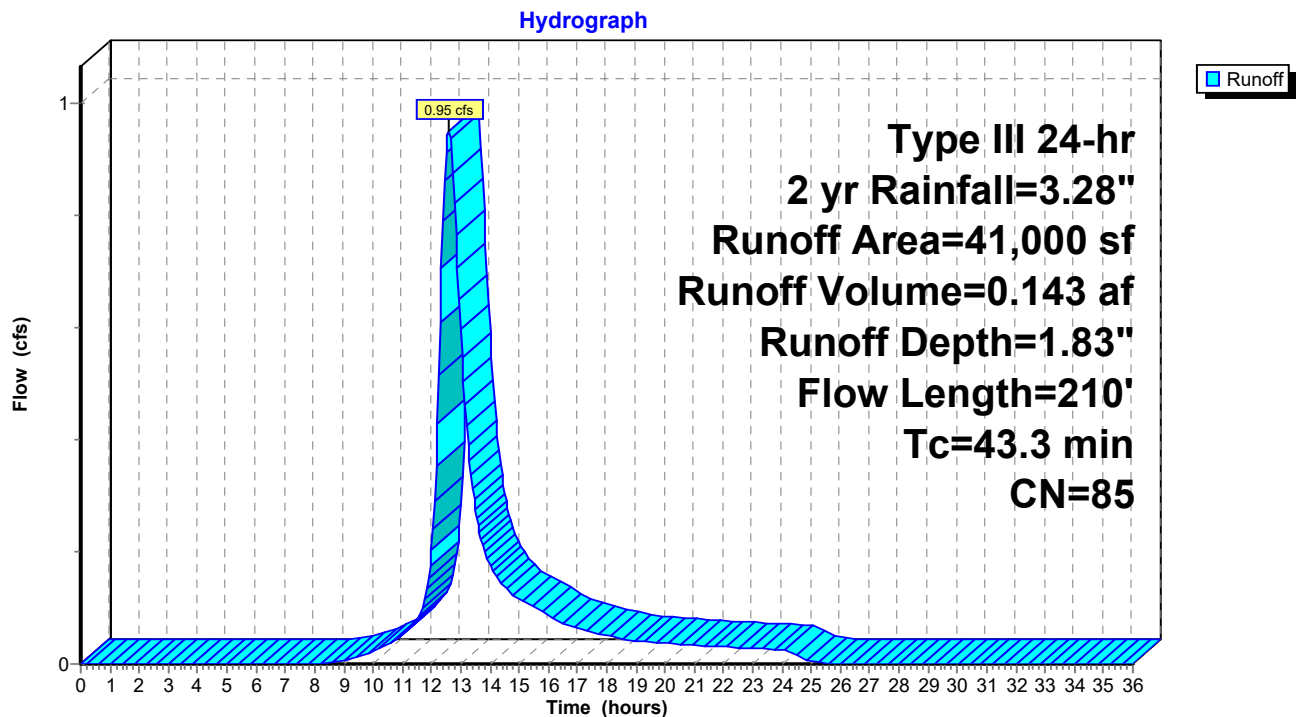

Summary for Subcatchment PR-4B: SB 11 A


Runoff = 0.95 cfs @ 12.52 hrs, Volume= 0.133 af, Depth= 1.83"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 2 yr Rainfall=3.28"

Area (sf)	CN	Description
* 38,000	85	SYNTHETIC TURF- PAD- LINER
38,000		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
33.7	90	0.0055	0.04		Sheet Flow, Through Turf Section Grass: Bermuda n= 0.410 P2= 3.20"
3.7	100	0.0001	0.45	0.16	Pipe Channel, TRENCH DRAIN LEVEL 8.0" Round Area= 0.3 sf Perim= 2.1' r= 0.17' n= 0.010
37.4	190	Total			

Subcatchment PR-4B: SB 11 A

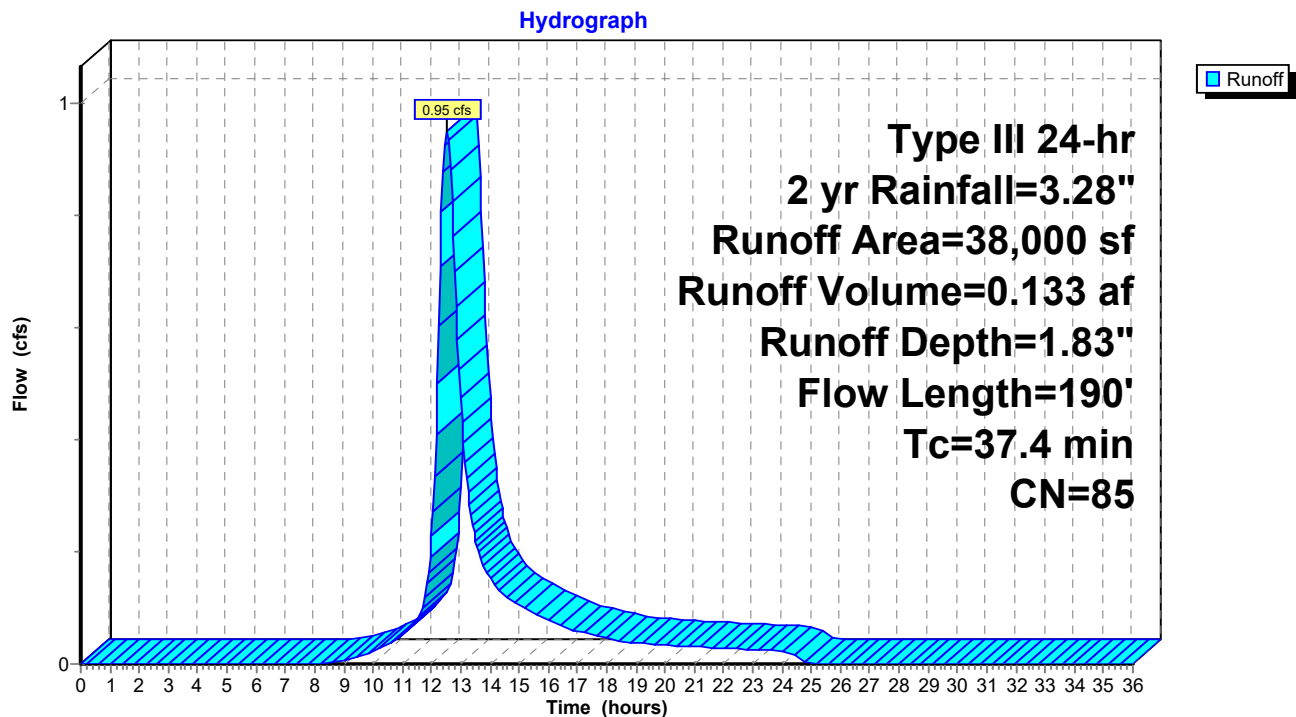

Summary for Subcatchment PR-4C: SB 00 DPW SLOPE


Runoff = 0.15 cfs @ 12.10 hrs, Volume= 0.011 af, Depth= 1.27"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
Type III 24-hr 2 yr Rainfall=3.28"

Area (sf)	CN	Adj	Description
1,100	98		Unconnected pavement, HSG A
3,600	74		>75% Grass cover, Good, HSG C
4,700	80	77	Weighted Average, UI Adjusted
3,600			76.60% Pervious Area
1,100			23.40% Impervious Area
1,100			100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.3	25	0.5000	0.32		Sheet Flow, SLOPING LAND
					Grass: Dense n= 0.240 P2= 3.20"
1.3	25	Total, Increased to minimum Tc = 6.0 min			

Subcatchment PR-4C: SB 00 DPW SLOPE

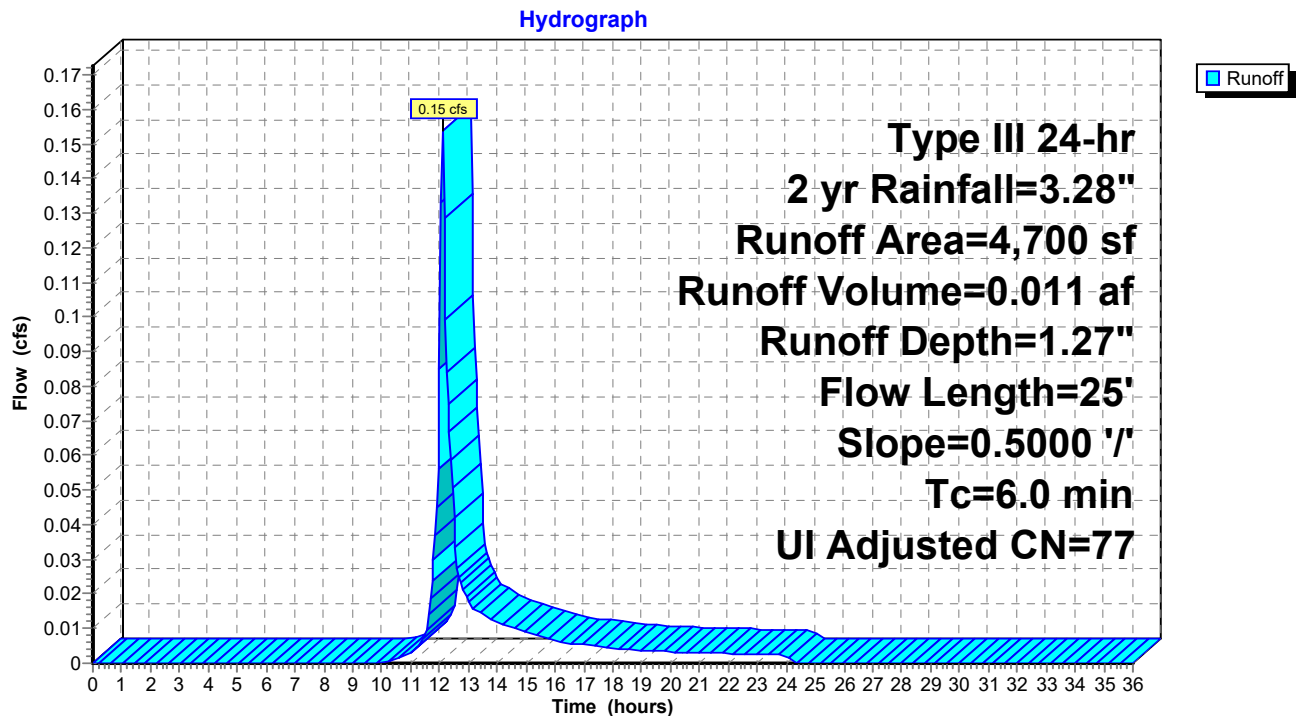

Summary for Subcatchment PR-5A: BB 01 A

Runoff = 0.81 cfs @ 12.28 hrs, Volume= 0.086 af, Depth= 1.83"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 2 yr Rainfall=3.28"

Area (sf)	CN	Description
* 24,500	85	SYNTHETIC TURF- PAD- LINER
24,500		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
18.2	46	0.0067	0.04		Sheet Flow, Through Turf Section Grass: Bermuda n= 0.410 P2= 3.20"
1.7	47	0.0001	0.45	0.16	Pipe Channel, TRENCH DRAIN LEVEL 8.0" Round Area= 0.3 sf Perim= 2.1' r= 0.17' n= 0.010
19.9	93	Total			

Subcatchment PR-5A: BB 01 A

Hydrograph

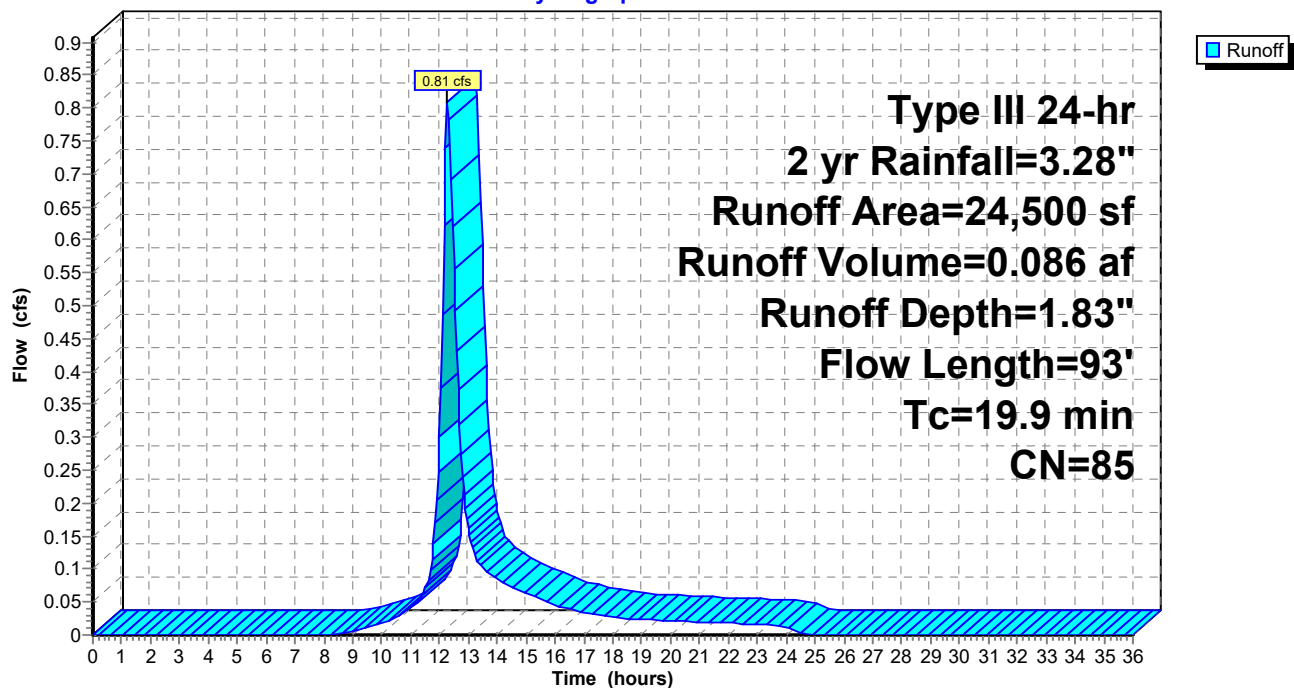

Summary for Subcatchment PR-5B: BB 11 A


Runoff = 1.32 cfs @ 12.90 hrs, Volume= 0.256 af, Depth= 1.83"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 2 yr Rainfall=3.28"

Area (sf)	CN	Description
* 73,200	85	SYNTHETIC TURF- PAD- LINER
73,200		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
22.1	53	0.0055	0.04		Sheet Flow, Through Turf Section Grass: Bermuda n= 0.410 P2= 3.20"
43.1	150	0.0083	0.06		Sheet Flow, SYNTHETIC TURF Grass: Bermuda n= 0.410 P2= 3.20"
1.7	47	0.0001	0.45	0.16	Pipe Channel, TRENCH DRAIN LEVEL 8.0" Round Area= 0.3 sf Perim= 2.1' r= 0.17' n= 0.010
66.9	250	Total			

Subcatchment PR-5B: BB 11 A

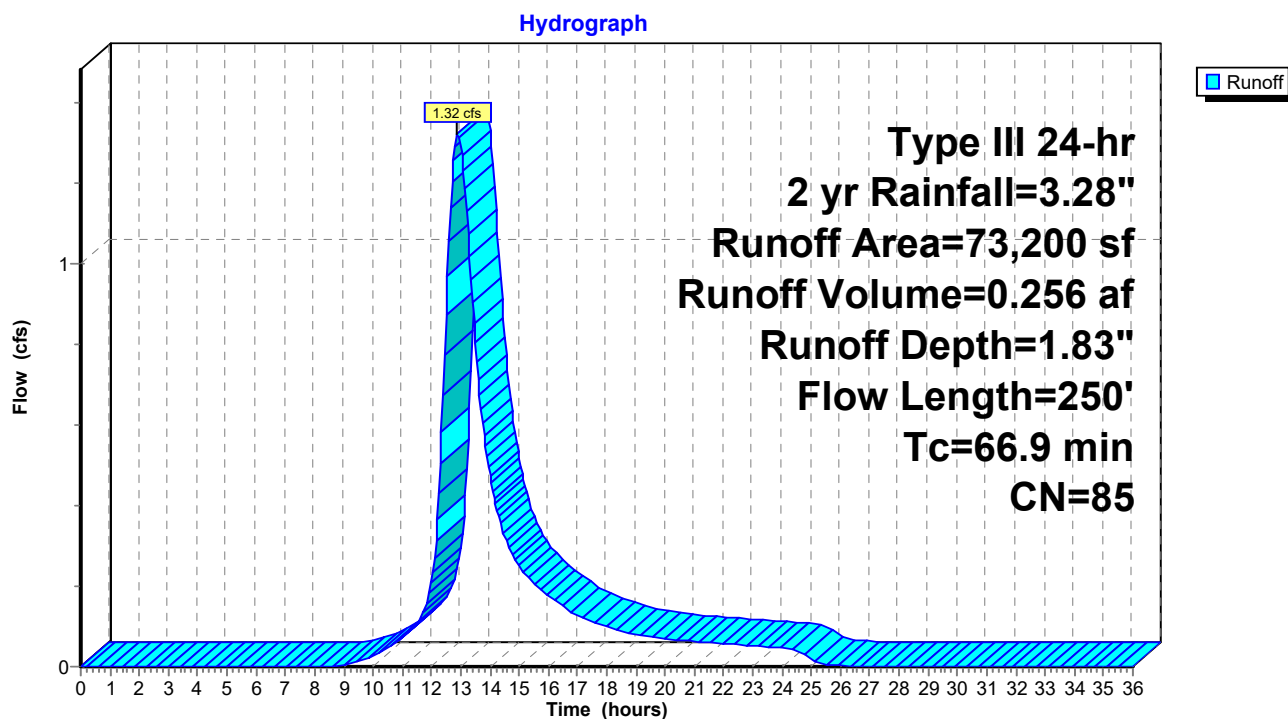


Summary for Subcatchment PR-5C: SLOPE

Runoff = 0.23 cfs @ 12.01 hrs, Volume= 0.015 af, Depth= 1.15"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 2 yr Rainfall=3.28"

Area (sf)	CN	Adj	Description
600	98		Unconnected roofs, HSG C
6,000	74		>75% Grass cover, Good, HSG C
6,600	76	75	Weighted Average, UI Adjusted
6,000			90.91% Pervious Area
600			9.09% Impervious Area
600			100.00% Unconnected

Subcatchment PR-5C: SLOPE

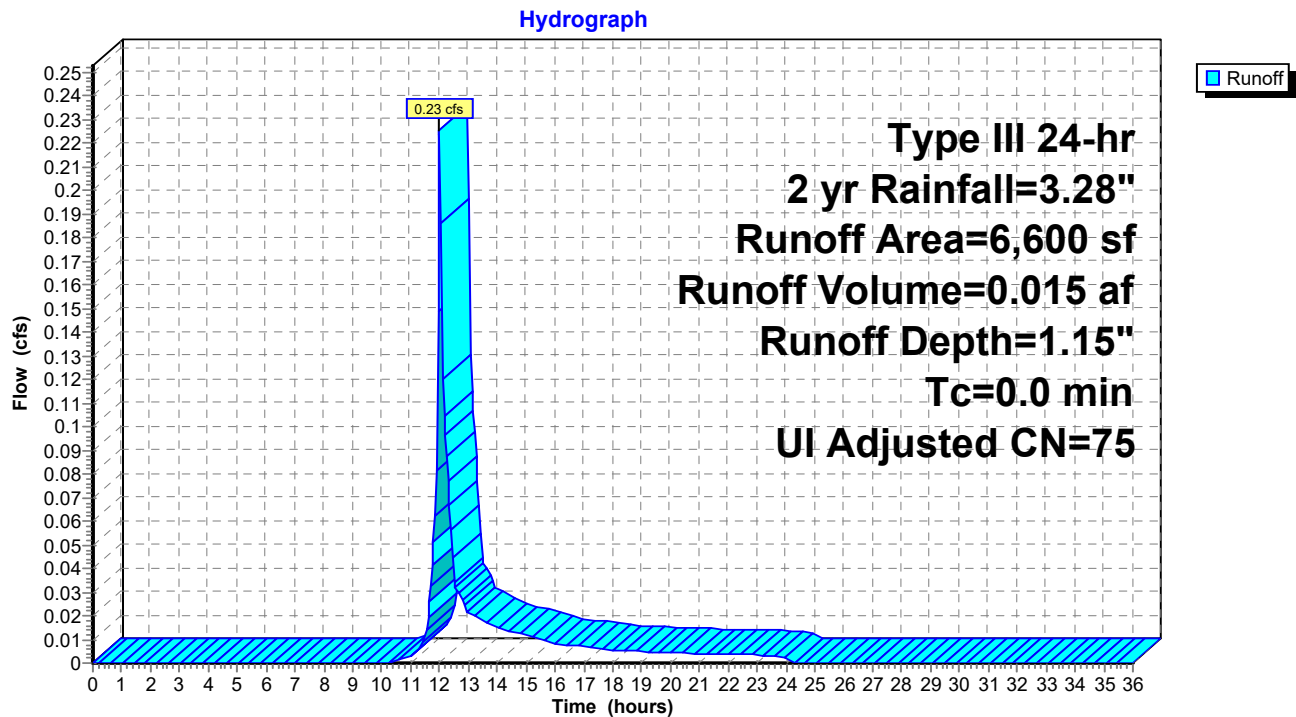

Summary for Pond 2P: rain garden#2 cascading

Inflow Area = 0.966 ac, 61.39% Impervious, Inflow Depth > 1.67" for 2 yr event
 Inflow = 1.90 cfs @ 12.10 hrs, Volume= 0.134 af
 Outflow = 1.61 cfs @ 12.17 hrs, Volume= 0.118 af, Atten= 15%, Lag= 4.5 min
 Primary = 0.03 cfs @ 12.15 hrs, Volume= 0.045 af
 Secondary = 1.59 cfs @ 12.17 hrs, Volume= 0.072 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Peak Elev= 54.58' @ 12.15 hrs Surf.Area= 1,062 sf Storage= 1,285 cf

Flood Elev= 55.00' Surf.Area= 1,326 sf Storage= 1,784 cf

Plug-Flow detention time= 218.3 min calculated for 0.118 af (88% of inflow)

Center-of-Mass det. time= 127.7 min (1,032.2 - 904.5)

Volume	Invert	Avail.Storage	Storage Description
#1	51.00'	1,557 cf	Rain Garden Envelope (Prismatic) Listed below (Recalc) 2,357 cf Overall - 800 cf Embedded = 1,557 cf
#2	51.00'	80 cf	crush stone (Prismatic) Listed below (Recalc) Inside #1 200 cf Overall x 40.0% Voids
#3	51.50'	133 cf	Bio Media (Prismatic) Listed below (Recalc) Inside #1 532 cf Overall x 25.0% Voids
#4	52.83'	14 cf	Mulch (Prismatic) Listed below (Recalc) Inside #1 68 cf Overall x 20.0% Voids
		1,784 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
51.00	400	0	0
53.00	400	800	800
54.00	694	547	1,347
55.00	1,326	1,010	2,357

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
51.00	400	0	0
51.50	400	200	200

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
51.50	400	0	0
52.83	400	532	532

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
52.83	400	0	0
53.00	400	68	68

17211.00 Arlington HS - Proposed Conditions - NOI ResuType III 24-hr 2 yr Rainfall=3.28"

Prepared by Samiotes Engineering

Printed 5/28/2020

HydroCAD® 10.00-24 s/n 03575 © 2018 HydroCAD Software Solutions LLC

Page 21

Device	Routing	Invert	Outlet Devices
#1	Device 3	51.00'	1.020 in/hr Exfiltration over Surface area
#2	Secondary	54.50'	25.0' long x 3.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 Coef. (English) 2.44 2.58 2.68 2.67 2.65 2.64 2.64 2.68 2.68 2.72 2.81 2.92 2.97 3.07 3.32
#3	Primary	51.00'	12.0" Round Culvert L= 25.0' Ke= 0.500 Inlet / Outlet Invert= 51.00' / 50.88' S= 0.0048 ' / Cc= 0.900 n= 0.012, Flow Area= 0.79 sf

Primary OutFlow Max=0.03 cfs @ 12.15 hrs HW=54.58' TW=46.87' (Dynamic Tailwater)


↑ **3=Culvert** (Passes 0.03 cfs of 6.64 cfs potential flow)

↑ **1=Exfiltration** (Exfiltration Controls 0.03 cfs)

Secondary OutFlow Max=1.40 cfs @ 12.17 hrs HW=54.58' TW=47.44' (Dynamic Tailwater)

↑ **2=Broad-Crested Rectangular Weir** (Weir Controls 1.40 cfs @ 0.69 fps)

Pond 2P: rain garden#2 cascading

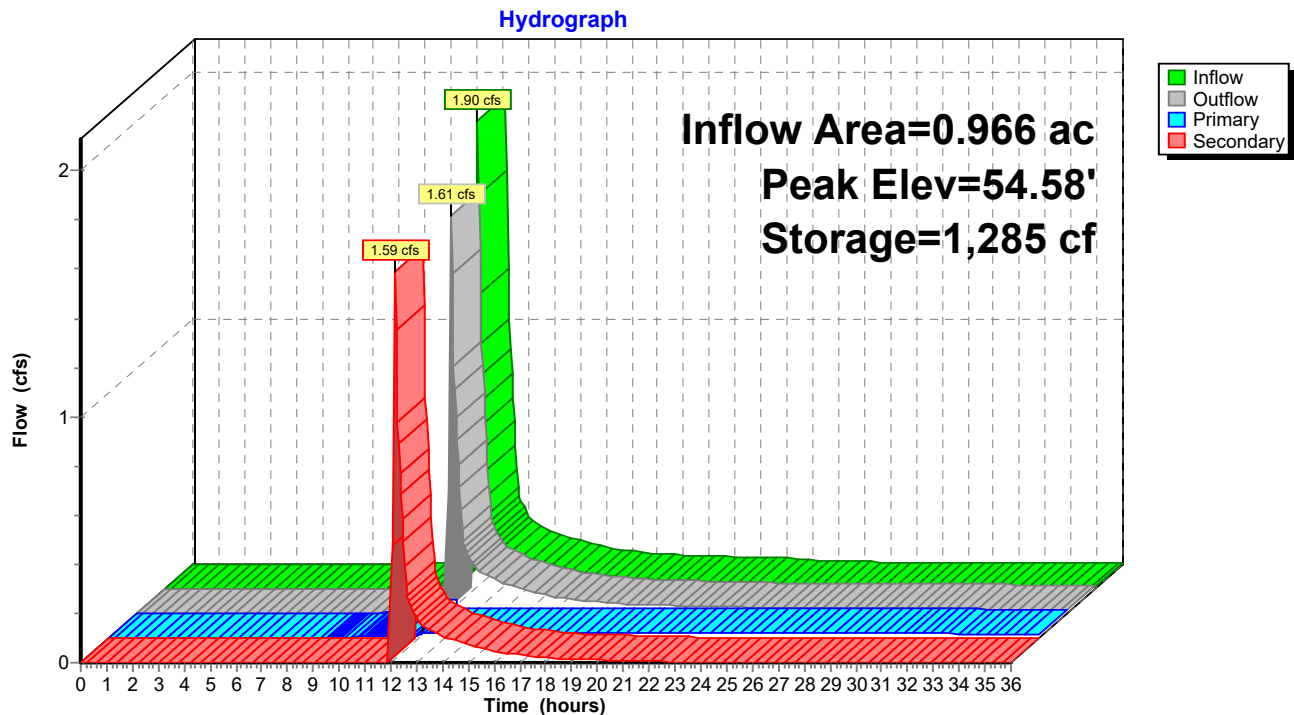

17211.00 Arlington HS - Proposed Conditions - NOI ResuType III 24-hr 2 yr Rainfall=3.28"

Prepared by Samiotes Engineering

Printed 5/28/2020

HydroCAD® 10.00-24 s/n 03575 © 2018 HydroCAD Software Solutions LLC

Page 22

Summary for Pond 3P: rain garden#3 cascading

Inflow Area = 1.152 ac, 51.48% Impervious, Inflow Depth > 1.30" for 2 yr event
 Inflow = 1.68 cfs @ 12.17 hrs, Volume= 0.125 af
 Outflow = 0.14 cfs @ 14.02 hrs, Volume= 0.084 af, Atten= 92%, Lag= 111.0 min
 Primary = 0.14 cfs @ 14.02 hrs, Volume= 0.084 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Peak Elev= 50.02' @ 14.02 hrs Surf.Area= 1,386 sf Storage= 2,310 cf

Flood Elev= 50.00' Surf.Area= 1,373 sf Storage= 2,283 cf

Plug-Flow detention time= 497.6 min calculated for 0.084 af (67% of inflow)

Center-of-Mass det. time= 276.1 min (1,301.1 - 1,025.0)

Volume	Invert	Avail.Storage	Storage Description
#1	46.00'	2,710 cf	Rain Garden Envelope (Prismatic) Listed below (Recalc) 3,911 cf Overall - 1,200 cf Embedded = 2,710 cf
#2	46.00'	120 cf	crush stone (Prismatic) Listed below (Recalc) Inside #1 300 cf Overall x 40.0% Voids
#3	46.50'	199 cf	Bio Media (Prismatic) Listed below (Recalc) Inside #1 798 cf Overall x 25.0% Voids
#4	47.83'	20 cf	Mulch (Prismatic) Listed below (Recalc) Inside #1 102 cf Overall x 20.0% Voids
		3,050 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
46.00	600	0	0
48.00	600	1,200	1,200
49.00	957	779	1,979
50.00	1,373	1,165	3,144
50.50	1,695	767	3,911

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
46.00	600	0	0
46.50	600	300	300

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
46.50	600	0	0
47.83	600	798	798

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
47.83	600	0	0
48.00	600	102	102

17211.00 Arlington HS - Proposed Conditions - NOI ResuType III 24-hr 2 yr Rainfall=3.28"

Prepared by Samiotes Engineering

Printed 5/28/2020

HydroCAD® 10.00-24 s/n 03575 © 2018 HydroCAD Software Solutions LLC


Page 23

Device	Routing	Invert	Outlet Devices
#1	Device 3	46.00'	1.020 in/hr Exfiltration over Surface area
#2	Device 3	50.00'	24.0" x 48.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#3	Primary	46.00'	15.0" Round Culvert L= 26.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 46.00' / 45.87' S= 0.0050 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

Primary OutFlow Max=0.14 cfs @ 14.02 hrs HW=50.02' TW=0.00' (Dynamic Tailwater)

- 3=Culvert (Passes 0.14 cfs of 8.59 cfs potential flow)
- 1=Exfiltration (Exfiltration Controls 0.03 cfs)
- 2=Orifice/Grate (Weir Controls 0.11 cfs @ 0.46 fps)

Pond 3P: rain garden#3 cascading

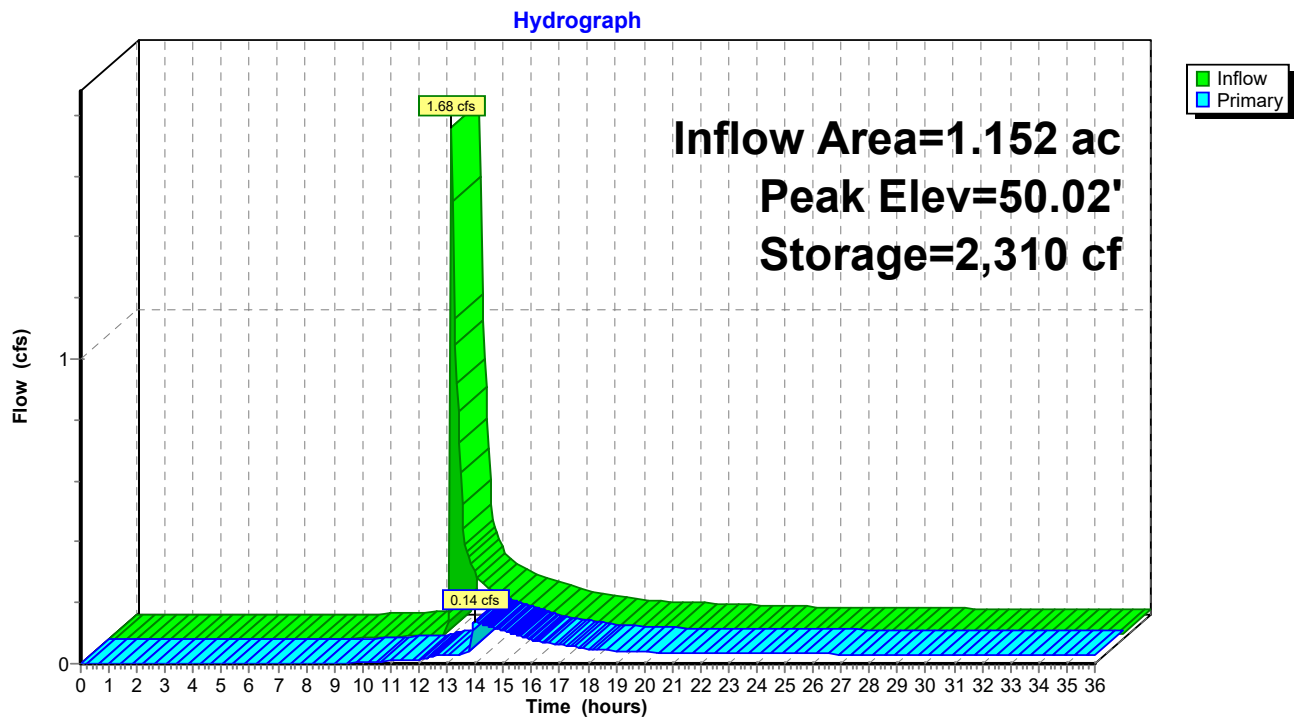

Summary for Pond 4P: UGS-1

Inflow Area = 1.705 ac, 60.59% Impervious, Inflow Depth = 1.77" for 2 yr event
 Inflow = 3.35 cfs @ 12.09 hrs, Volume= 0.251 af
 Outflow = 1.36 cfs @ 12.35 hrs, Volume= 0.215 af, Atten= 59%, Lag= 15.4 min
 Discarded = 0.04 cfs @ 10.25 hrs, Volume= 0.094 af
 Primary = 1.32 cfs @ 12.35 hrs, Volume= 0.120 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 43.11' @ 12.35 hrs Surf.Area= 1,672 sf Storage= 4,001 cf

Plug-Flow detention time= (not calculated: outflow precedes inflow)
 Center-of-Mass det. time= 227.2 min (1,043.4 - 816.2)

Volume	Invert	Avail.Storage	Storage Description
#1A	39.50'	2,099 cf	29.92'W x 55.89'L x 5.50'H Field A 9,196 cf Overall - 3,198 cf Embedded = 5,998 cf x 35.0% Voids
#2A	40.25'	3,198 cf	ADS_StormTech MC-3500 d +Capx 28 Inside #1 Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap 28 Chambers in 4 Rows Cap Storage= +14.9 cf x 2 x 4 rows = 119.2 cf
		5,297 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	39.25'	24.0" Round Culvert L= 50.0' Ke= 0.500 Inlet / Outlet Invert= 39.25' / 38.75' S= 0.0100 '/' Cc= 0.900 n= 0.012, Flow Area= 3.14 sf
#2	Device 1	43.67'	5.0' long x 4.00' rise Sharp-Crested Rectangular Weir 2 End Contraction(s)
#3	Discarded	39.50'	1.020 in/hr Exfiltration over Surface area
#4	Device 1	42.42'	9.0" Vert. Orifice/Grate X 3 rows with 6.0" cc spacing C= 0.600

Discarded OutFlow Max=0.04 cfs @ 10.25 hrs HW=39.59' (Free Discharge)
 ↑ **3=Exfiltration** (Exfiltration Controls 0.04 cfs)

Primary OutFlow Max=1.32 cfs @ 12.35 hrs HW=43.11' TW=0.00' (Dynamic Tailwater)
 ↑ **1=Culvert** (Passes 1.32 cfs of 25.56 cfs potential flow)
 ↑ **2=Sharp-Crested Rectangular Weir** (Controls 0.00 cfs)
 ↑ **4=Orifice/Grate** (Orifice Controls 1.32 cfs @ 2.59 fps)

Pond 4P: UGS-1 - Chamber Wizard Field A

Chamber Model = ADS_StormTechMC-3500 d +Cap (ADS StormTech®MC-3500 d rev 03/14 with Cap volume)

Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf

Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap

Cap Storage= +14.9 cf x 2 x 4 rows = 119.2 cf

77.0" Wide + 9.0" Spacing = 86.0" C-C Row Spacing

7 Chambers/Row x 7.17' Long +1.85' Cap Length x 2 = 53.89' Row Length +12.0" End Stone x 2 = 55.89' Base Length

4 Rows x 77.0" Wide + 9.0" Spacing x 3 + 12.0" Side Stone x 2 = 29.92' Base Width

9.0" Base + 45.0" Chamber Height + 12.0" Cover = 5.50' Field Height

28 Chambers x 110.0 cf + 14.9 cf Cap Volume x 2 x 4 Rows = 3,197.9 cf Chamber Storage

9,196.2 cf Field - 3,197.9 cf Chambers = 5,998.4 cf Stone x 35.0% Voids = 2,099.4 cf Stone Storage

Chamber Storage + Stone Storage = 5,297.3 cf = 0.122 af



Overall Storage Efficiency = 57.6%

Overall System Size = 55.89' x 29.92' x 5.50'


28 Chambers

340.6 cy Field

222.2 cy Stone

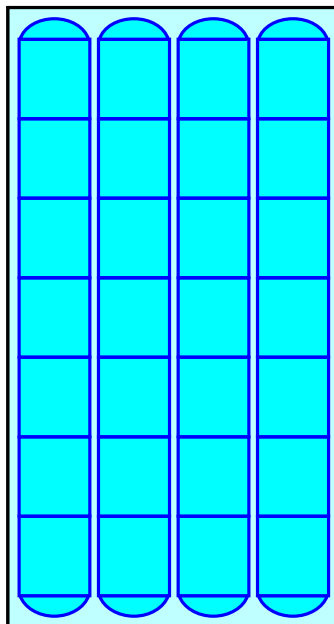

Pond 4P: UGS-1

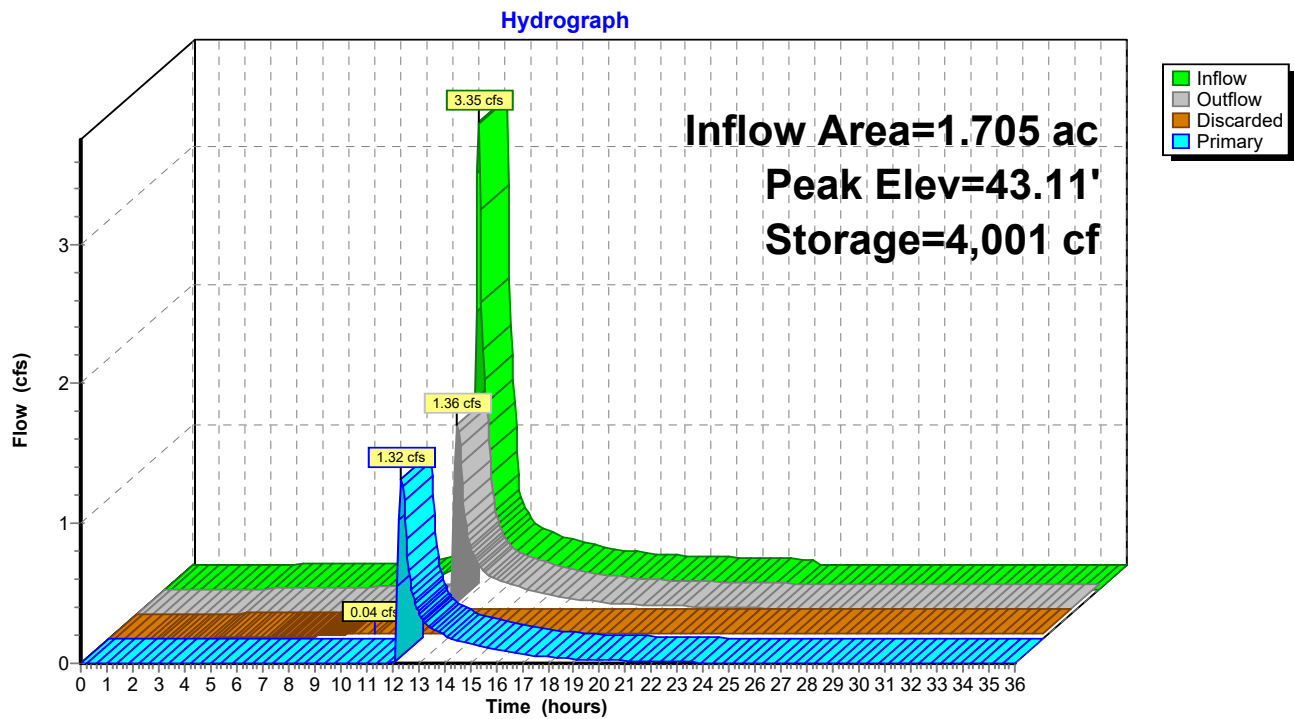

Summary for Pond 5P: rain garden#1 cascading

Inflow Area = 0.725 ac, 65.66% Impervious, Inflow Depth = 1.83" for 2 yr event
 Inflow = 1.52 cfs @ 12.09 hrs, Volume= 0.110 af
 Outflow = 1.52 cfs @ 12.10 hrs, Volume= 0.106 af, Atten= 0%, Lag= 0.3 min
 Primary = 0.01 cfs @ 12.10 hrs, Volume= 0.022 af
 Secondary = 1.51 cfs @ 12.10 hrs, Volume= 0.084 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 62.08' @ 12.10 hrs Surf.Area= 516 sf Storage= 594 cf
 Flood Elev= 63.00' Surf.Area= 660 sf Storage= 1,132 cf

Plug-Flow detention time= 115.3 min calculated for 0.106 af (96% of inflow)
 Center-of-Mass det. time= 95.3 min (920.3 - 825.0)

Volume	Invert	Avail.Storage	Storage Description
#1	58.50'	1,048 cf	Rain Garden Envelope (Prismatic) Listed below (Recalc) 1,348 cf Overall - 300 cf Embedded = 1,048 cf
#2	58.50'	30 cf	crush stone (Prismatic) Listed below (Recalc) Inside #1 75 cf Overall x 40.0% Voids
#3	59.00'	50 cf	Bio Media (Prismatic) Listed below (Recalc) Inside #1 199 cf Overall x 25.0% Voids
#4	60.33'	5 cf	Mulch (Prismatic) Listed below (Recalc) Inside #1 26 cf Overall x 20.0% Voids
1,132 cf			Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
58.50	150	0	0
60.50	150	300	300
61.00	236	97	397
62.00	503	370	766
63.00	660	582	1,348

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
58.50	150	0	0
59.00	150	75	75

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
59.00	150	0	0
60.33	150	199	199

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
60.33	150	0	0
60.50	150	26	26

17211.00 Arlington HS - Proposed Conditions - NOI ResuType III 24-hr 2 yr Rainfall=3.28"

Prepared by Samiotes Engineering

Printed 5/28/2020

HydroCAD® 10.00-24 s/n 03575 © 2018 HydroCAD Software Solutions LLC

Page 28

Device	Routing	Invert	Outlet Devices
#1	Device 3	58.50'	1.020 in/hr Exfiltration over Surface area
#2	Secondary	62.00'	25.0' long x 3.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 Coef. (English) 2.44 2.58 2.68 2.67 2.65 2.64 2.64 2.68 2.68 2.72 2.81 2.92 2.97 3.07 3.32
#3	Primary	58.50'	8.0" Round Culvert L= 20.0' Ke= 0.500 Inlet / Outlet Invert= 58.50' / 58.40' S= 0.0050 ' / S= 0.0050 ' Cc= 0.900 n= 0.012, Flow Area= 0.35 sf

Primary OutFlow Max=0.01 cfs @ 12.10 hrs HW=62.08' TW=54.39' (Dynamic Tailwater)


↑ **3=Culvert** (Passes 0.01 cfs of 3.03 cfs potential flow)

↑ **1=Exfiltration** (Exfiltration Controls 0.01 cfs)

Secondary OutFlow Max=1.50 cfs @ 12.10 hrs HW=62.08' TW=54.39' (Dynamic Tailwater)

↑ **2=Broad-Crested Rectangular Weir** (Weir Controls 1.50 cfs @ 0.71 fps)

Pond 5P: rain garden#1 cascading

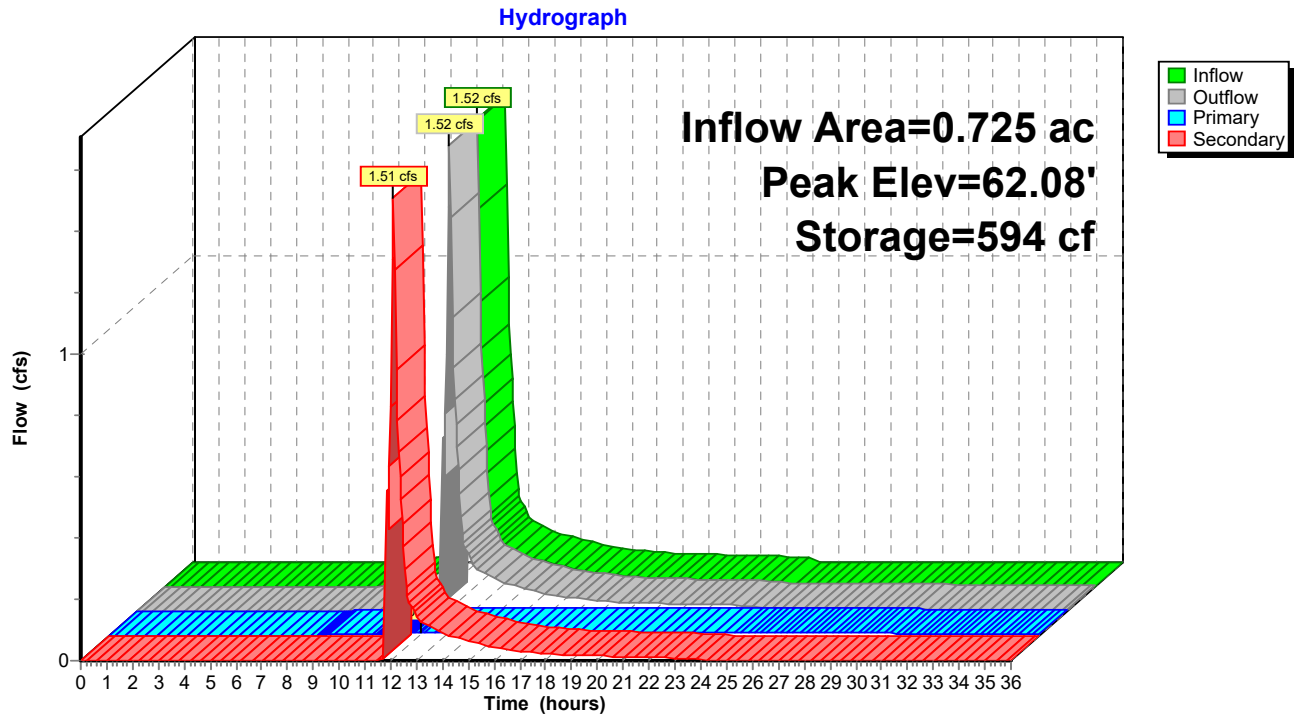

Summary for Pond BB 01 B: BB 01 B


Inflow Area = 0.714 ac, 1.93% Impervious, Inflow Depth = 1.68" for 2 yr event
 Inflow = 0.90 cfs @ 12.27 hrs, Volume= 0.100 af
 Outflow = 0.90 cfs @ 12.27 hrs, Volume= 0.100 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.90 cfs @ 12.27 hrs, Volume= 0.100 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 48.20' @ 12.27 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	47.63'	12.0" Round Culvert L= 5.0' CMP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 47.63' / 47.58' S= 0.0100 '/ Cc= 0.900 n= 0.010, Flow Area= 0.79 sf

Primary OutFlow Max=0.89 cfs @ 12.27 hrs HW=48.20' TW=46.58' (Dynamic Tailwater)
 ↑1=Culvert (Barrel Controls 0.89 cfs @ 2.78 fps)

Pond BB 01 B: BB 01 B

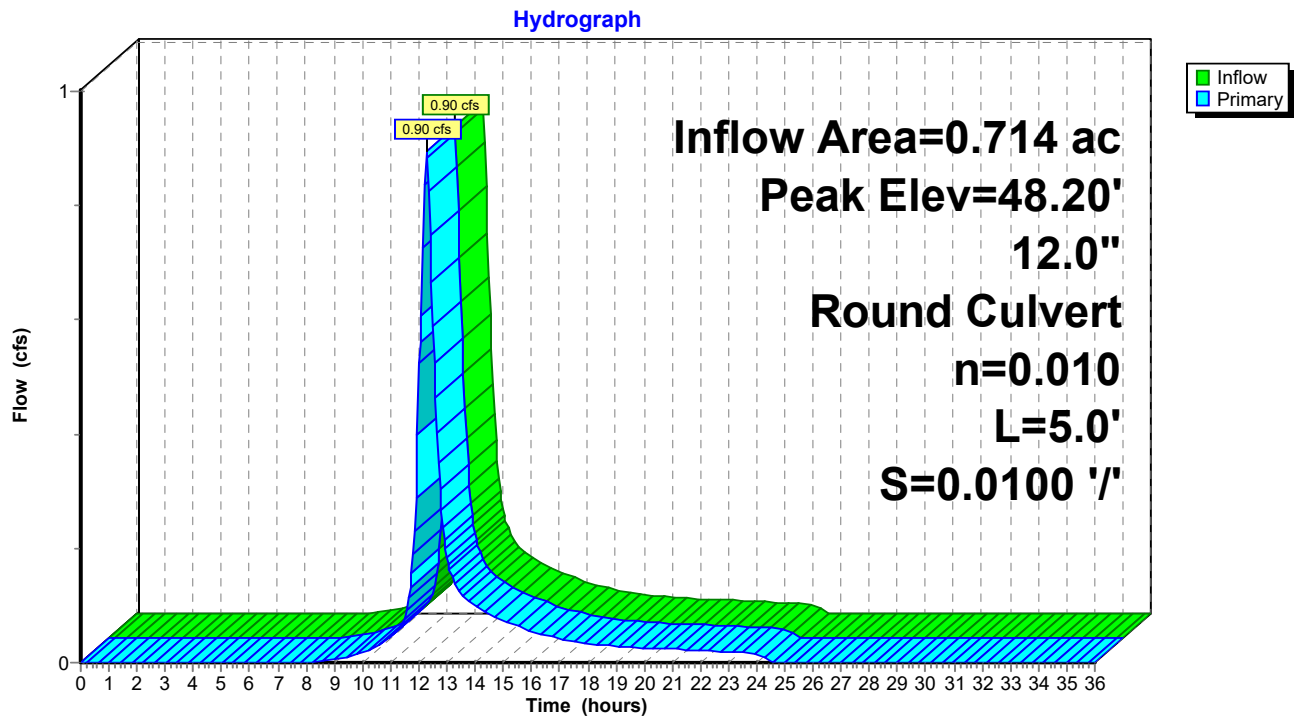

Summary for Pond BB 01 S: BB 01 S

Inflow Area = 0.714 ac, 1.93% Impervious, Inflow Depth = 1.68" for 2 yr event
 Inflow = 0.90 cfs @ 12.27 hrs, Volume= 0.100 af
 Outflow = 0.16 cfs @ 13.11 hrs, Volume= 0.100 af, Atten= 82%, Lag= 50.7 min
 Primary = 0.16 cfs @ 13.11 hrs, Volume= 0.100 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 46.70' @ 13.11 hrs Surf.Area= 0 sf Storage= 1,517 cf

Plug-Flow detention time= 79.1 min calculated for 0.100 af (100% of inflow)
 Center-of-Mass det. time= 78.6 min (918.5 - 839.9)


Volume	Invert	Avail.Storage	Storage Description
#1	45.65'	8,017 cf	Custom Stage Data Listed below

Elevation (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
45.65	0	0
46.48	16	16
46.98	3,378	3,394
47.48	3,405	6,799
47.98	1,218	8,017

Device	Routing	Invert	Outlet Devices
#1	Primary	45.65'	2.5" Vert. Orifice/Grate C= 0.600
#2	Primary	46.98'	4.0" Vert. Orifice/Grate C= 0.600
#3	Primary	46.98'	5.0" Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=0.16 cfs @ 13.11 hrs HW=46.70' TW=45.46' (Dynamic Tailwater)
 1=Orifice/Grate (Orifice Controls 0.16 cfs @ 4.69 fps)
 2=Orifice/Grate (Controls 0.00 cfs)
 3=Orifice/Grate (Controls 0.00 cfs)

Pond BB 01 S: BB 01 S

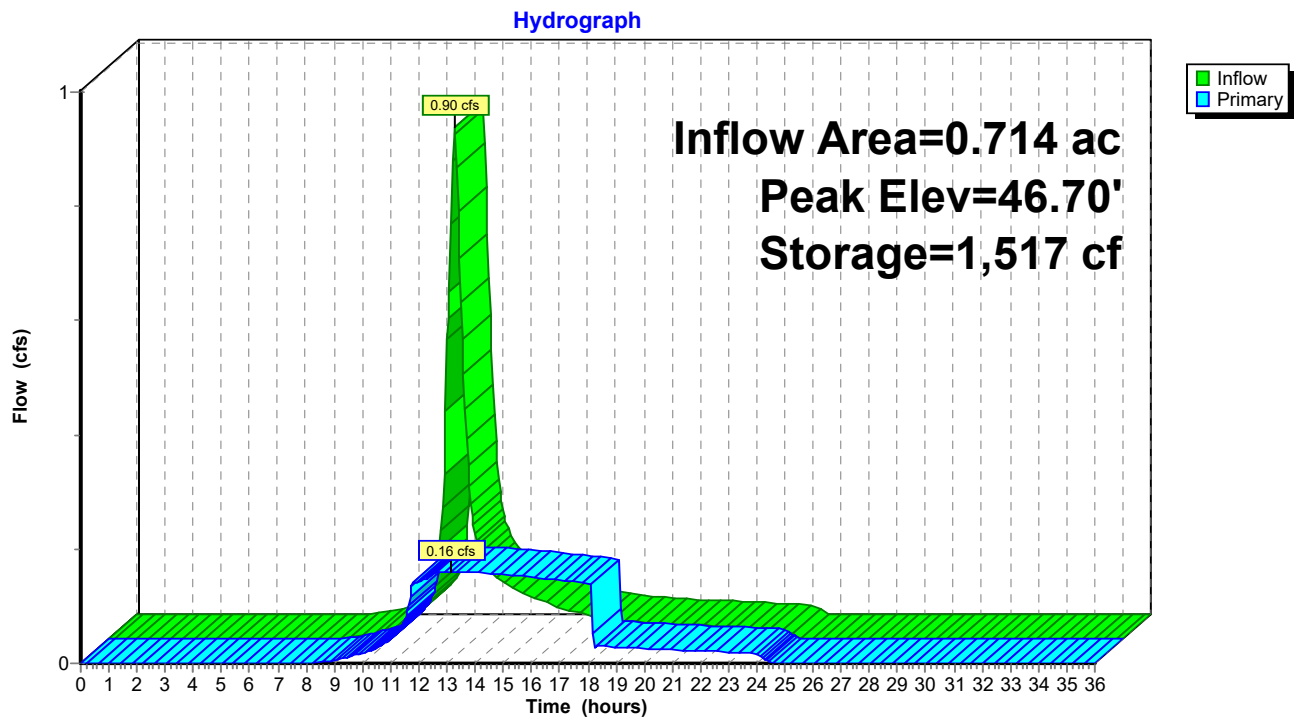

Summary for Pond BB 06 B: BB 06 B


Inflow Area = 0.714 ac, 1.93% Impervious, Inflow Depth = 1.68" for 2 yr event
 Inflow = 0.16 cfs @ 13.11 hrs, Volume= 0.100 af
 Outflow = 0.16 cfs @ 13.11 hrs, Volume= 0.100 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.16 cfs @ 13.11 hrs, Volume= 0.100 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 45.46' @ 13.11 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	45.25'	12.0" Round Culvert L= 112.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 45.25' / 44.69' S= 0.0050 '/ Cc= 0.900 n= 0.010, Flow Area= 0.79 sf

Primary OutFlow Max=0.16 cfs @ 13.11 hrs HW=45.46' TW=44.71' (Dynamic Tailwater)
 1=Culvert (Barrel Controls 0.16 cfs @ 2.09 fps)

Pond BB 06 B: BB 06 B

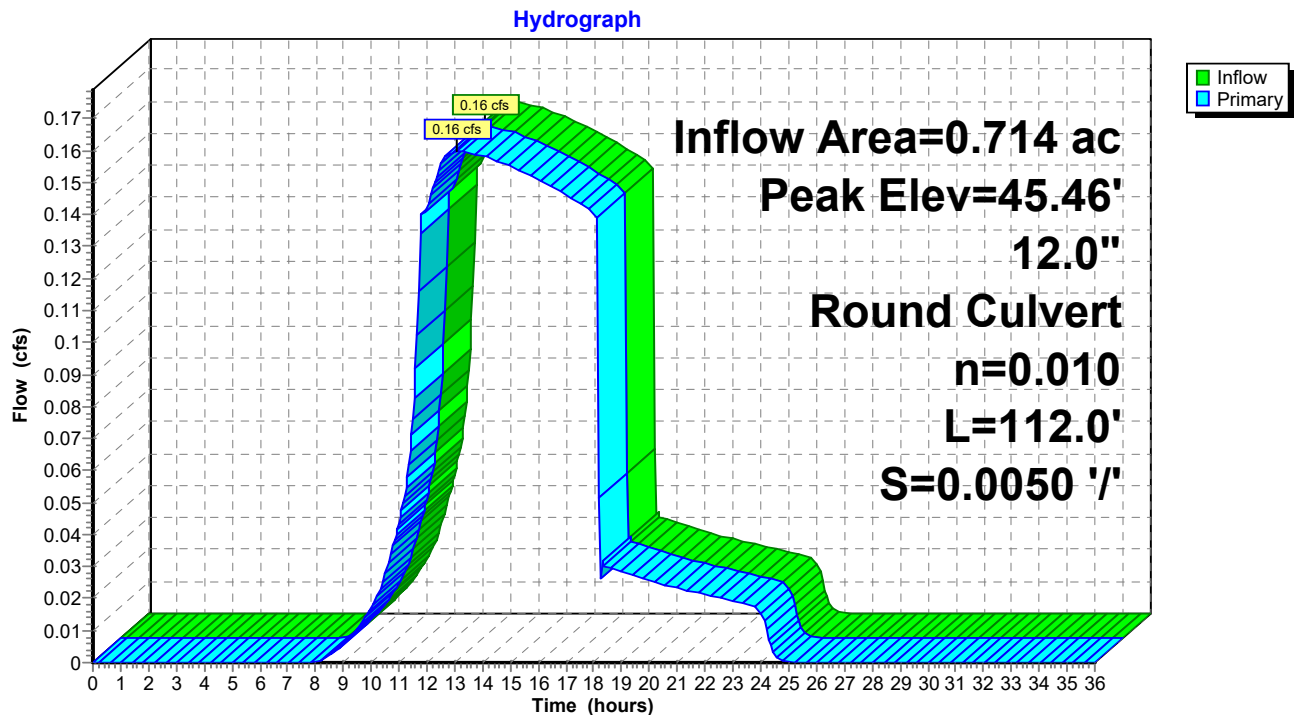

Summary for Pond BB 07 B: BB 07 B


Inflow Area = 0.714 ac, 1.93% Impervious, Inflow Depth = 1.68" for 2 yr event
 Inflow = 0.16 cfs @ 13.11 hrs, Volume= 0.100 af
 Outflow = 0.16 cfs @ 13.11 hrs, Volume= 0.100 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.16 cfs @ 13.11 hrs, Volume= 0.100 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 44.71' @ 13.11 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	44.50'	12.0" Round Culvert L= 88.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 44.50' / 44.06' S= 0.0050 '/ Cc= 0.900 n= 0.010, Flow Area= 0.79 sf

Primary OutFlow Max=0.16 cfs @ 13.11 hrs HW=44.71' TW=44.09' (Dynamic Tailwater)
 1=Culvert (Barrel Controls 0.16 cfs @ 2.07 fps)

Pond BB 07 B: BB 07 B

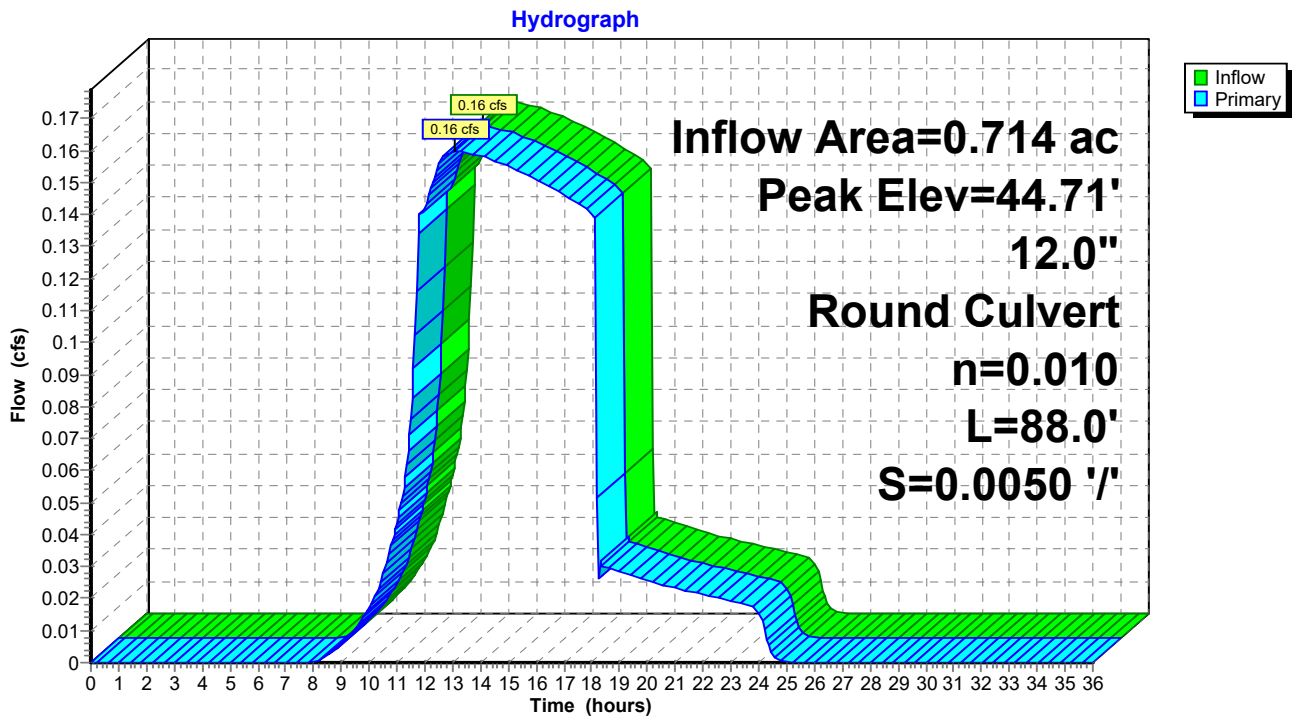

Summary for Pond BB 11 B: BB 11 B


Inflow Area = 1.680 ac, 0.00% Impervious, Inflow Depth = 1.83" for 2 yr event
 Inflow = 1.32 cfs @ 12.90 hrs, Volume= 0.256 af
 Outflow = 1.32 cfs @ 12.90 hrs, Volume= 0.256 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.32 cfs @ 12.90 hrs, Volume= 0.256 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 45.96' @ 12.90 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	45.25'	12.0" Round Culvert L= 8.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 45.25' / 45.12' S= 0.0163 '/ Cc= 0.900 n= 0.020, Flow Area= 0.79 sf

Primary OutFlow Max=1.32 cfs @ 12.90 hrs HW=45.96' TW=45.04' (Dynamic Tailwater)
 1=Culvert (Barrel Controls 1.32 cfs @ 3.10 fps)

Pond BB 11 B: BB 11 B

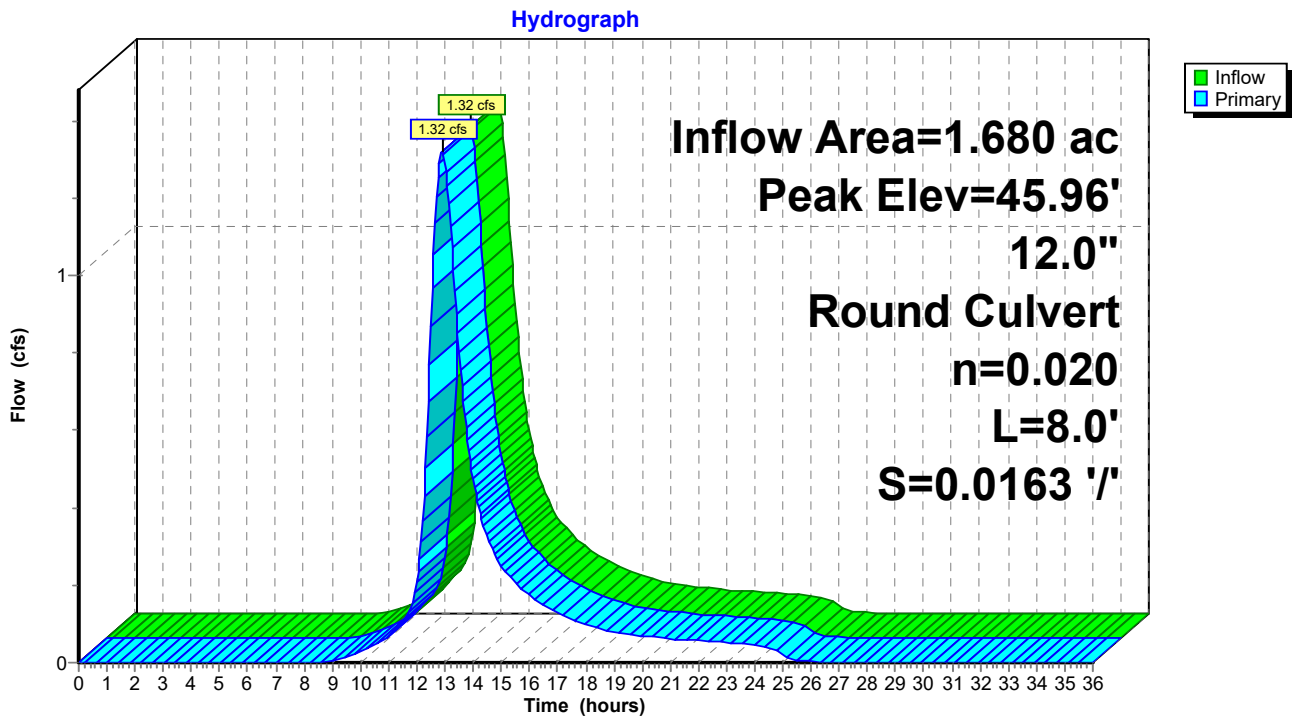

Summary for Pond BB 11 S: BB 11 S

Inflow Area = 1.680 ac, 0.00% Impervious, Inflow Depth = 1.83" for 2 yr event
 Inflow = 1.32 cfs @ 12.90 hrs, Volume= 0.256 af
 Outflow = 1.04 cfs @ 13.27 hrs, Volume= 0.256 af, Atten= 21%, Lag= 22.7 min
 Primary = 1.04 cfs @ 13.27 hrs, Volume= 0.256 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 45.08' @ 13.27 hrs Surf.Area= 0 sf Storage= 715 cf

Plug-Flow detention time= 3.9 min calculated for 0.255 af (100% of inflow)
 Center-of-Mass det. time= 4.0 min (885.4 - 881.4)


Volume	Invert	Avail.Storage	Storage Description
#1	44.14'	7,432 cf	Custom Stage Data Listed below

Elevation (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
44.14	0	0
44.97	16	16
45.47	3,131	3,147
45.97	3,156	6,303
46.47	1,129	7,432

Device	Routing	Invert	Outlet Devices
#1	Primary	44.14'	2.5" Vert. Orifice/Grate C= 0.600
#2	Primary	44.47'	8.0" Vert. Orifice/Grate C= 0.600
#3	Primary	45.47'	6.0" Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=1.04 cfs @ 13.27 hrs HW=45.08' TW=44.09' (Dynamic Tailwater)
 1=Orifice/Grate (Orifice Controls 0.15 cfs @ 4.41 fps)
 2=Orifice/Grate (Orifice Controls 0.89 cfs @ 2.66 fps)
 3=Orifice/Grate (Controls 0.00 cfs)

Pond BB 11 S: BB 11 S

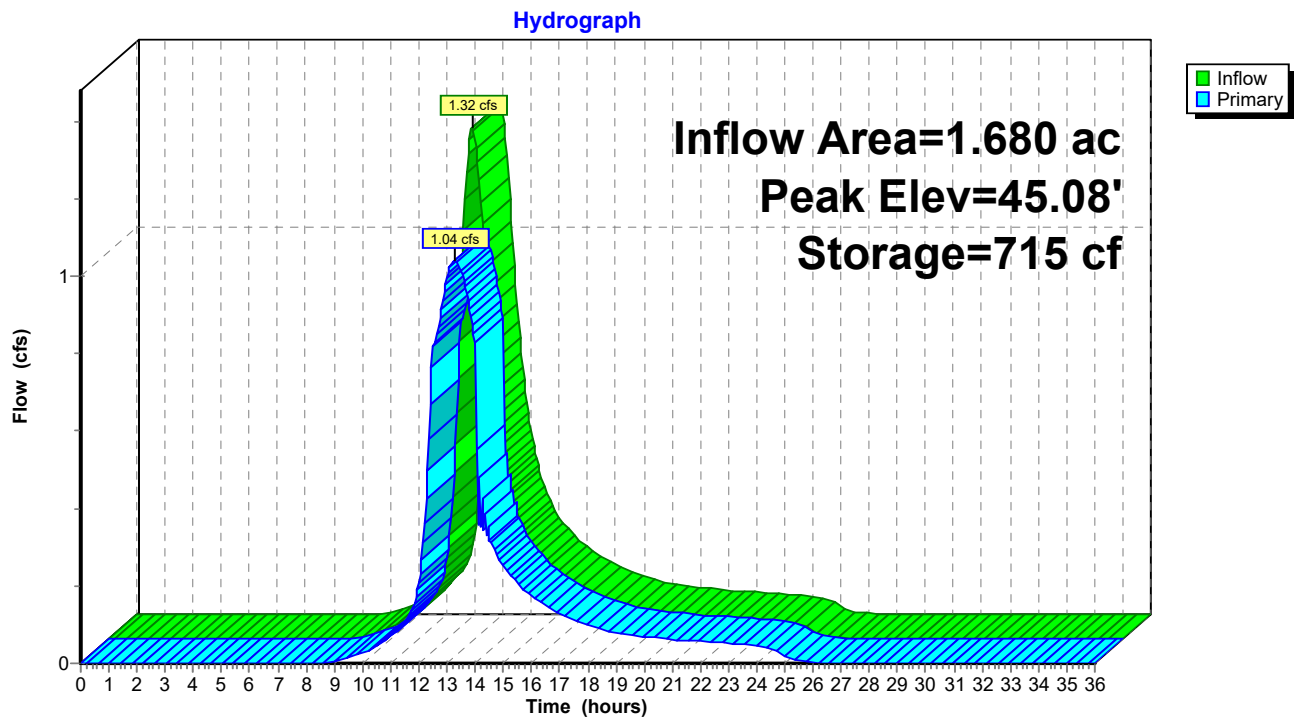

Summary for Pond PR-4: SB 01 DMH


Inflow Area = 1.921 ac, 1.31% Impervious, Inflow Depth = 1.79" for 2 yr event
 Inflow = 1.70 cfs @ 12.73 hrs, Volume= 0.287 af
 Outflow = 1.70 cfs @ 12.73 hrs, Volume= 0.287 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.70 cfs @ 12.73 hrs, Volume= 0.287 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 49.01' @ 12.73 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	48.30'	12.0" Round Culvert L= 50.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 48.30' / 47.80' S= 0.0100 '/ Cc= 0.900 n= 0.010, Flow Area= 0.79 sf

Primary OutFlow Max=1.70 cfs @ 12.73 hrs HW=49.01' TW=0.00' (Dynamic Tailwater)
 1=Culvert (Inlet Controls 1.70 cfs @ 2.86 fps)

Pond PR-4: SB 01 DMH

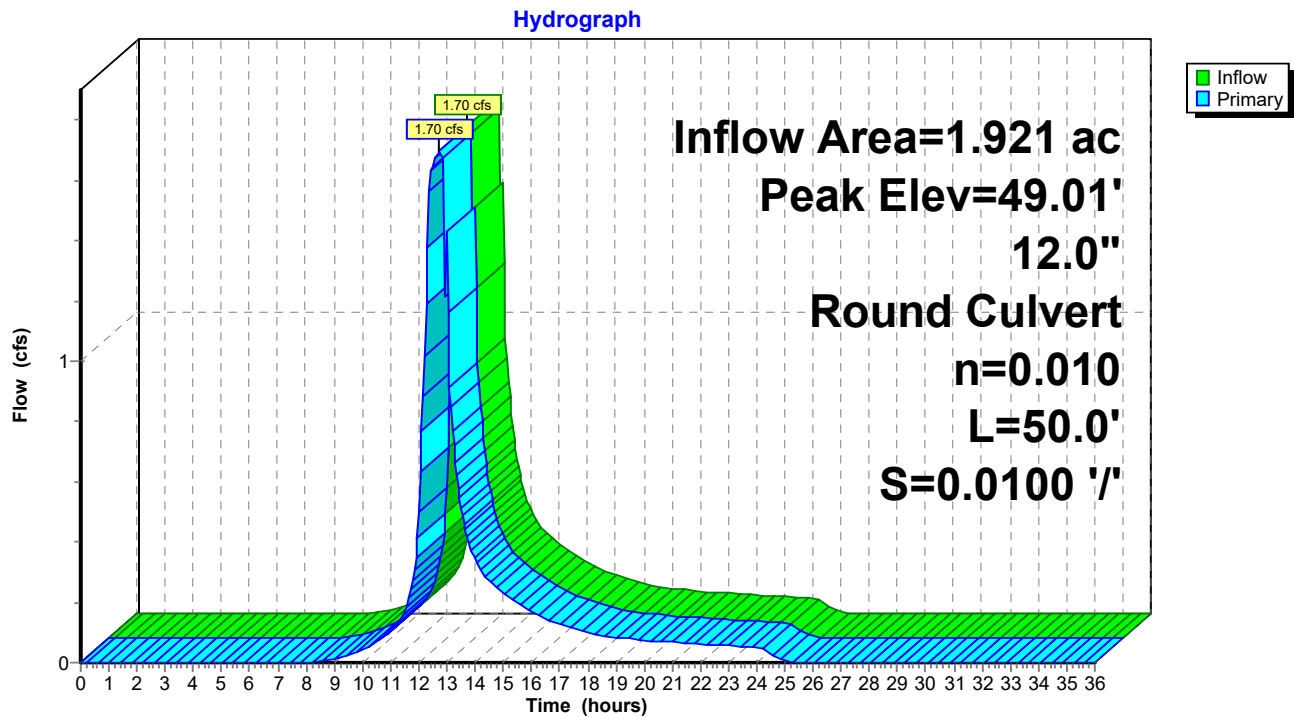

Summary for Pond PR-5: DMH 1


Inflow Area = 2.394 ac, 0.58% Impervious, Inflow Depth = 1.78" for 2 yr event
 Inflow = 1.20 cfs @ 13.27 hrs, Volume= 0.356 af
 Outflow = 1.20 cfs @ 13.27 hrs, Volume= 0.356 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.20 cfs @ 13.27 hrs, Volume= 0.356 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 44.09' @ 13.27 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	43.50'	15.0" Round Culvert L= 10.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 43.50' / 43.40' S= 0.0100 '/ Cc= 0.900 n= 0.010, Flow Area= 1.23 sf

Primary OutFlow Max=1.20 cfs @ 13.27 hrs HW=44.09' TW=0.00' (Dynamic Tailwater)
 1=Culvert (Barrel Controls 1.20 cfs @ 3.07 fps)

Pond PR-5: DMH 1

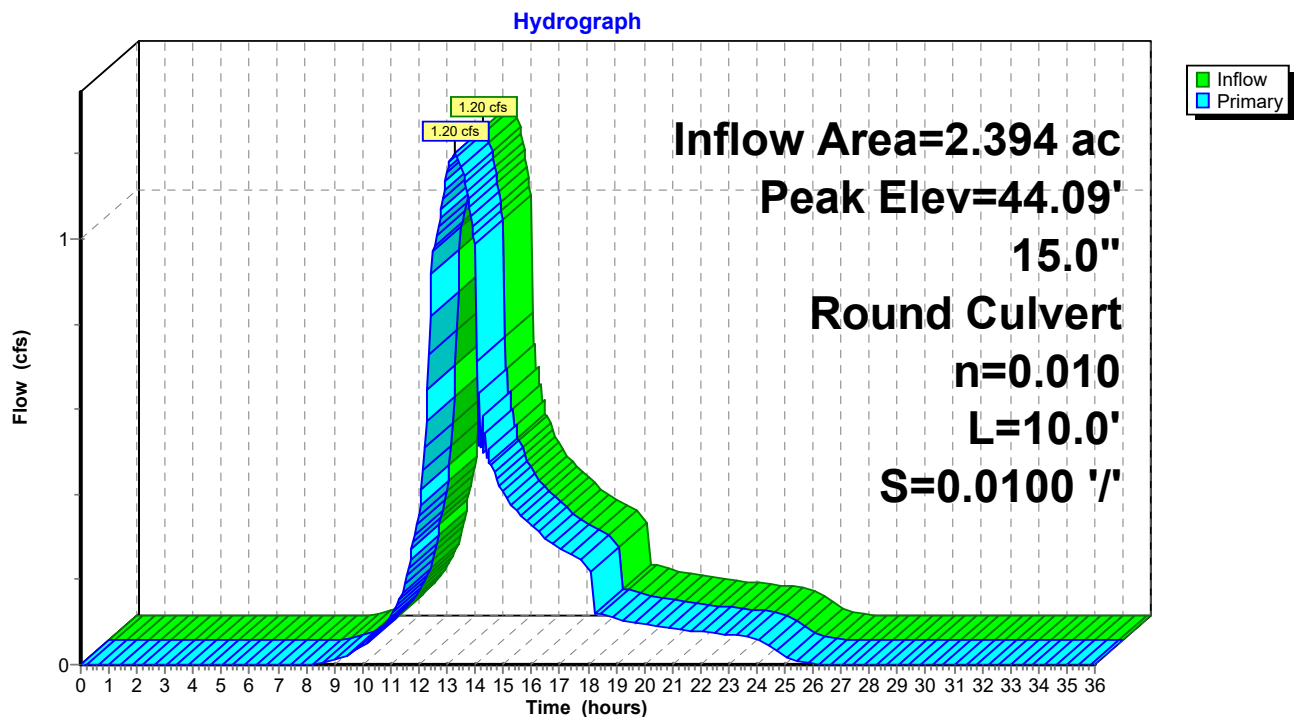

Summary for Pond SB 01 B: SB 01 B


Inflow Area = 1.049 ac, 2.41% Impervious, Inflow Depth = 1.77" for 2 yr event
 Inflow = 0.98 cfs @ 12.58 hrs, Volume= 0.155 af
 Outflow = 0.98 cfs @ 12.58 hrs, Volume= 0.155 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.98 cfs @ 12.58 hrs, Volume= 0.155 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 52.74' @ 12.58 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	52.00'	8.0" Round Culvert L= 8.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 52.00' / 51.92' S= 0.0100 '/ Cc= 0.900 n= 0.010, Flow Area= 0.35 sf

Primary OutFlow Max=0.98 cfs @ 12.58 hrs HW=52.74' TW=51.49' (Dynamic Tailwater)
 1=Culvert (Barrel Controls 0.98 cfs @ 3.16 fps)

Pond SB 01 B: SB 01 B

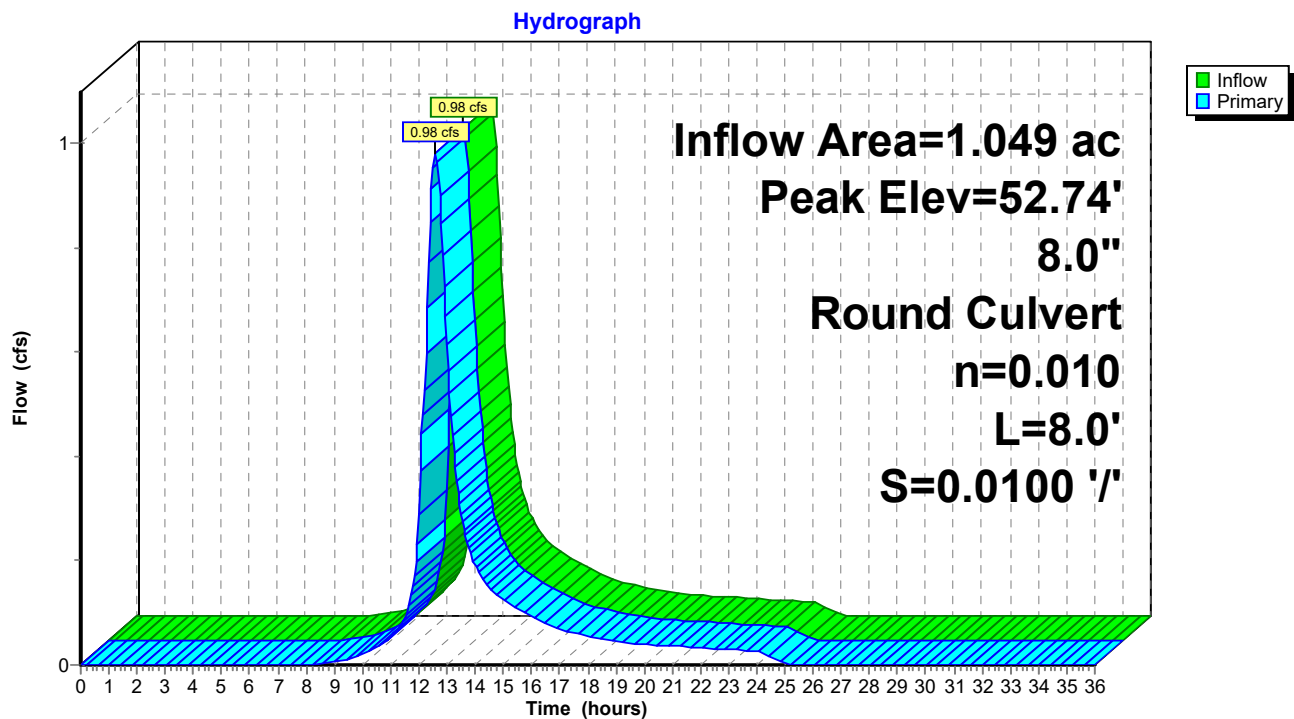

Summary for Pond SB 01 S: SB 01 S

Inflow Area = 1.049 ac, 2.41% Impervious, Inflow Depth = 1.77" for 2 yr event
 Inflow = 0.98 cfs @ 12.58 hrs, Volume= 0.155 af
 Outflow = 0.86 cfs @ 12.79 hrs, Volume= 0.155 af, Atten= 12%, Lag= 12.3 min
 Primary = 0.86 cfs @ 12.79 hrs, Volume= 0.155 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 51.50' @ 12.79 hrs Surf.Area= 0 sf Storage= 157 cf

Plug-Flow detention time= 1.5 min calculated for 0.155 af (100% of inflow)
 Center-of-Mass det. time= 1.1 min (860.0 - 858.9)

Volume	Invert	Avail.Storage	Storage Description
#1	50.64'	3,084 cf	Custom Stage Data Listed below


Elevation (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
50.64	0	0
51.47	16	16
51.97	2,170	2,186
52.47	898	3,084

Device	Routing	Invert	Outlet Devices
#1	Primary	50.64'	4.0" Vert. Orifice/Grate C= 0.600
#2	Primary	50.97'	6.0" Vert. Orifice/Grate C= 0.600
#3	Primary	51.47'	8.0" Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=0.86 cfs @ 12.79 hrs HW=51.50' TW=50.49' (Dynamic Tailwater)

1=Orifice/Grate (Orifice Controls 0.35 cfs @ 4.02 fps)
 2=Orifice/Grate (Orifice Controls 0.50 cfs @ 2.56 fps)
 3=Orifice/Grate (Orifice Controls 0.00 cfs @ 0.61 fps)

Pond SB 01 S: SB 01 S

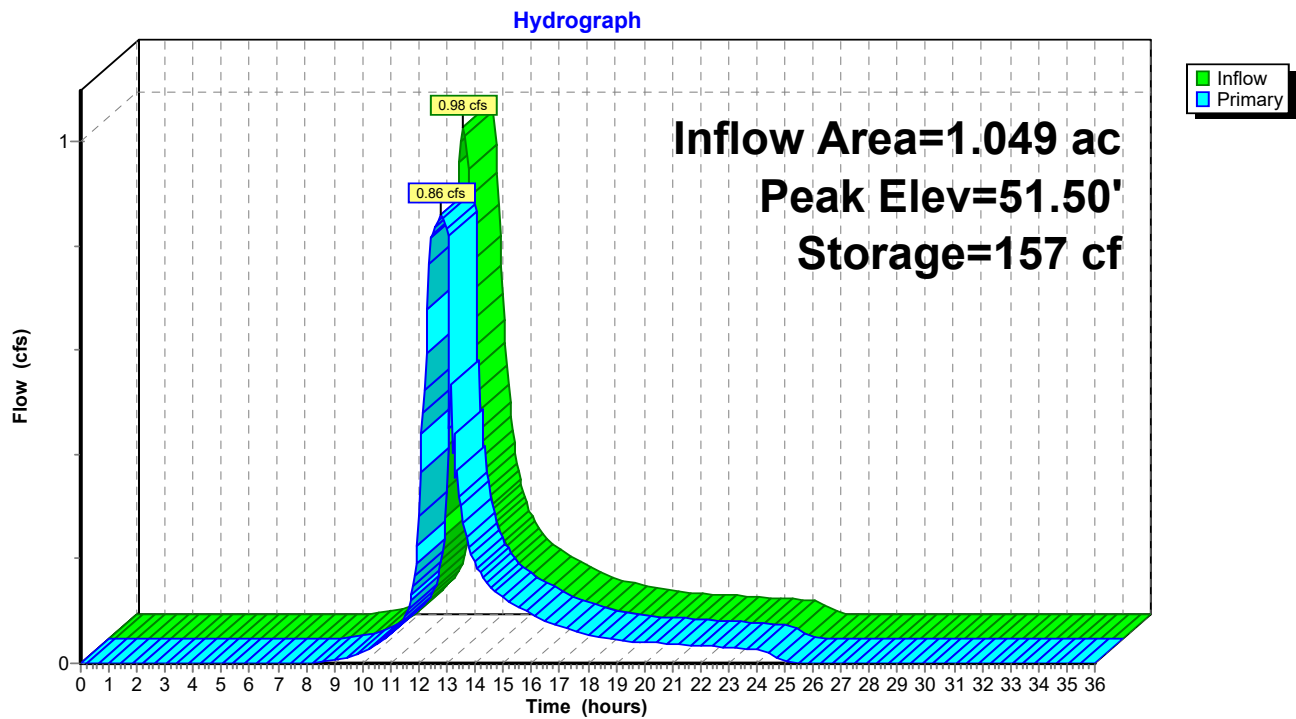

Summary for Pond SB 02 B: SB 02 B


Inflow Area = 1.049 ac, 2.41% Impervious, Inflow Depth = 1.77" for 2 yr event
 Inflow = 0.86 cfs @ 12.79 hrs, Volume= 0.155 af
 Outflow = 0.86 cfs @ 12.79 hrs, Volume= 0.155 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.86 cfs @ 12.79 hrs, Volume= 0.155 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 50.49' @ 12.79 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	49.97'	12.0" Round Culvert L= 12.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 49.97' / 49.85' S= 0.0100 '/ Cc= 0.900 n= 0.010, Flow Area= 0.79 sf

Primary OutFlow Max=0.86 cfs @ 12.79 hrs HW=50.49' TW=49.01' (Dynamic Tailwater)
 1=Culvert (Barrel Controls 0.86 cfs @ 3.01 fps)

Pond SB 02 B: SB 02 B

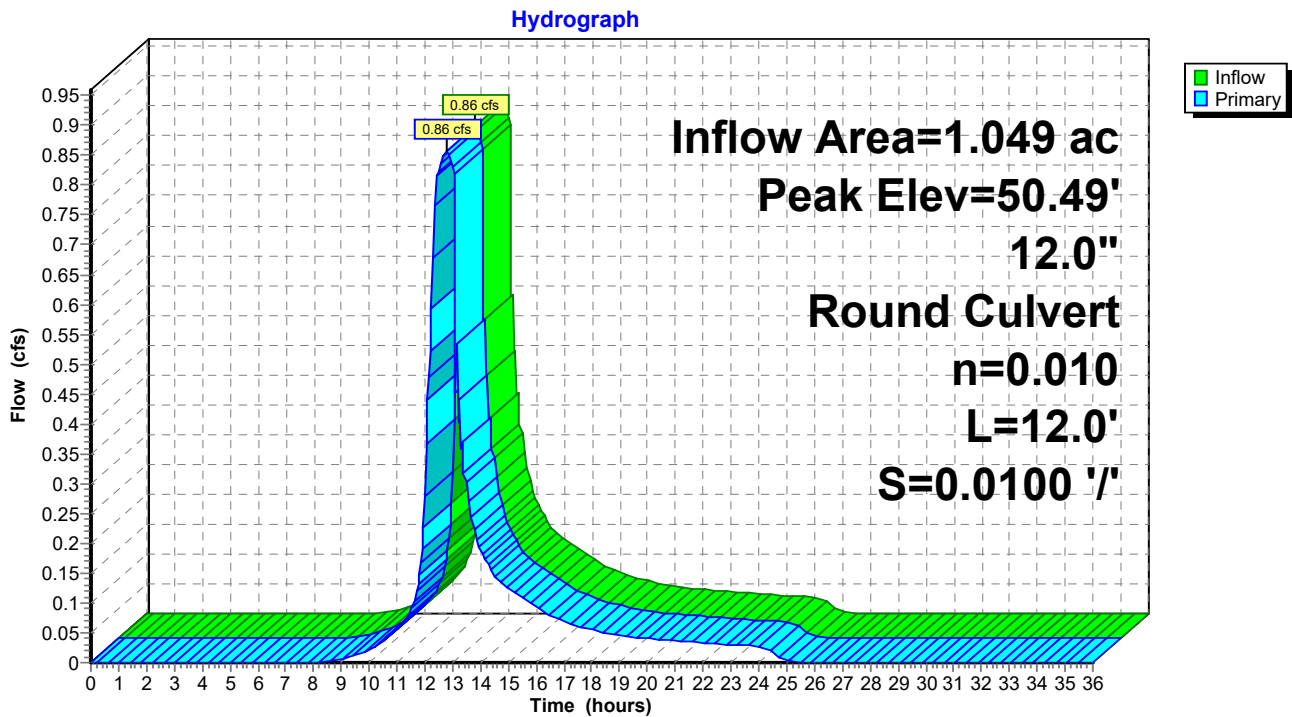

Summary for Pond SB 11 B: SB 11 B


Inflow Area = 0.872 ac, 0.00% Impervious, Inflow Depth = 1.83" for 2 yr event
 Inflow = 0.95 cfs @ 12.52 hrs, Volume= 0.133 af
 Outflow = 0.95 cfs @ 12.52 hrs, Volume= 0.133 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.95 cfs @ 12.52 hrs, Volume= 0.133 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 52.65' @ 12.52 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	52.00'	8.0" Round Culvert L= 24.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 52.00' / 51.76' S= 0.0100 '/ Cc= 0.900 n= 0.010, Flow Area= 0.35 sf

Primary OutFlow Max=0.95 cfs @ 12.52 hrs HW=52.65' TW=51.68' (Dynamic Tailwater)
 1=Culvert (Inlet Controls 0.95 cfs @ 2.74 fps)

Pond SB 11 B: SB 11 B

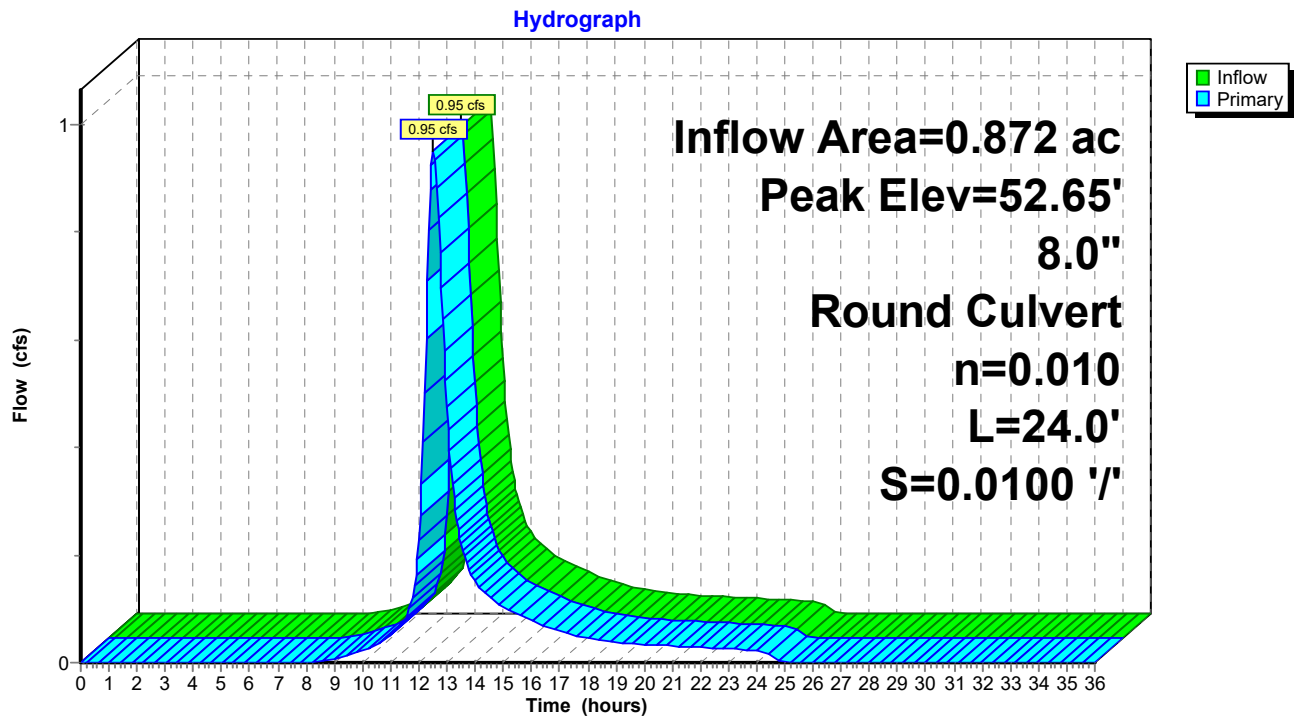

Summary for Pond SB 11 S: SB 11 S

Inflow Area = 0.872 ac, 0.00% Impervious, Inflow Depth = 1.83" for 2 yr event
 Inflow = 0.95 cfs @ 12.52 hrs, Volume= 0.133 af
 Outflow = 0.84 cfs @ 12.68 hrs, Volume= 0.133 af, Atten= 11%, Lag= 9.9 min
 Primary = 0.84 cfs @ 12.68 hrs, Volume= 0.133 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 51.69' @ 12.68 hrs Surf.Area= 0 sf Storage= 109 cf

Plug-Flow detention time= (not calculated: outflow precedes inflow)
 Center-of-Mass det. time= 0.9 min (855.0 - 854.1)

Volume	Invert	Avail.Storage	Storage Description
#1	50.84'	2,892 cf	Custom Stage Data Listed below


Elevation (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
50.84	0	0
51.67	16	16
52.17	2,035	2,051
52.67	841	2,892

Device	Routing	Invert	Outlet Devices
#1	Primary	50.84'	4.0" Vert. Orifice/Grate C= 0.600
#2	Primary	51.17'	6.0" Vert. Orifice/Grate C= 0.600
#3	Primary	51.67'	6.0" Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=0.84 cfs @ 12.68 hrs HW=51.69' TW=50.64' (Dynamic Tailwater)

1=Orifice/Grate (Orifice Controls 0.35 cfs @ 3.99 fps)
 2=Orifice/Grate (Orifice Controls 0.49 cfs @ 2.51 fps)
 3=Orifice/Grate (Orifice Controls 0.00 cfs @ 0.51 fps)

Pond SB 11 S: SB 11 S

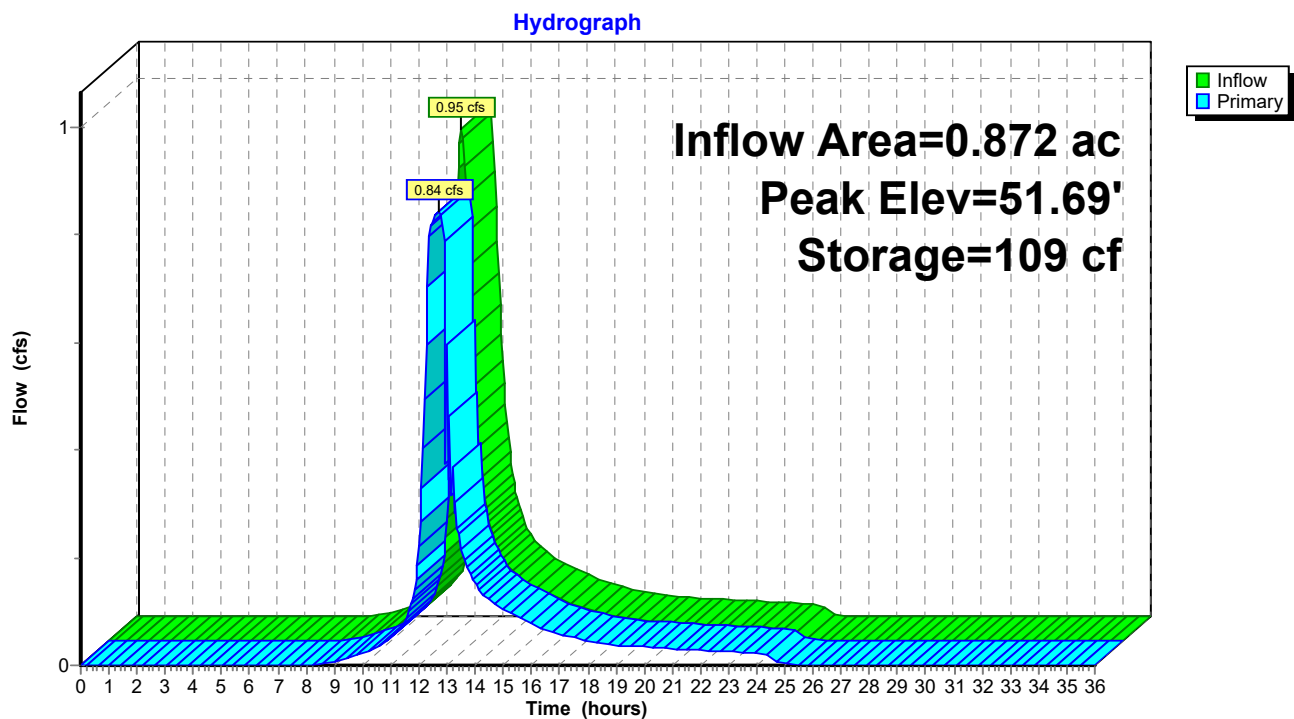

Summary for Pond SB 12 B: SB 12 B


Inflow Area = 0.872 ac, 0.00% Impervious, Inflow Depth = 1.83" for 2 yr event
 Inflow = 0.84 cfs @ 12.68 hrs, Volume= 0.133 af
 Outflow = 0.84 cfs @ 12.68 hrs, Volume= 0.133 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.84 cfs @ 12.68 hrs, Volume= 0.133 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 50.64' @ 12.68 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	50.17'	12.0" Round Culvert L= 160.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 50.17' / 48.57' S= 0.0100 '/ Cc= 0.900 n= 0.010, Flow Area= 0.79 sf

Primary OutFlow Max=0.84 cfs @ 12.68 hrs HW=50.64' TW=49.01' (Dynamic Tailwater)
 1=Culvert (Inlet Controls 0.84 cfs @ 2.33 fps)

Pond SB 12 B: SB 12 B

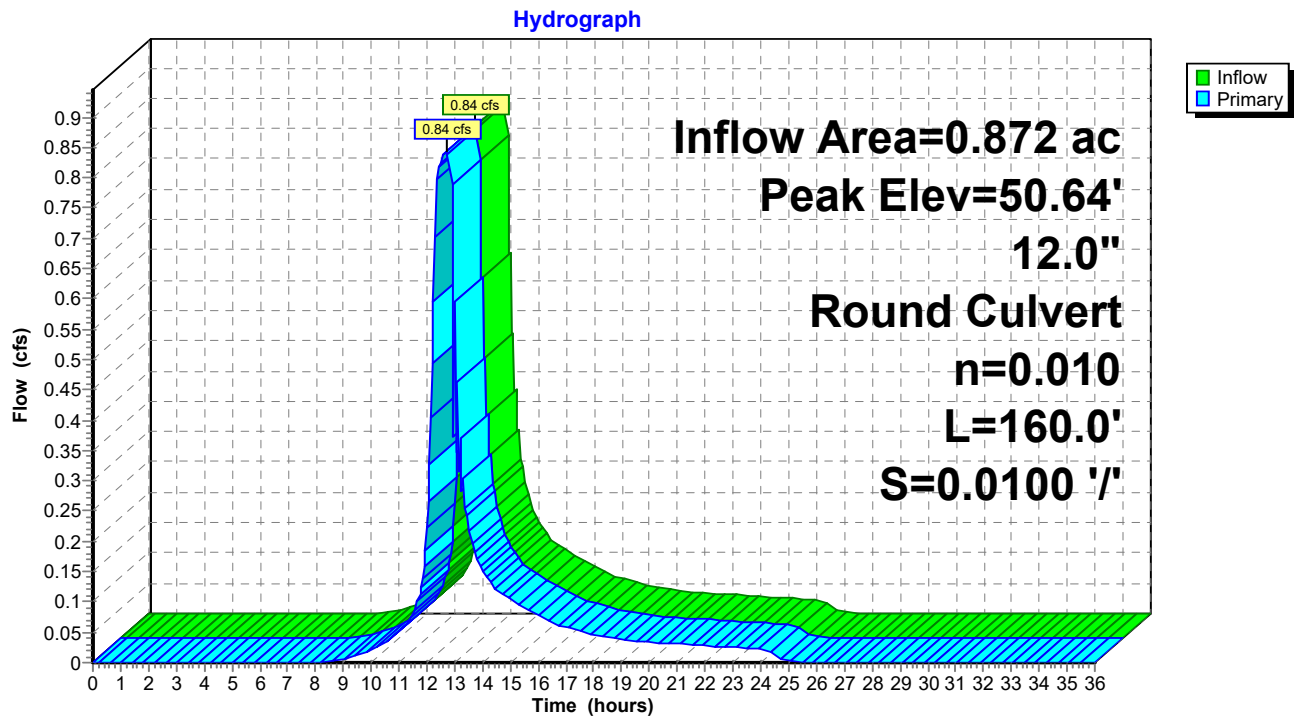


Summary for Link POA: POA

Inflow Area = 17.400 ac, 49.60% Impervious, Inflow Depth > 1.77" for 2 yr event
Inflow = 21.54 cfs @ 12.11 hrs, Volume= 2.564 af
Primary = 21.54 cfs @ 12.11 hrs, Volume= 2.564 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Link POA: POA

Hydrograph

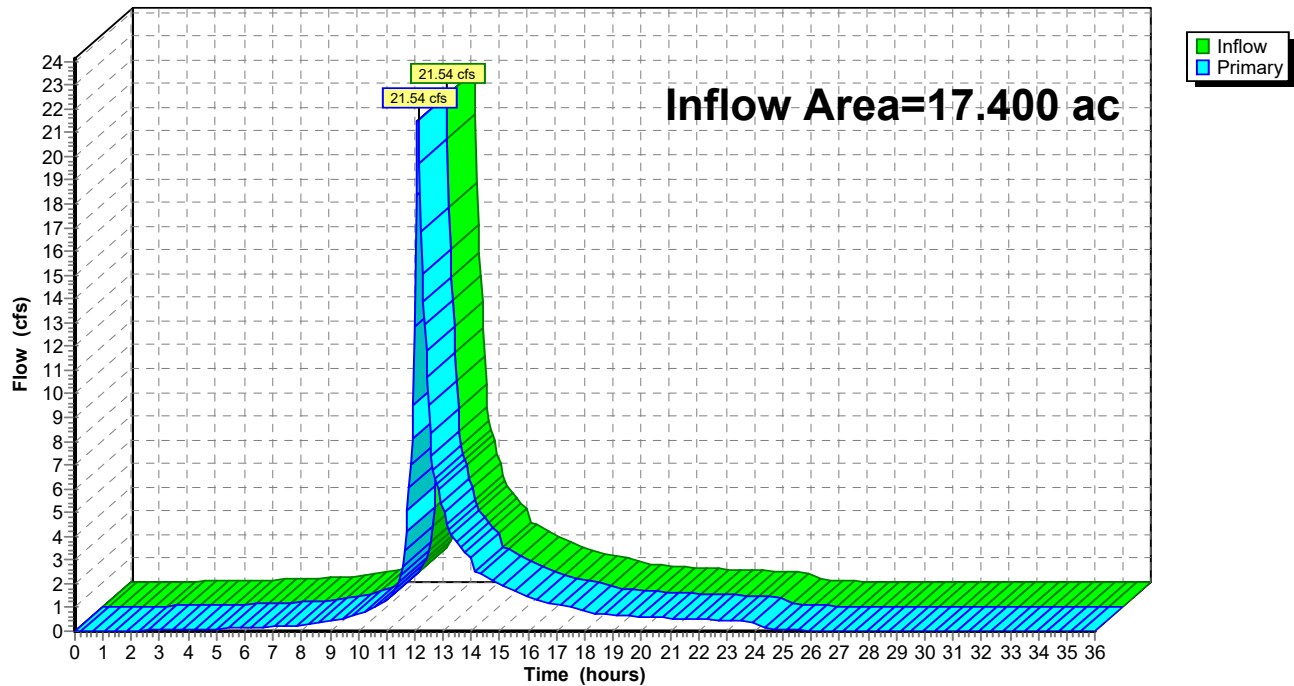

Summary for Subcatchment PR-1: PR-1

Runoff = 14.67 cfs @ 12.13 hrs, Volume= 1.185 af, Depth= 3.23"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10 yr Rainfall=5.17"

Area (ac)	CN	Description
1.892	61	>75% Grass cover, Good, HSG B
2.510	98	Paved parking, HSG B
4.402	82	Weighted Average
1.892		42.98% Pervious Area
2.510		57.02% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.2	50	0.0050	0.69		Sheet Flow, A-B
					Smooth surfaces n= 0.011 P2= 3.20"
7.9	234	0.0050	0.49		Shallow Concentrated Flow, B-C
					Short Grass Pasture Kv= 7.0 fps
9.1	284	Total			

Subcatchment PR-1: PR-1

Hydrograph

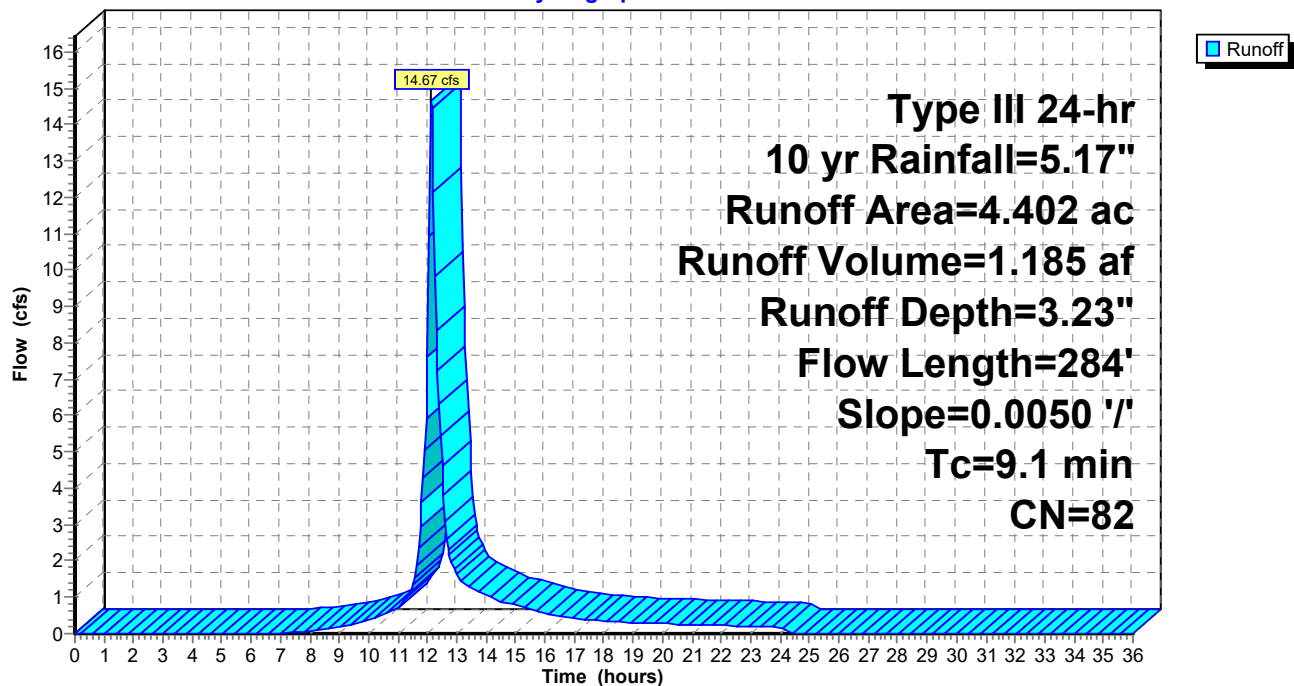

Summary for Subcatchment PR-1A: PR-1A


Runoff = 2.13 cfs @ 12.09 hrs, Volume= 0.162 af, Depth= 4.15"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10 yr Rainfall=5.17"

Area (ac)	CN	Description
0.090	61	>75% Grass cover, Good, HSG B
0.380	98	Paved parking, HSG B
0.470	91	Weighted Average
0.090		19.15% Pervious Area
0.380		80.85% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-1A: PR-1A

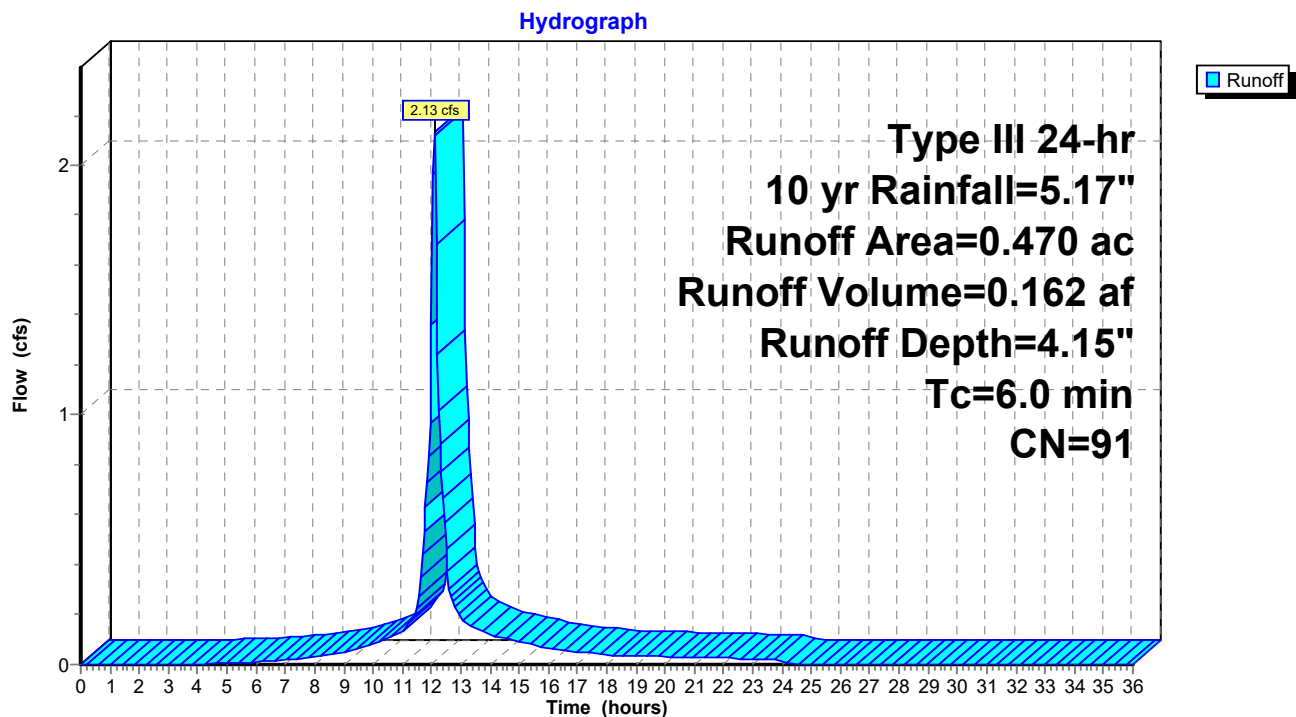

Summary for Subcatchment PR-1B: PR-1B

Runoff = 9.19 cfs @ 12.09 hrs, Volume= 0.765 af, Depth= 4.93"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10 yr Rainfall=5.17"

Area (ac)	CN	Description
1.861	98	Roofs, HSG B
1.861		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-1B: PR-1B

Hydrograph

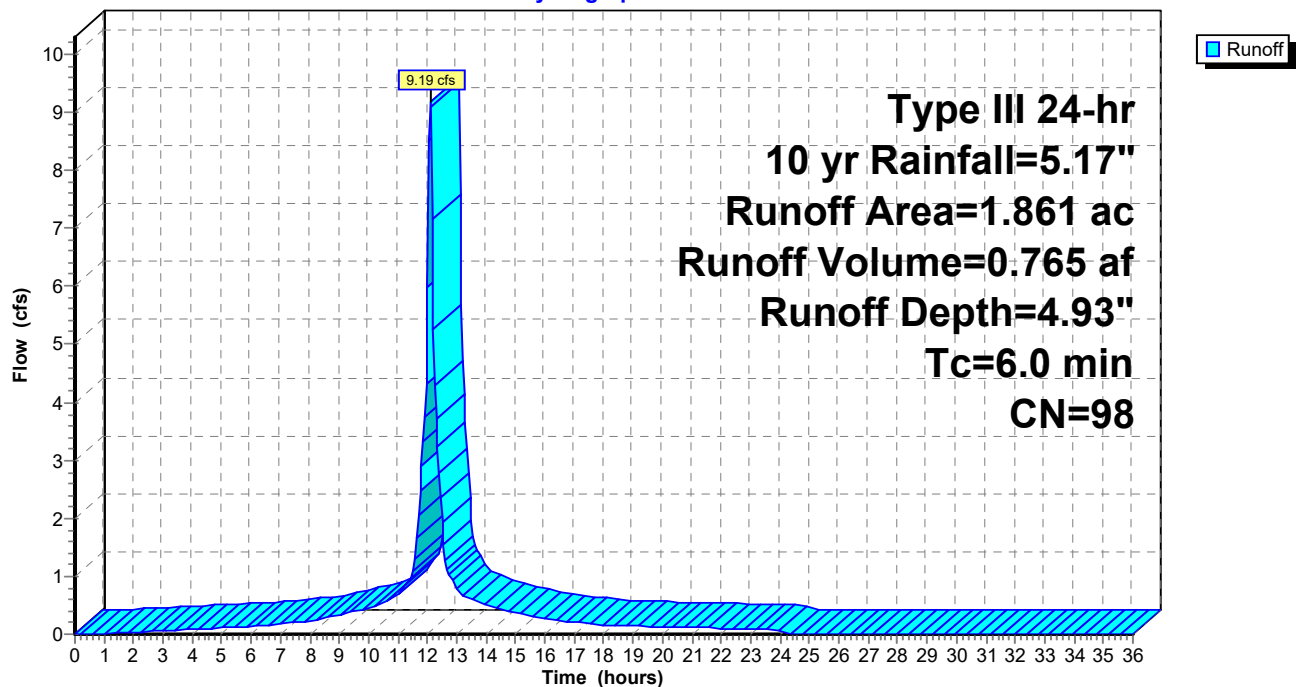

Summary for Subcatchment PR-1C: PR-1C


Runoff = 1.37 cfs @ 12.09 hrs, Volume= 0.099 af, Depth= 2.59"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10 yr Rainfall=5.17"

Area (ac)	CN	Description
0.020	55	Woods, Good, HSG B
0.260	61	>75% Grass cover, Good, HSG B
0.180	98	Paved parking, HSG B
0.460	75	Weighted Average
0.280		60.87% Pervious Area
0.180		39.13% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.6	20	0.0700	0.09		Sheet Flow, 20' SF Woods: Light underbrush n= 0.400 P2= 3.20"
1.9	40	0.5000	0.35		Sheet Flow, 30' SF Grass: Dense n= 0.240 P2= 3.20"
0.1	12	0.0100	1.61		Shallow Concentrated Flow, 12' SCF Unpaved Kv= 16.1 fps
0.2	48	0.0400	4.06		Shallow Concentrated Flow, 48' SCF Paved Kv= 20.3 fps
5.8	120	Total, Increased to minimum Tc = 6.0 min			

Subcatchment PR-1C: PR-1C

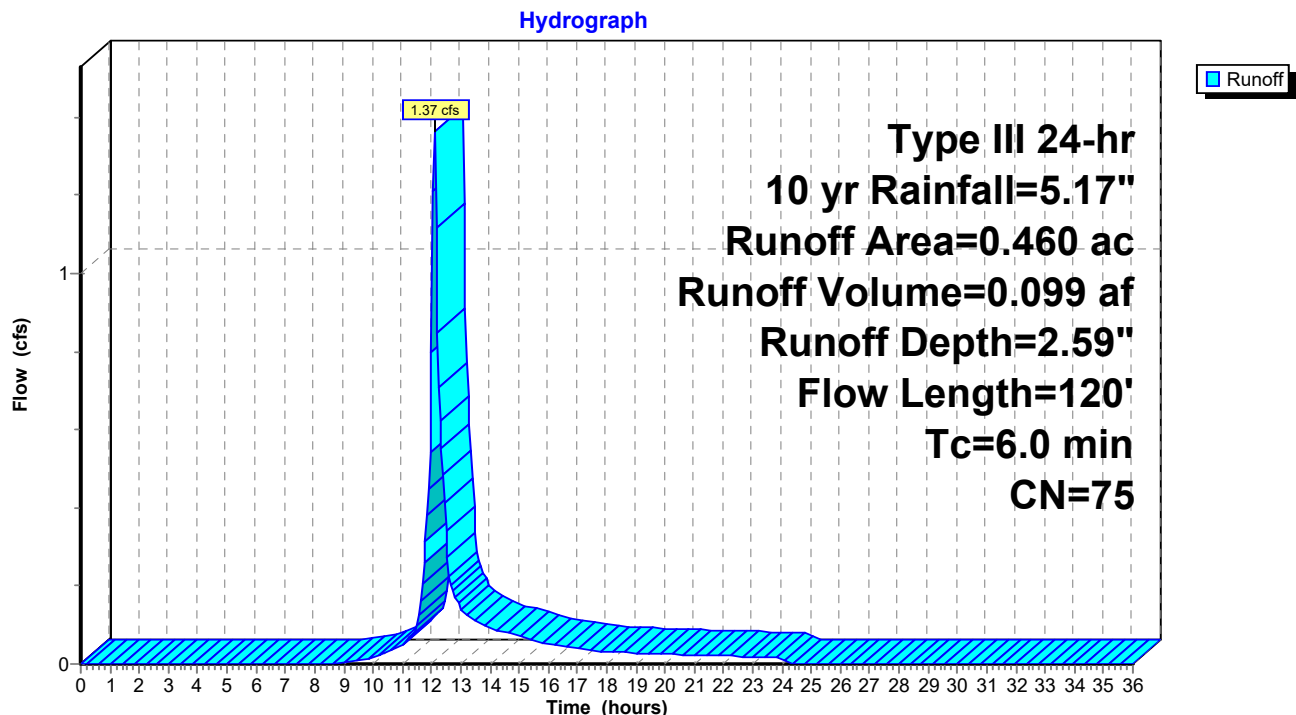

Summary for Subcatchment PR-1D: PR-1D

Runoff = 7.42 cfs @ 12.09 hrs, Volume= 0.617 af, Depth= 4.93"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10 yr Rainfall=5.17"

Area (ac)	CN	Description
1.501	98	Roofs, HSG B
1.501		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-1D: PR-1D

Hydrograph

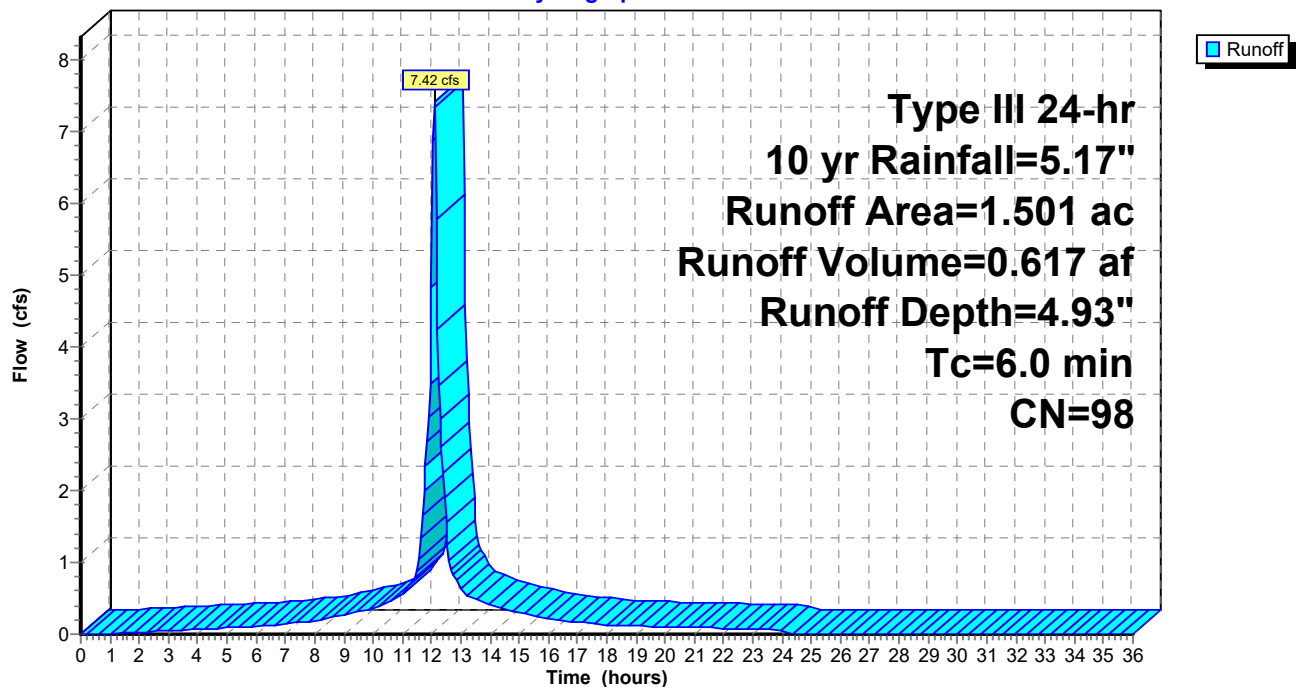

Summary for Subcatchment PR-1E: PR-1E


Runoff = 3.62 cfs @ 12.17 hrs, Volume= 0.319 af, Depth= 2.50"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10 yr Rainfall=5.17"

Area (ac)	CN	Description
1.000	61	>75% Grass cover, Good, HSG B
0.533	98	Paved parking, HSG B
1.533	74	Weighted Average
1.000		65.23% Pervious Area
0.533		34.77% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.8	50	0.0050	0.09		Sheet Flow, 50' SF
					Grass: Short n= 0.150 P2= 3.20"
2.5	170	0.0050	1.14		Shallow Concentrated Flow, 170' SCF
					Unpaved Kv= 16.1 fps
12.3	220	Total			

Subcatchment PR-1E: PR-1E

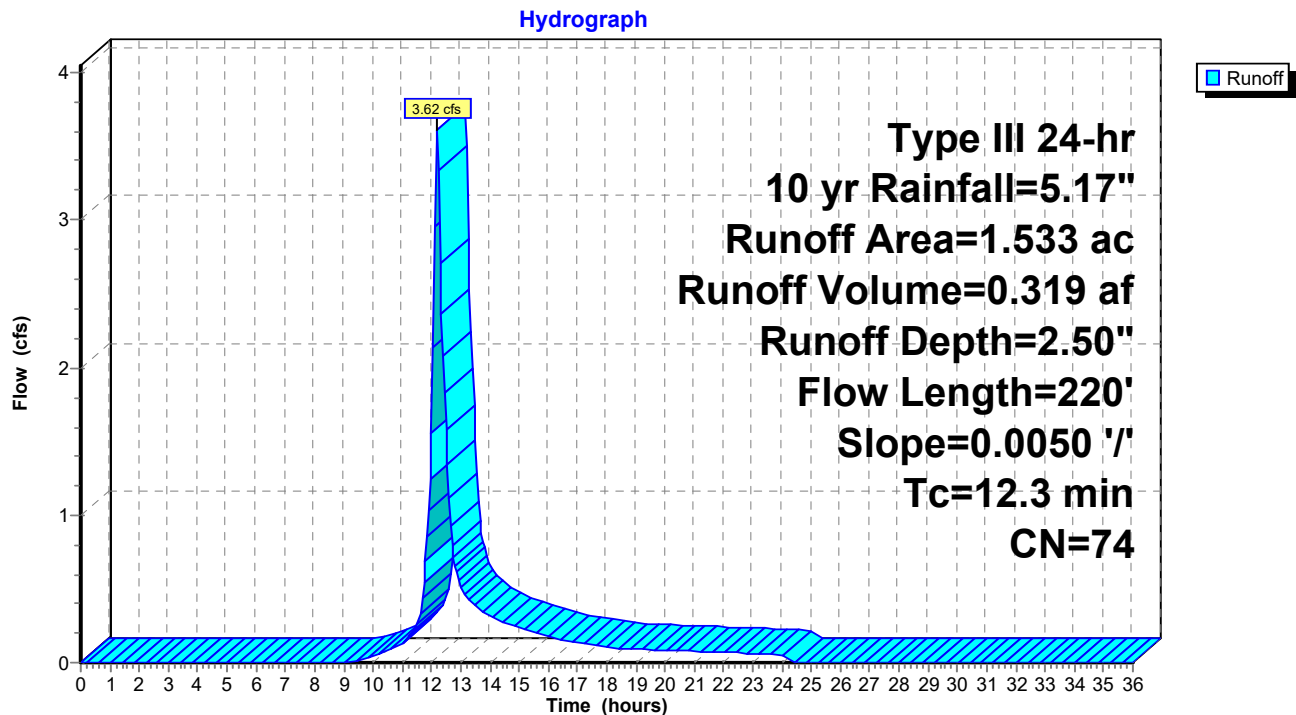

Summary for Subcatchment PR-2: PR-2

Runoff = 5.18 cfs @ 12.09 hrs, Volume= 0.376 af, Depth= 3.14"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10 yr Rainfall=5.17"

Area (ac)	CN	Description
0.672	61	>75% Grass cover, Good, HSG B
0.768	98	Paved parking, HSG B
1.440	81	Weighted Average
0.672		46.67% Pervious Area
0.768		53.33% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-2: PR-2

Hydrograph

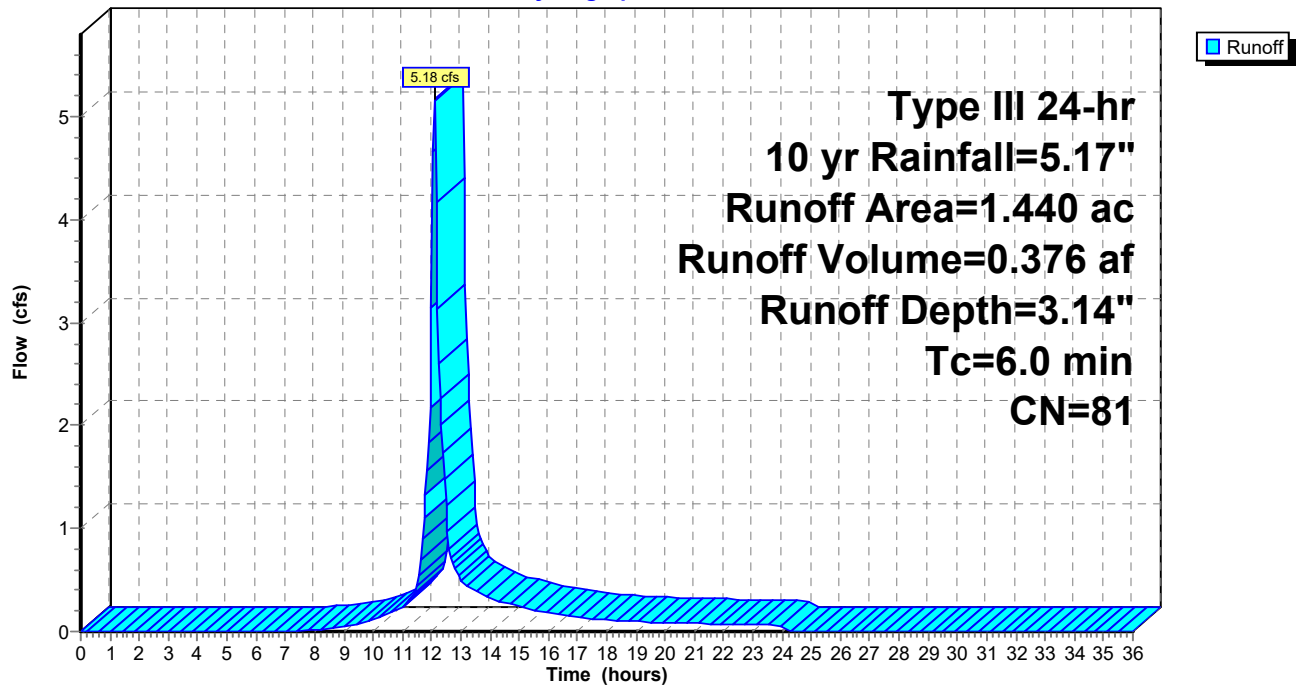

Summary for Subcatchment PR-2B: PR-2B

Runoff = 1.31 cfs @ 12.09 hrs, Volume= 0.109 af, Depth= 4.93"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10 yr Rainfall=5.17"

Area (ac)	CN	Description
0.265	98	Roofs, HSG B
0.265		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-2B: PR-2B

Hydrograph

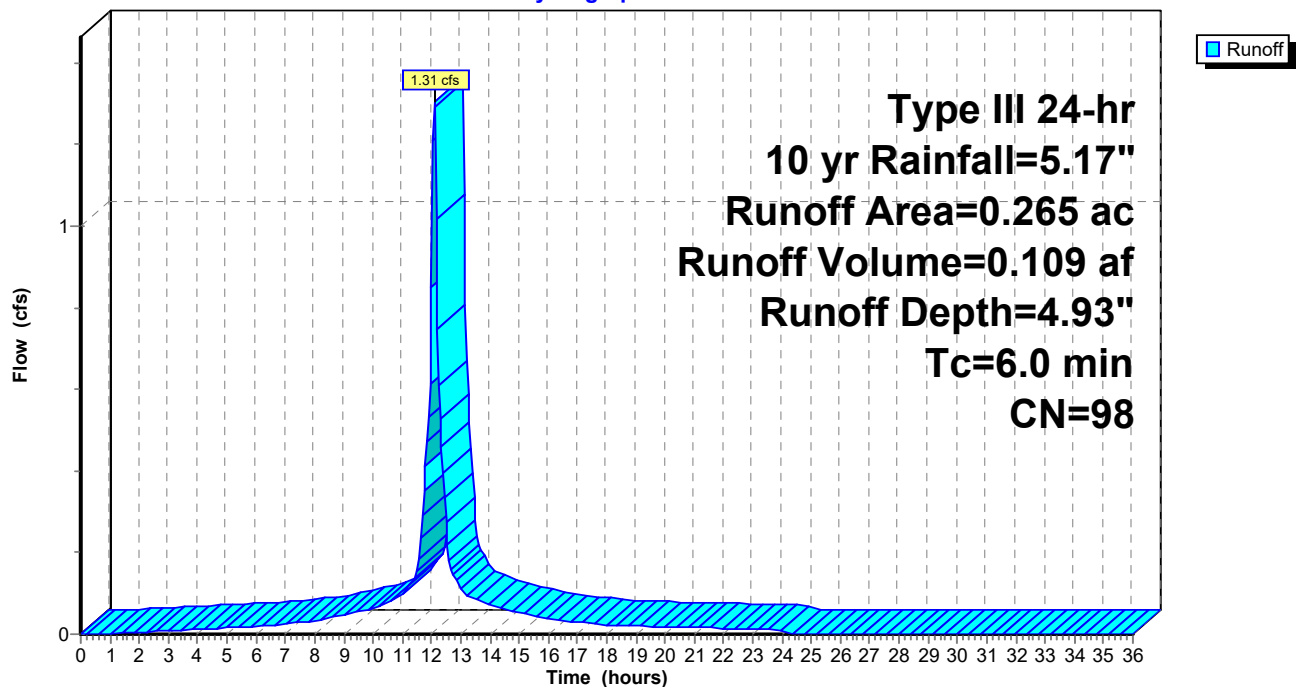

Summary for Subcatchment PR-3A: PR-3A


Runoff = 2.90 cfs @ 12.09 hrs, Volume= 0.213 af, Depth= 3.53"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10 yr Rainfall=5.17"

Area (ac)	CN	Description
0.249	61	>75% Grass cover, Good, HSG B
0.476	98	Paved parking, HSG B
0.725	85	Weighted Average
0.249		34.34% Pervious Area
0.476		65.66% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-3A: PR-3A

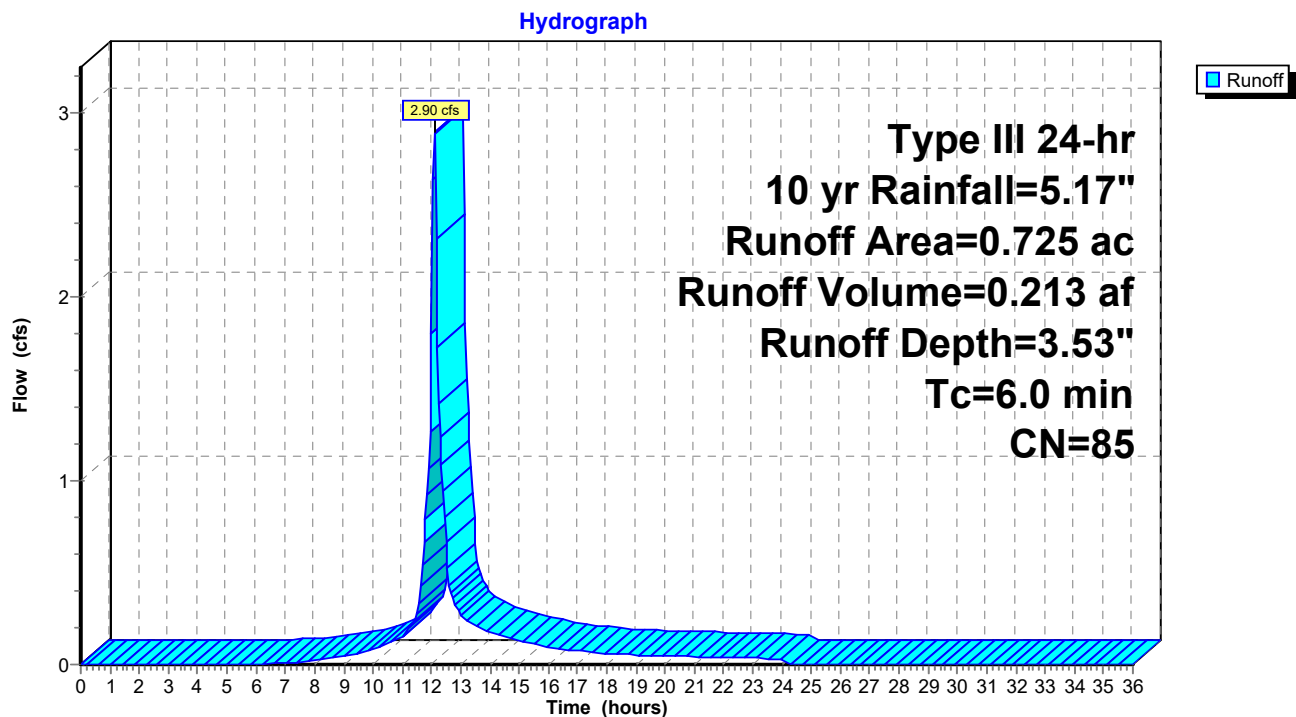

Summary for Subcatchment PR-3B: PR-3B

Runoff = 0.82 cfs @ 12.09 hrs, Volume= 0.059 af, Depth= 2.95"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10 yr Rainfall=5.17"

Area (ac)	CN	Description
0.124	61	>75% Grass cover, Good, HSG B
0.117	98	Paved parking, HSG B
0.241	79	Weighted Average
0.124		51.45% Pervious Area
0.117		48.55% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-3B: PR-3B

Hydrograph

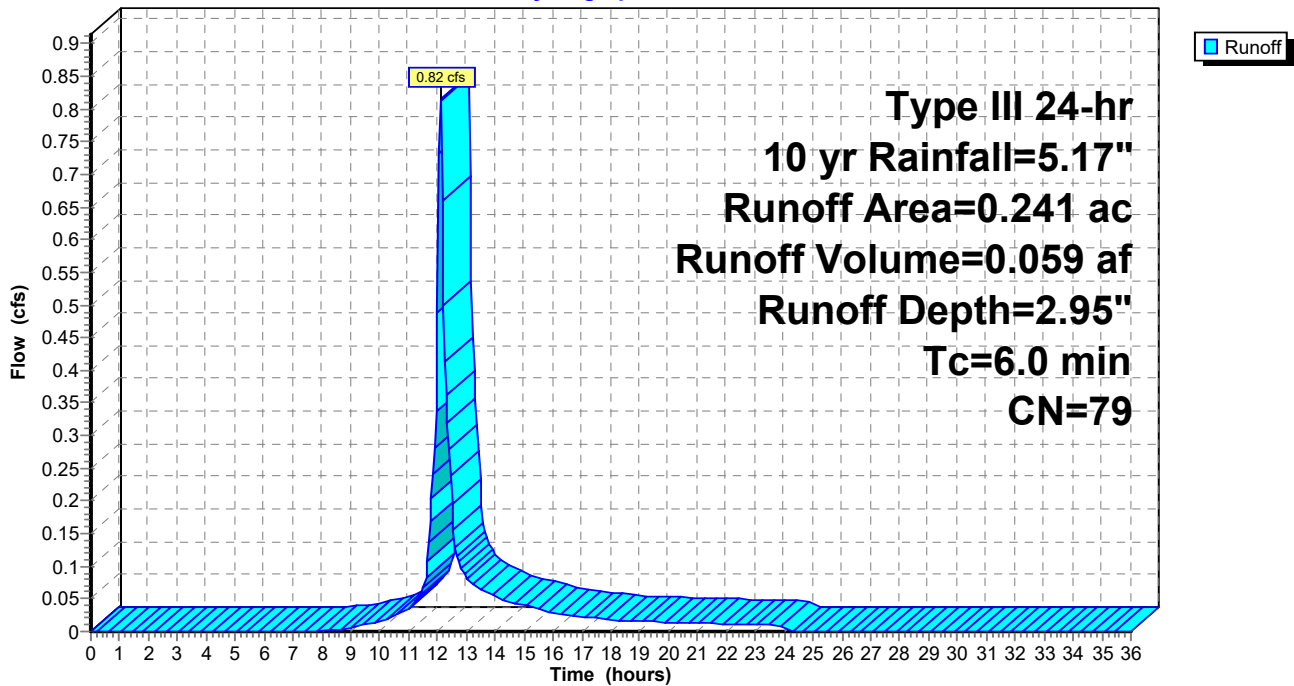

Summary for Subcatchment PR-3C: PR-3C

Runoff = 0.29 cfs @ 12.10 hrs, Volume= 0.023 af, Depth= 1.47"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10 yr Rainfall=5.17"

Area (ac)	CN	Description
0.186	61	>75% Grass cover, Good, HSG B
0.186		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-3C: PR-3C

Hydrograph

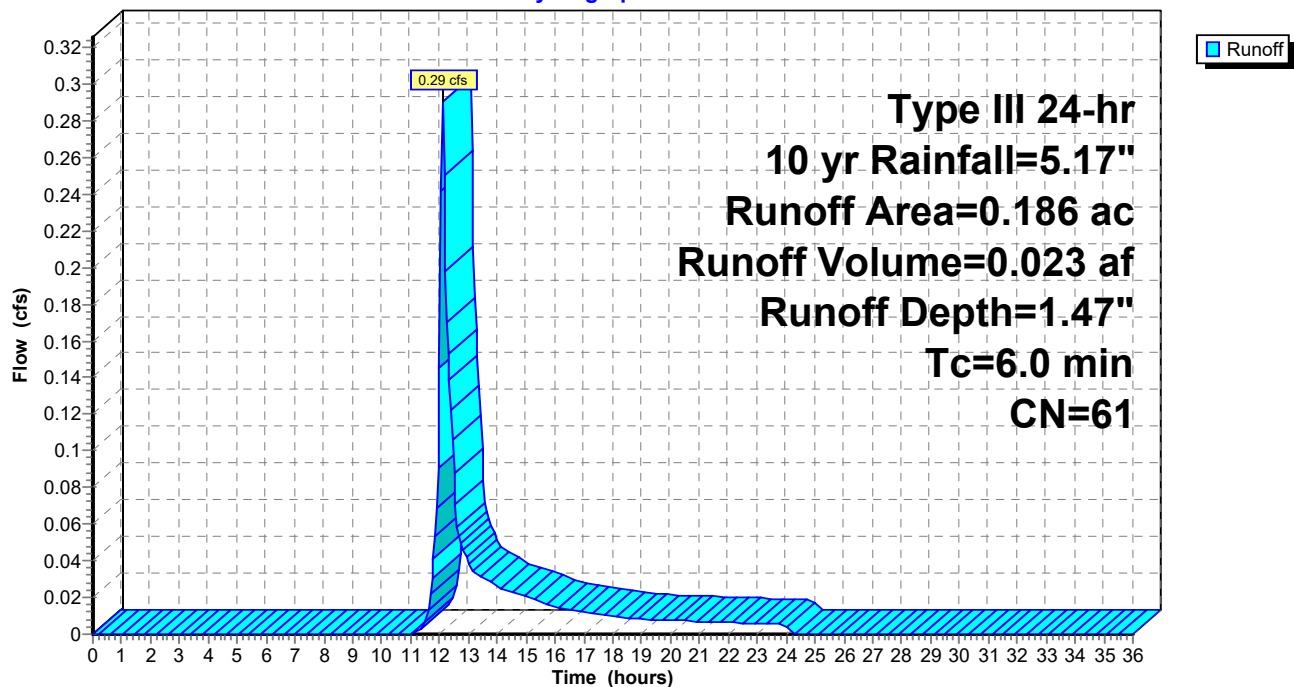

Summary for Subcatchment PR-4A: SB 01 A


Runoff = 1.82 cfs @ 12.58 hrs, Volume= 0.277 af, Depth= 3.53"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10 yr Rainfall=5.17"

Area (sf)	CN	Description
* 41,000	85	SYNTHETIC TURF- PAD- LINER
41,000		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
39.6	110	0.0055	0.05		Sheet Flow, Through Turf Section Grass: Bermuda n= 0.410 P2= 3.20"
3.7	100	0.0001	0.45	0.16	Pipe Channel, TRENCH DRAIN LEVEL 8.0" Round Area= 0.3 sf Perim= 2.1' r= 0.17' n= 0.010
43.3	210	Total			

Subcatchment PR-4A: SB 01 A

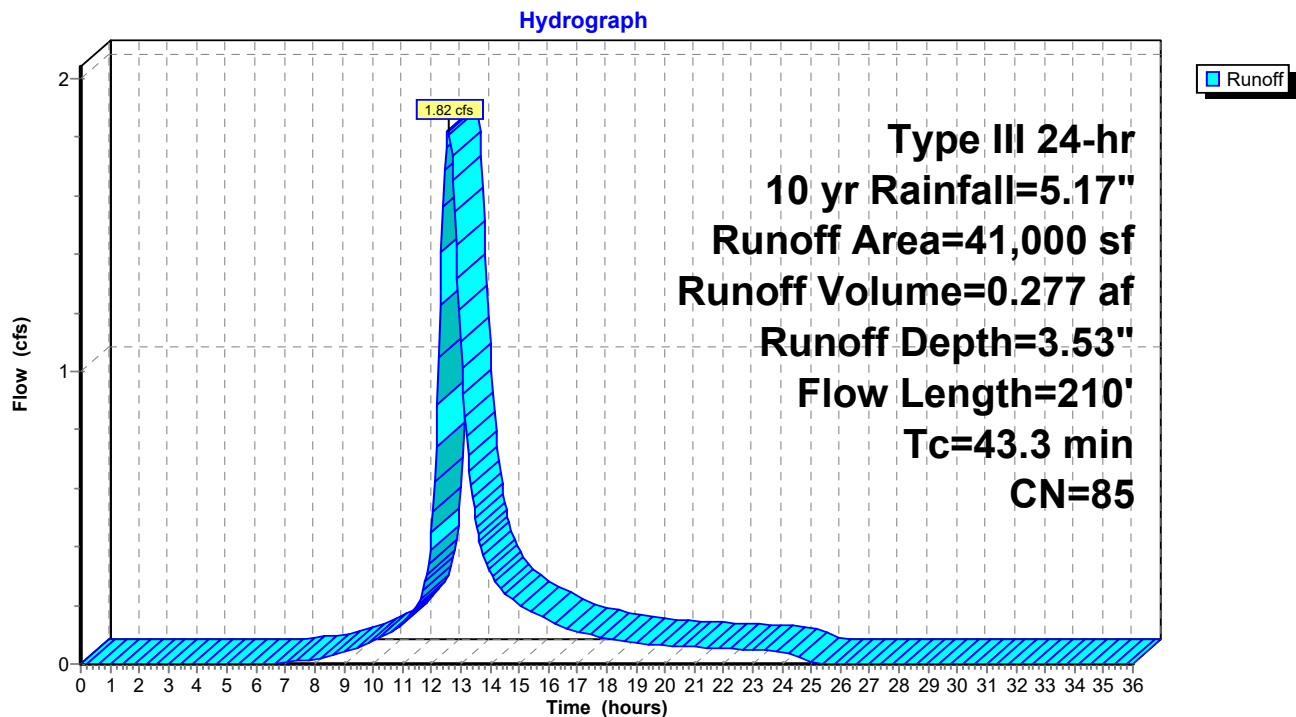

Summary for Subcatchment PR-4B: SB 11 A


Runoff = 1.82 cfs @ 12.51 hrs, Volume= 0.256 af, Depth= 3.53"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10 yr Rainfall=5.17"

Area (sf)	CN	Description
* 38,000	85	SYNTHETIC TURF- PAD- LINER
38,000		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
33.7	90	0.0055	0.04		Sheet Flow, Through Turf Section Grass: Bermuda n= 0.410 P2= 3.20"
3.7	100	0.0001	0.45	0.16	Pipe Channel, TRENCH DRAIN LEVEL 8.0" Round Area= 0.3 sf Perim= 2.1' r= 0.17' n= 0.010
37.4	190	Total			

Subcatchment PR-4B: SB 11 A

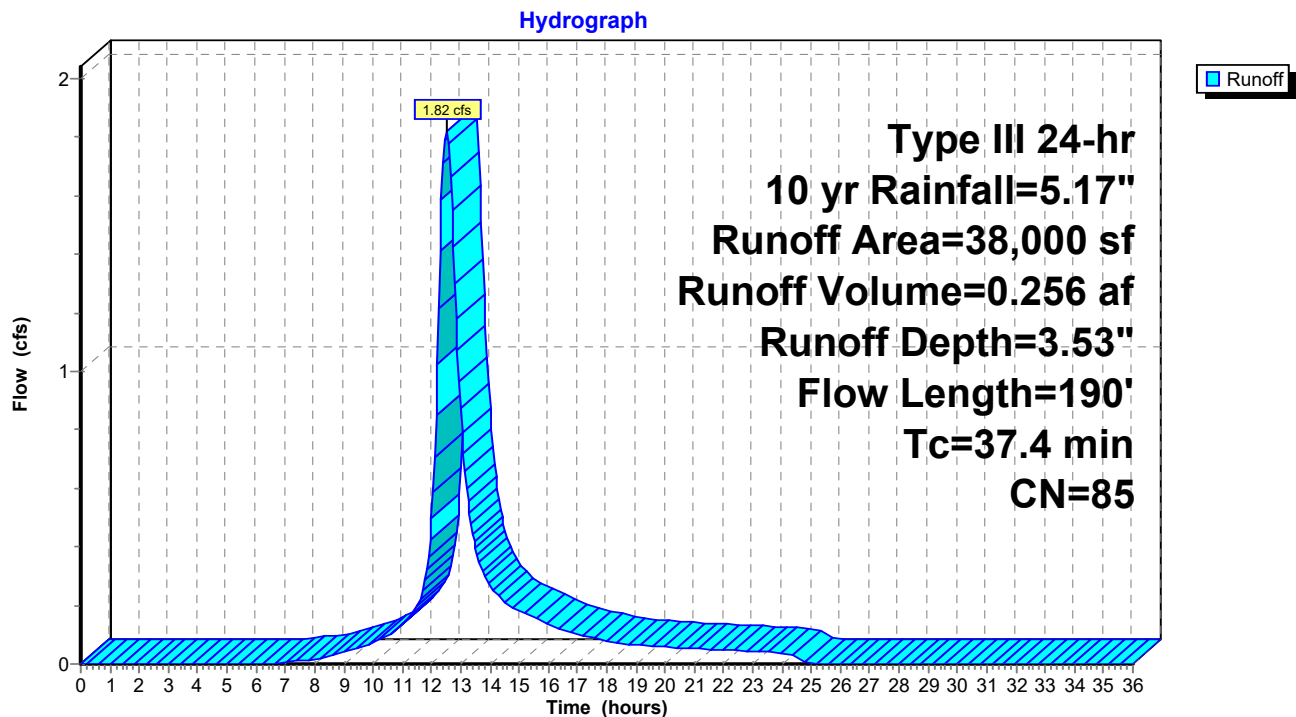

Summary for Subcatchment PR-4C: SB 00 DPW SLOPE


Runoff = 0.34 cfs @ 12.09 hrs, Volume= 0.025 af, Depth= 2.77"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10 yr Rainfall=5.17"

Area (sf)	CN	Adj	Description
1,100	98		Unconnected pavement, HSG A
3,600	74		>75% Grass cover, Good, HSG C
4,700	80	77	Weighted Average, UI Adjusted
3,600			76.60% Pervious Area
1,100			23.40% Impervious Area
1,100			100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.3	25	0.5000	0.32		Sheet Flow, SLOPING LAND
					Grass: Dense n= 0.240 P2= 3.20"
1.3	25	Total, Increased to minimum Tc = 6.0 min			

Subcatchment PR-4C: SB 00 DPW SLOPE

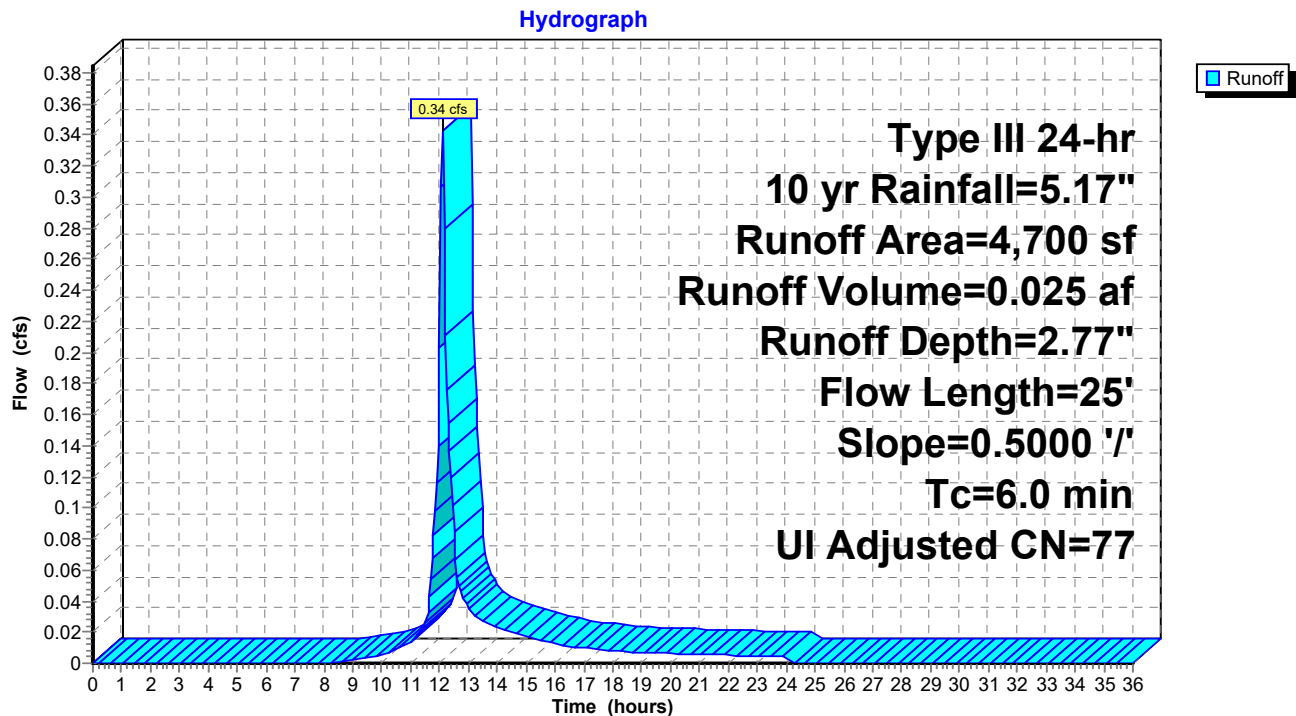

Summary for Subcatchment PR-5A: BB 01 A


Runoff = 1.56 cfs @ 12.27 hrs, Volume= 0.165 af, Depth= 3.53"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10 yr Rainfall=5.17"

Area (sf)	CN	Description
* 24,500	85	SYNTHETIC TURF- PAD- LINER
24,500		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
18.2	46	0.0067	0.04		Sheet Flow, Through Turf Section Grass: Bermuda n= 0.410 P2= 3.20"
1.7	47	0.0001	0.45	0.16	Pipe Channel, TRENCH DRAIN LEVEL 8.0" Round Area= 0.3 sf Perim= 2.1' r= 0.17' n= 0.010
19.9	93	Total			

Subcatchment PR-5A: BB 01 A

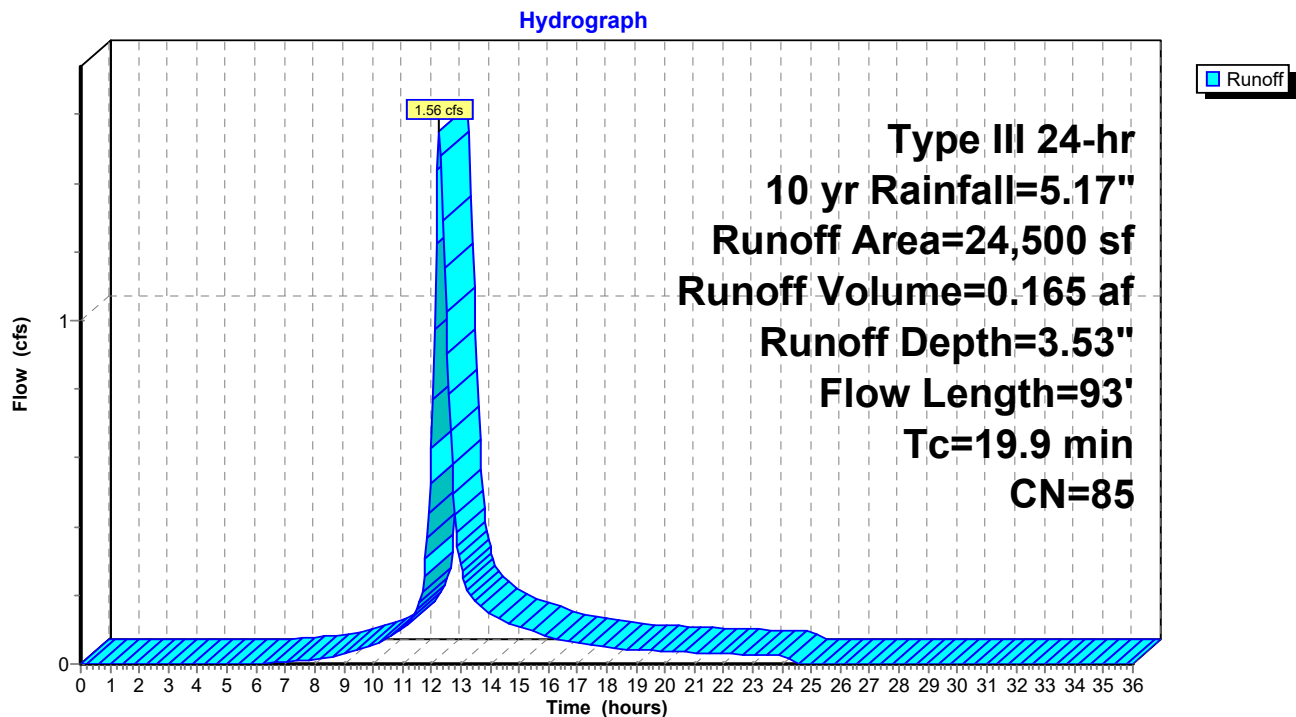

Summary for Subcatchment PR-5B: BB 11 A


Runoff = 2.55 cfs @ 12.87 hrs, Volume= 0.494 af, Depth= 3.53"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10 yr Rainfall=5.17"

Area (sf)	CN	Description
* 73,200	85	SYNTHETIC TURF- PAD- LINER
73,200		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
22.1	53	0.0055	0.04		Sheet Flow, Through Turf Section Grass: Bermuda n= 0.410 P2= 3.20"
43.1	150	0.0083	0.06		Sheet Flow, SYNTHETIC TURF Grass: Bermuda n= 0.410 P2= 3.20"
1.7	47	0.0001	0.45	0.16	Pipe Channel, TRENCH DRAIN LEVEL 8.0" Round Area= 0.3 sf Perim= 2.1' r= 0.17' n= 0.010
66.9	250	Total			

Subcatchment PR-5B: BB 11 A

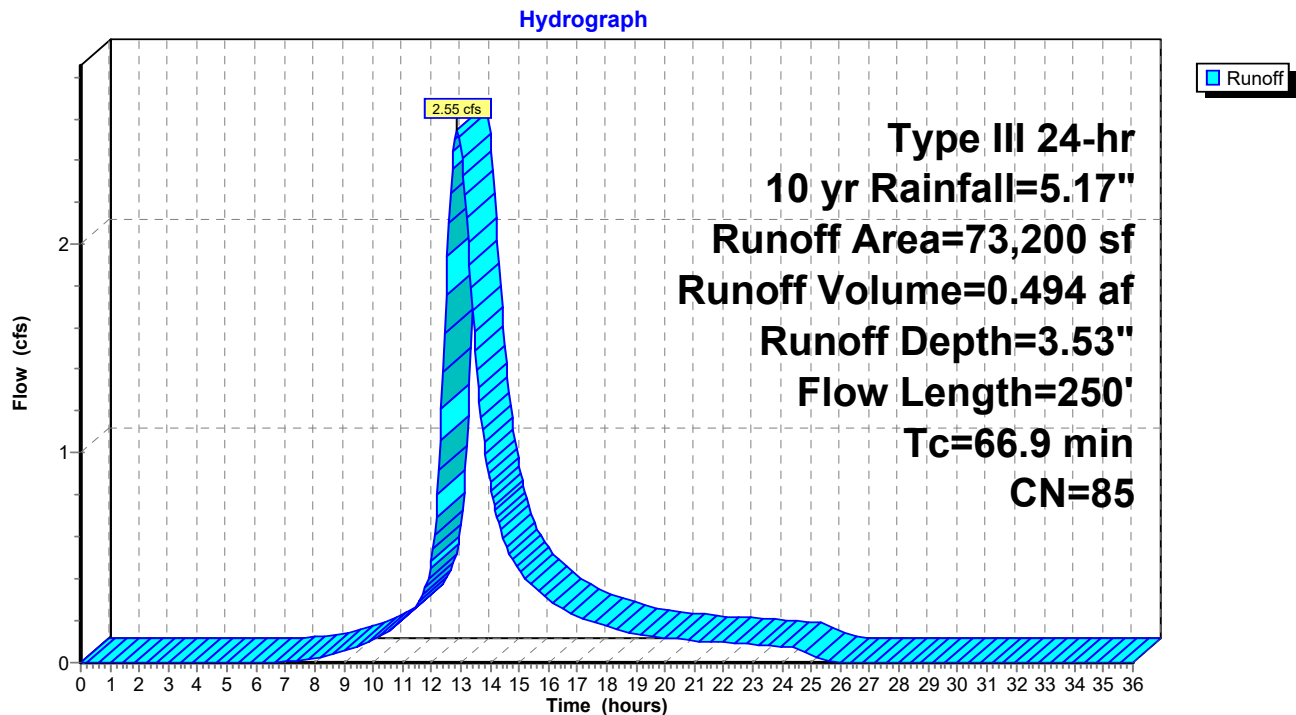


Summary for Subcatchment PR-5C: SLOPE

Runoff = 0.53 cfs @ 12.00 hrs, Volume= 0.033 af, Depth= 2.59"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10 yr Rainfall=5.17"

Area (sf)	CN	Adj	Description
600	98		Unconnected roofs, HSG C
6,000	74		>75% Grass cover, Good, HSG C
6,600	76	75	Weighted Average, UI Adjusted
6,000			90.91% Pervious Area
600			9.09% Impervious Area
600			100.00% Unconnected

Subcatchment PR-5C: SLOPE

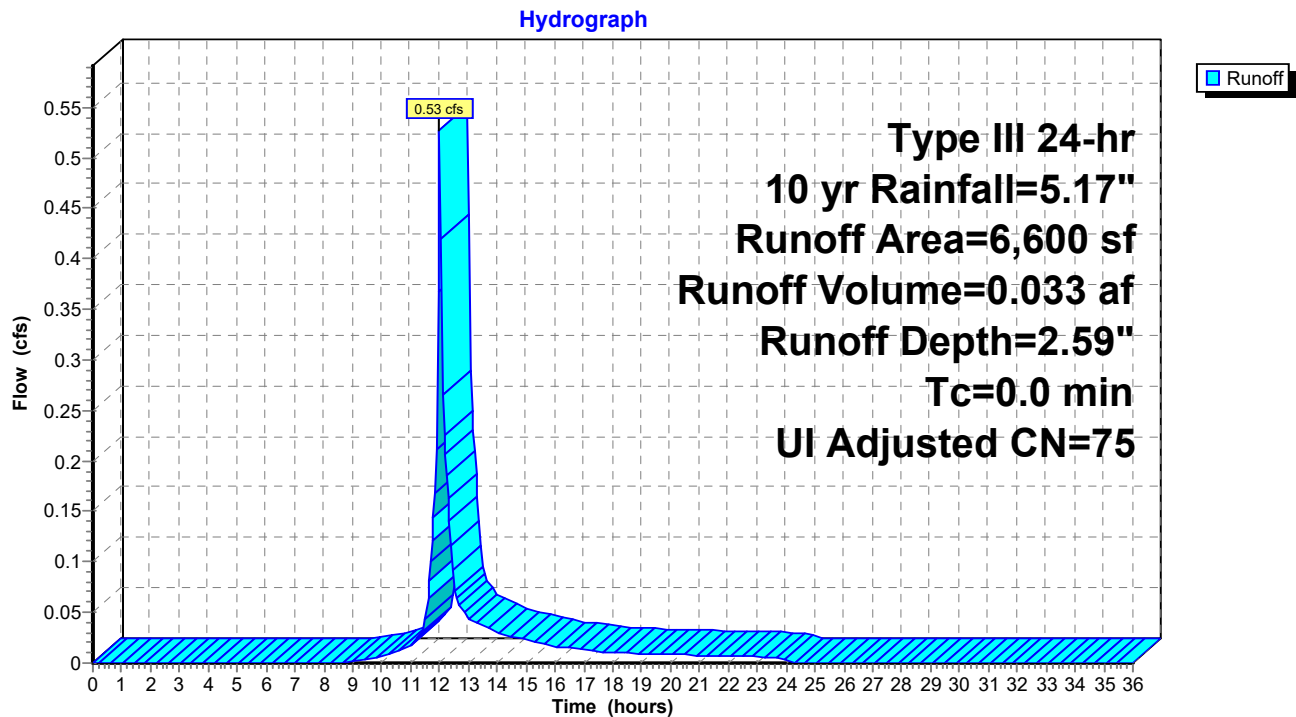

Summary for Pond 2P: rain garden#2 cascading

Inflow Area = 0.966 ac, 61.39% Impervious, Inflow Depth > 3.33" for 10 yr event
 Inflow = 3.72 cfs @ 12.09 hrs, Volume= 0.268 af
 Outflow = 3.71 cfs @ 12.10 hrs, Volume= 0.251 af, Atten= 0%, Lag= 0.5 min
 Primary = 0.03 cfs @ 12.10 hrs, Volume= 0.047 af
 Secondary = 3.69 cfs @ 12.10 hrs, Volume= 0.204 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 54.65' @ 12.10 hrs Surf.Area= 1,107 sf Storage= 1,363 cf
 Flood Elev= 55.00' Surf.Area= 1,326 sf Storage= 1,784 cf

Plug-Flow detention time= 109.2 min calculated for 0.251 af (94% of inflow)
 Center-of-Mass det. time= 61.3 min (913.4 - 852.0)

Volume	Invert	Avail.Storage	Storage Description
#1	51.00'	1,557 cf	Rain Garden Envelope (Prismatic) Listed below (Recalc) 2,357 cf Overall - 800 cf Embedded = 1,557 cf
#2	51.00'	80 cf	crush stone (Prismatic) Listed below (Recalc) Inside #1 200 cf Overall x 40.0% Voids
#3	51.50'	133 cf	Bio Media (Prismatic) Listed below (Recalc) Inside #1 532 cf Overall x 25.0% Voids
#4	52.83'	14 cf	Mulch (Prismatic) Listed below (Recalc) Inside #1 68 cf Overall x 20.0% Voids
1,784 cf			Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
51.00	400	0	0
53.00	400	800	800
54.00	694	547	1,347
55.00	1,326	1,010	2,357

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
51.00	400	0	0
51.50	400	200	200

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
51.50	400	0	0
52.83	400	532	532

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
52.83	400	0	0
53.00	400	68	68

17211.00 Arlington HS - Proposed Conditions - NOI Resubtype III 24-hr 10 yr Rainfall=5.17"

Prepared by Samiotes Engineering

Printed 5/28/2020

HydroCAD® 10.00-24 s/n 03575 © 2018 HydroCAD Software Solutions LLC

Page 66

Device	Routing	Invert	Outlet Devices
#1	Device 3	51.00'	1.020 in/hr Exfiltration over Surface area
#2	Secondary	54.50'	25.0' long x 3.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 Coef. (English) 2.44 2.58 2.68 2.67 2.65 2.64 2.64 2.68 2.68 2.72 2.81 2.92 2.97 3.07 3.32
#3	Primary	51.00'	12.0" Round Culvert L= 25.0' Ke= 0.500 Inlet / Outlet Invert= 51.00' / 50.88' S= 0.0048 ' / Cc= 0.900 n= 0.012, Flow Area= 0.79 sf

Primary OutFlow Max=0.03 cfs @ 12.10 hrs HW=54.65' TW=49.97' (Dynamic Tailwater)


↑ **3=Culvert** (Passes 0.03 cfs of 6.71 cfs potential flow)

↑ **1=Exfiltration** (Exfiltration Controls 0.03 cfs)

Secondary OutFlow Max=3.65 cfs @ 12.10 hrs HW=54.65' TW=49.97' (Dynamic Tailwater)

↑ **2=Broad-Crested Rectangular Weir** (Weir Controls 3.65 cfs @ 0.95 fps)

Pond 2P: rain garden#2 cascading

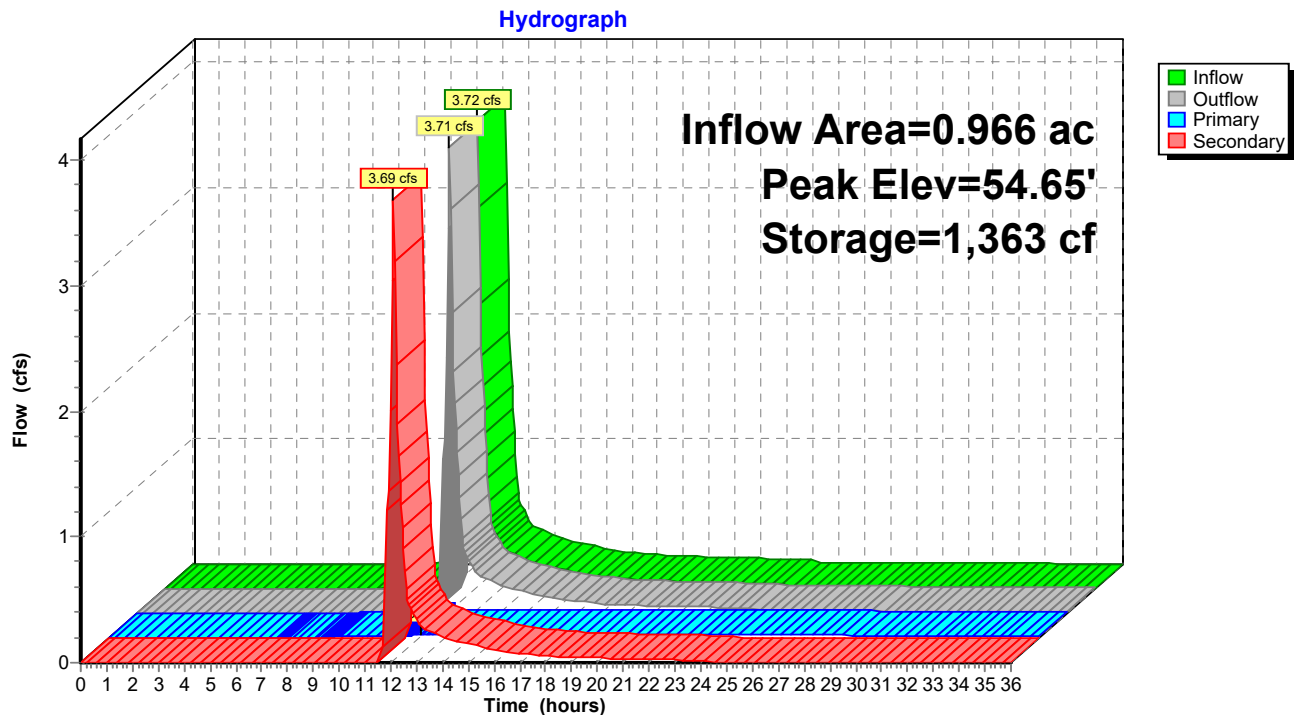

Summary for Pond 3P: rain garden#3 cascading

Inflow Area = 1.152 ac, 51.48% Impervious, Inflow Depth > 2.86" for 10 yr event
 Inflow = 4.00 cfs @ 12.10 hrs, Volume= 0.274 af
 Outflow = 3.80 cfs @ 12.17 hrs, Volume= 0.233 af, Atten= 5%, Lag= 3.8 min
 Primary = 3.80 cfs @ 12.17 hrs, Volume= 0.233 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 50.22' @ 12.17 hrs Surf.Area= 1,517 sf Storage= 2,605 cf
 Flood Elev= 50.00' Surf.Area= 1,373 sf Storage= 2,283 cf

Plug-Flow detention time= 197.8 min calculated for 0.233 af (85% of inflow)
 Center-of-Mass det. time= 88.1 min (997.8 - 909.8)

Volume	Invert	Avail.Storage	Storage Description
#1	46.00'	2,710 cf	Rain Garden Envelope (Prismatic) Listed below (Recalc) 3,911 cf Overall - 1,200 cf Embedded = 2,710 cf
#2	46.00'	120 cf	crush stone (Prismatic) Listed below (Recalc) Inside #1 300 cf Overall x 40.0% Voids
#3	46.50'	199 cf	Bio Media (Prismatic) Listed below (Recalc) Inside #1 798 cf Overall x 25.0% Voids
#4	47.83'	20 cf	Mulch (Prismatic) Listed below (Recalc) Inside #1 102 cf Overall x 20.0% Voids
3,050 cf			Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
46.00	600	0	0
48.00	600	1,200	1,200
49.00	957	779	1,979
50.00	1,373	1,165	3,144
50.50	1,695	767	3,911

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
46.00	600	0	0
46.50	600	300	300

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
46.50	600	0	0
47.83	600	798	798


Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
47.83	600	0	0
48.00	600	102	102

Device	Routing	Invert	Outlet Devices
#1	Device 3	46.00'	1.020 in/hr Exfiltration over Surface area
#2	Device 3	50.00'	24.0" x 48.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#3	Primary	46.00'	15.0" Round Culvert L= 26.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 46.00' / 45.87' S= 0.0050 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

Primary OutFlow Max=3.33 cfs @ 12.17 hrs HW=50.19' TW=0.00' (Dynamic Tailwater)

- 3=Culvert (Passes 3.33 cfs of 8.81 cfs potential flow)
- 1=Exfiltration (Exfiltration Controls 0.04 cfs)
- 2=Orifice/Grate (Weir Controls 3.29 cfs @ 1.43 fps)

Pond 3P: rain garden#3 cascading

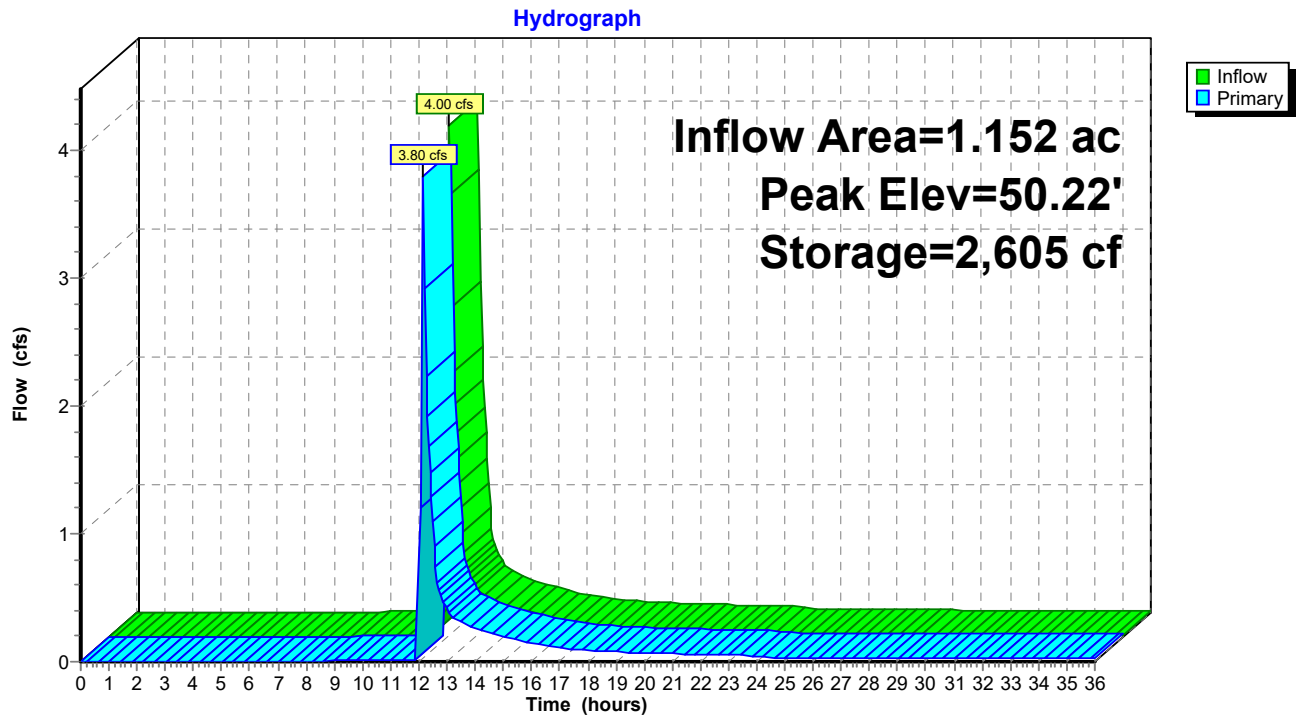

Summary for Pond 4P: UGS-1

Inflow Area = 1.705 ac, 60.59% Impervious, Inflow Depth = 3.42" for 10 yr event
 Inflow = 6.48 cfs @ 12.09 hrs, Volume= 0.485 af
 Outflow = 6.85 cfs @ 12.11 hrs, Volume= 0.448 af, Atten= 0%, Lag= 1.0 min
 Discarded = 0.04 cfs @ 8.55 hrs, Volume= 0.100 af
 Primary = 6.81 cfs @ 12.11 hrs, Volume= 0.347 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 43.93' @ 12.11 hrs Surf.Area= 1,672 sf Storage= 4,668 cf

Plug-Flow detention time= (not calculated: outflow precedes inflow)
 Center-of-Mass det. time= 118.5 min (920.4 - 801.9)

Volume	Invert	Avail.Storage	Storage Description
#1A	39.50'	2,099 cf	29.92'W x 55.89'L x 5.50'H Field A 9,196 cf Overall - 3,198 cf Embedded = 5,998 cf x 35.0% Voids
#2A	40.25'	3,198 cf	ADS_StormTech MC-3500 d +Cap x 28 Inside #1 Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap 28 Chambers in 4 Rows Cap Storage= +14.9 cf x 2 x 4 rows = 119.2 cf
		5,297 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	39.25'	24.0" Round Culvert L= 50.0' Ke= 0.500 Inlet / Outlet Invert= 39.25' / 38.75' S= 0.0100 ' / Cc= 0.900 n= 0.012, Flow Area= 3.14 sf
#2	Device 1	43.67'	5.0' long x 4.00' rise Sharp-Crested Rectangular Weir 2 End Contraction(s)
#3	Discarded	39.50'	1.020 in/hr Exfiltration over Surface area
#4	Device 1	42.42'	9.0" Vert. Orifice/Grate X 3 rows with 6.0" cc spacing C= 0.600

Discarded OutFlow Max=0.04 cfs @ 8.55 hrs HW=39.58' (Free Discharge)
 ↑ **3=Exfiltration** (Exfiltration Controls 0.04 cfs)

Primary OutFlow Max=6.56 cfs @ 12.11 hrs HW=43.91' TW=0.00' (Dynamic Tailwater)
 ↑ **1=Culvert** (Passes 6.56 cfs of 28.94 cfs potential flow)
 ↑ **2=Sharp-Crested Rectangular Weir** (Weir Controls 1.91 cfs @ 1.60 fps)
 ↑ **4=Orifice/Grate** (Orifice Controls 4.65 cfs @ 3.90 fps)

Pond 4P: UGS-1 - Chamber Wizard Field A

Chamber Model = ADS_StormTechMC-3500 d +Cap (ADS StormTech®MC-3500 d rev 03/14 with Cap volume)

Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf

Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap

Cap Storage= +14.9 cf x 2 x 4 rows = 119.2 cf

77.0" Wide + 9.0" Spacing = 86.0" C-C Row Spacing

7 Chambers/Row x 7.17' Long +1.85' Cap Length x 2 = 53.89' Row Length +12.0" End Stone x 2 = 55.89' Base Length

4 Rows x 77.0" Wide + 9.0" Spacing x 3 + 12.0" Side Stone x 2 = 29.92' Base Width

9.0" Base + 45.0" Chamber Height + 12.0" Cover = 5.50' Field Height

28 Chambers x 110.0 cf + 14.9 cf Cap Volume x 2 x 4 Rows = 3,197.9 cf Chamber Storage

9,196.2 cf Field - 3,197.9 cf Chambers = 5,998.4 cf Stone x 35.0% Voids = 2,099.4 cf Stone Storage

Chamber Storage + Stone Storage = 5,297.3 cf = 0.122 af



Overall Storage Efficiency = 57.6%

Overall System Size = 55.89' x 29.92' x 5.50'


28 Chambers

340.6 cy Field

222.2 cy Stone

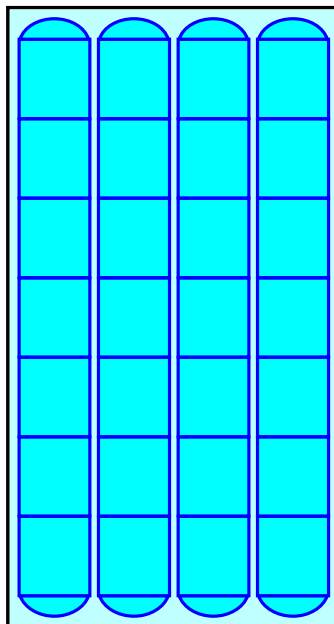

Pond 4P: UGS-1

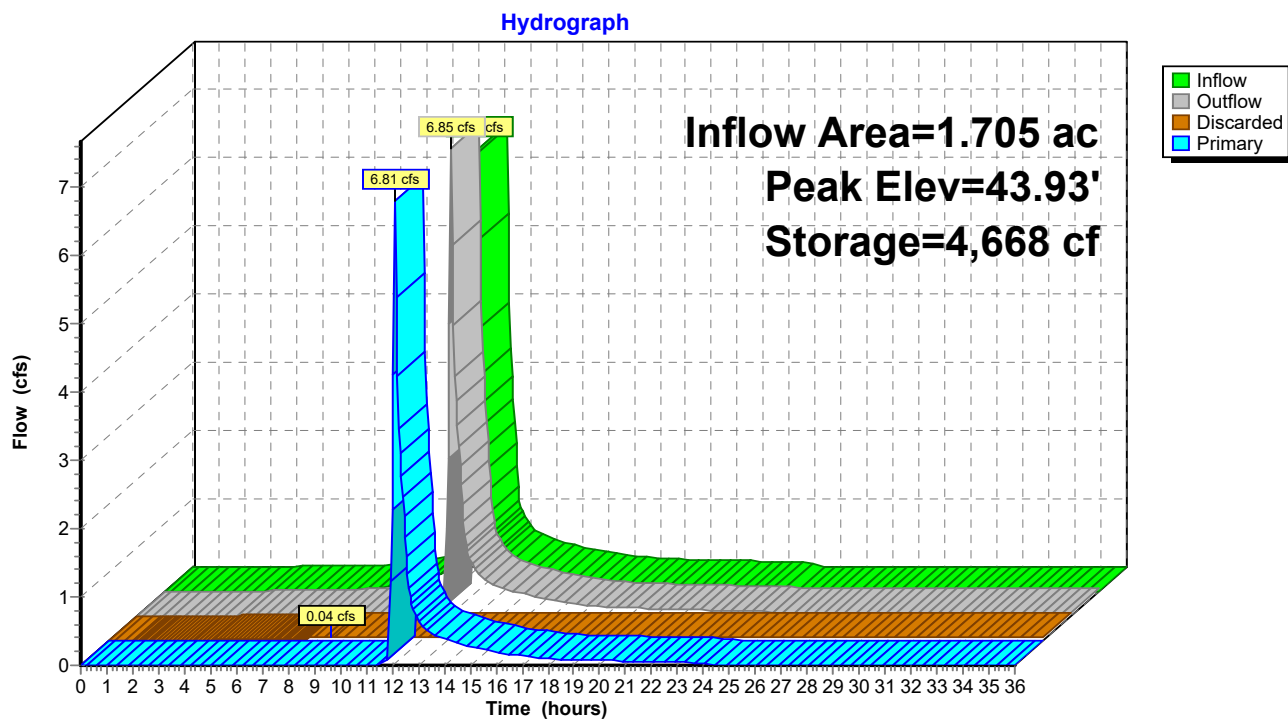

Summary for Pond 5P: rain garden#1 cascading

Inflow Area = 0.725 ac, 65.66% Impervious, Inflow Depth = 3.53" for 10 yr event
 Inflow = 2.90 cfs @ 12.09 hrs, Volume= 0.213 af
 Outflow = 2.91 cfs @ 12.10 hrs, Volume= 0.209 af, Atten= 0%, Lag= 0.3 min
 Primary = 0.01 cfs @ 12.10 hrs, Volume= 0.024 af
 Secondary = 2.89 cfs @ 12.10 hrs, Volume= 0.185 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 62.13' @ 12.10 hrs Surf.Area= 524 sf Storage= 618 cf
 Flood Elev= 63.00' Surf.Area= 660 sf Storage= 1,132 cf

Plug-Flow detention time= 65.7 min calculated for 0.209 af (98% of inflow)
 Center-of-Mass det. time= 54.0 min (860.3 - 806.2)

Volume	Invert	Avail.Storage	Storage Description
#1	58.50'	1,048 cf	Rain Garden Envelope (Prismatic) Listed below (Recalc) 1,348 cf Overall - 300 cf Embedded = 1,048 cf
#2	58.50'	30 cf	crush stone (Prismatic) Listed below (Recalc) Inside #1 75 cf Overall x 40.0% Voids
#3	59.00'	50 cf	Bio Media (Prismatic) Listed below (Recalc) Inside #1 199 cf Overall x 25.0% Voids
#4	60.33'	5 cf	Mulch (Prismatic) Listed below (Recalc) Inside #1 26 cf Overall x 20.0% Voids
1,132 cf			Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
58.50	150	0	0
60.50	150	300	300
61.00	236	97	397
62.00	503	370	766
63.00	660	582	1,348

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
58.50	150	0	0
59.00	150	75	75

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
59.00	150	0	0
60.33	150	199	199

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
60.33	150	0	0
60.50	150	26	26

17211.00 Arlington HS - Proposed Conditions - NOI Res~~ult~~ Type III 24-hr 10 yr Rainfall=5.17"

Prepared by Samiotes Engineering

Printed 5/28/2020

HydroCAD® 10.00-24 s/n 03575 © 2018 HydroCAD Software Solutions LLC

Page 73

Device	Routing	Invert	Outlet Devices
#1	Device 3	58.50'	1.020 in/hr Exfiltration over Surface area
#2	Secondary	62.00'	25.0' long x 3.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 Coef. (English) 2.44 2.58 2.68 2.67 2.65 2.64 2.64 2.68 2.68 2.72 2.81 2.92 2.97 3.07 3.32
#3	Primary	58.50'	8.0" Round Culvert L= 20.0' Ke= 0.500 Inlet / Outlet Invert= 58.50' / 58.40' S= 0.0050 '/' Cc= 0.900 n= 0.012, Flow Area= 0.35 sf

Primary OutFlow Max=0.01 cfs @ 12.10 hrs HW=62.13' TW=54.65' (Dynamic Tailwater)


↑ **3=Culvert** (Passes 0.01 cfs of 3.05 cfs potential flow)

↑ **1=Exfiltration** (Exfiltration Controls 0.01 cfs)

Secondary OutFlow Max=2.86 cfs @ 12.10 hrs HW=62.13' TW=54.65' (Dynamic Tailwater)

↑ **2=Broad-Crested Rectangular Weir** (Weir Controls 2.86 cfs @ 0.88 fps)

Pond 5P: rain garden#1 cascading

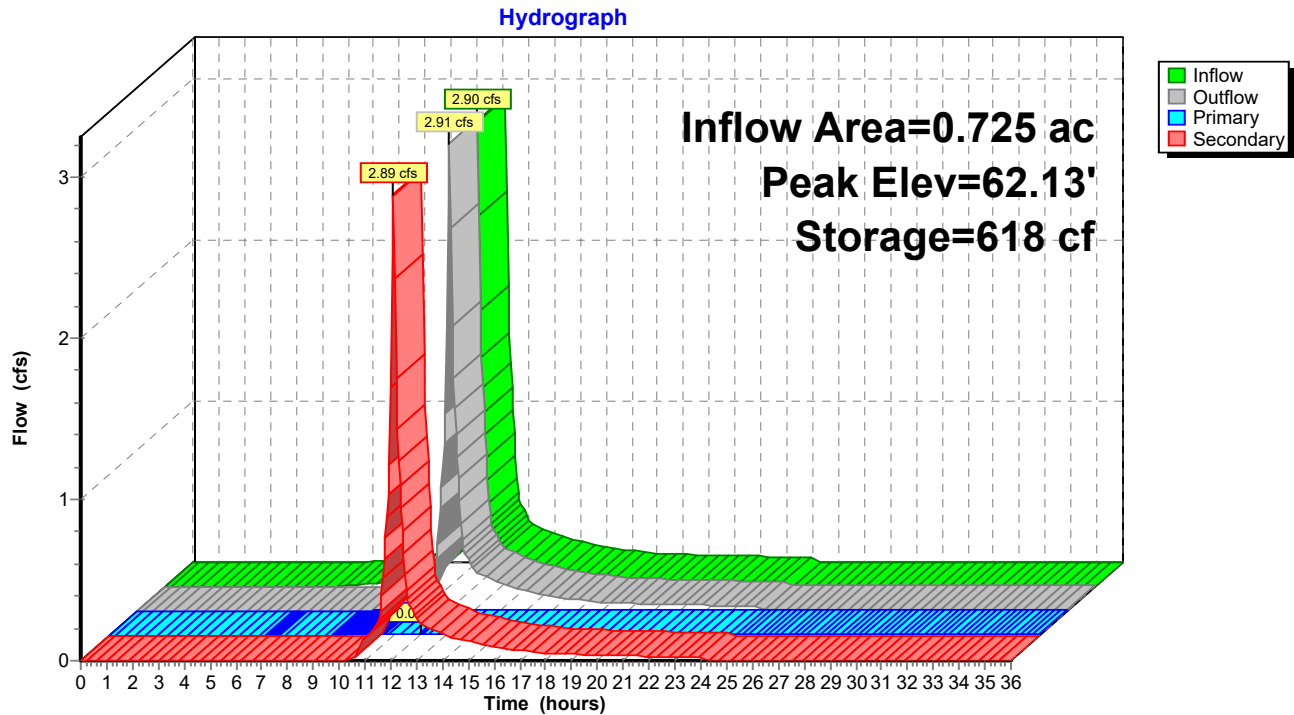

Summary for Pond BB 01 B: BB 01 B


Inflow Area = 0.714 ac, 1.93% Impervious, Inflow Depth = 3.33" for 10 yr event
 Inflow = 1.73 cfs @ 12.26 hrs, Volume= 0.198 af
 Outflow = 1.73 cfs @ 12.26 hrs, Volume= 0.198 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.73 cfs @ 12.26 hrs, Volume= 0.198 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 48.48' @ 12.26 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	47.63'	12.0" Round Culvert L= 5.0' CMP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 47.63' / 47.58' S= 0.0100 '/ Cc= 0.900 n= 0.010, Flow Area= 0.79 sf

Primary OutFlow Max=1.72 cfs @ 12.26 hrs HW=48.48' TW=46.74' (Dynamic Tailwater)
 1=Culvert (Barrel Controls 1.72 cfs @ 3.27 fps)

Pond BB 01 B: BB 01 B

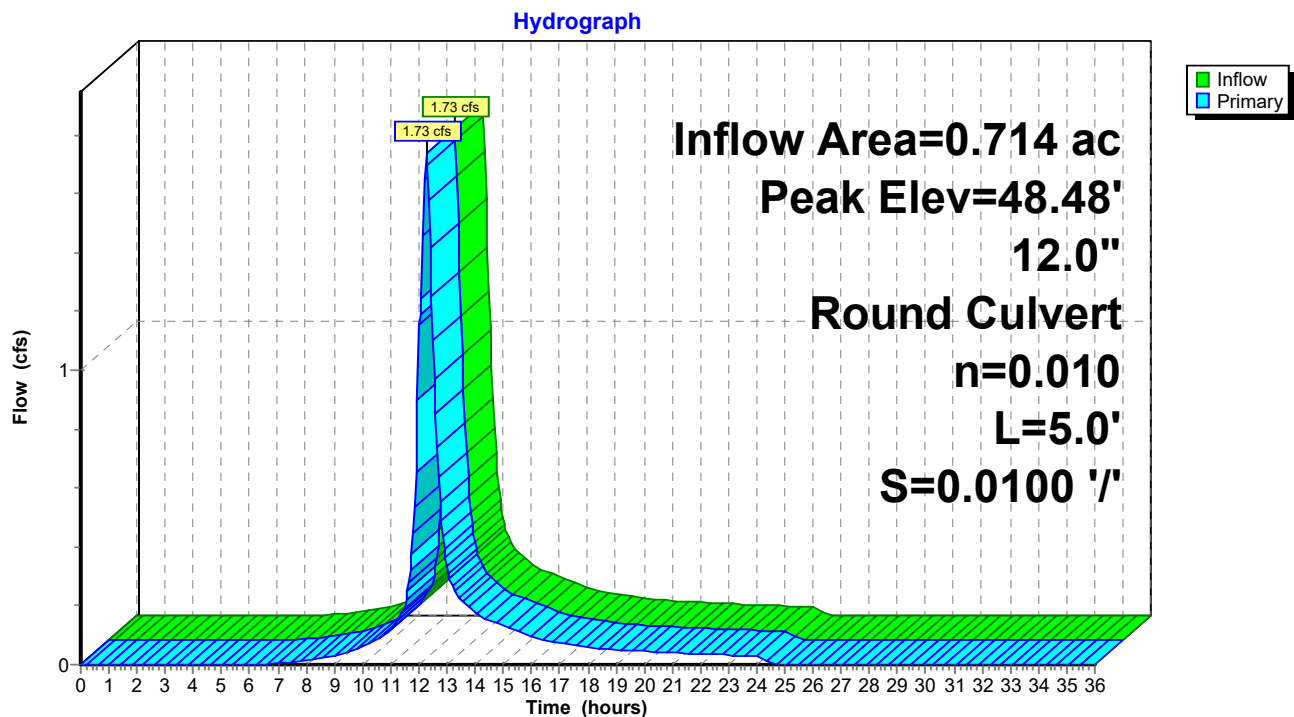

Summary for Pond BB 01 S: BB 01 S

Inflow Area = 0.714 ac, 1.93% Impervious, Inflow Depth = 3.33" for 10 yr event
 Inflow = 1.73 cfs @ 12.26 hrs, Volume= 0.198 af
 Outflow = 0.20 cfs @ 13.66 hrs, Volume= 0.198 af, Atten= 88%, Lag= 84.0 min
 Primary = 0.20 cfs @ 13.66 hrs, Volume= 0.198 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 47.04' @ 13.66 hrs Surf.Area= 0 sf Storage= 3,792 cf

Plug-Flow detention time= 194.0 min calculated for 0.198 af (100% of inflow)
 Center-of-Mass det. time= 193.6 min (1,014.1 - 820.5)


Volume	Invert	Avail.Storage	Storage Description
#1	45.65'	8,017 cf	Custom Stage Data Listed below

Elevation (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
45.65	0	0
46.48	16	16
46.98	3,378	3,394
47.48	3,405	6,799
47.98	1,218	8,017

Device	Routing	Invert	Outlet Devices
#1	Primary	45.65'	2.5" Vert. Orifice/Grate C= 0.600
#2	Primary	46.98'	4.0" Vert. Orifice/Grate C= 0.600
#3	Primary	46.98'	5.0" Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=0.20 cfs @ 13.66 hrs HW=47.04' TW=45.48' (Dynamic Tailwater)
 1=Orifice/Grate (Orifice Controls 0.19 cfs @ 5.46 fps)
 2=Orifice/Grate (Orifice Controls 0.01 cfs @ 0.82 fps)
 3=Orifice/Grate (Orifice Controls 0.01 cfs @ 0.82 fps)

Pond BB 01 S: BB 01 S

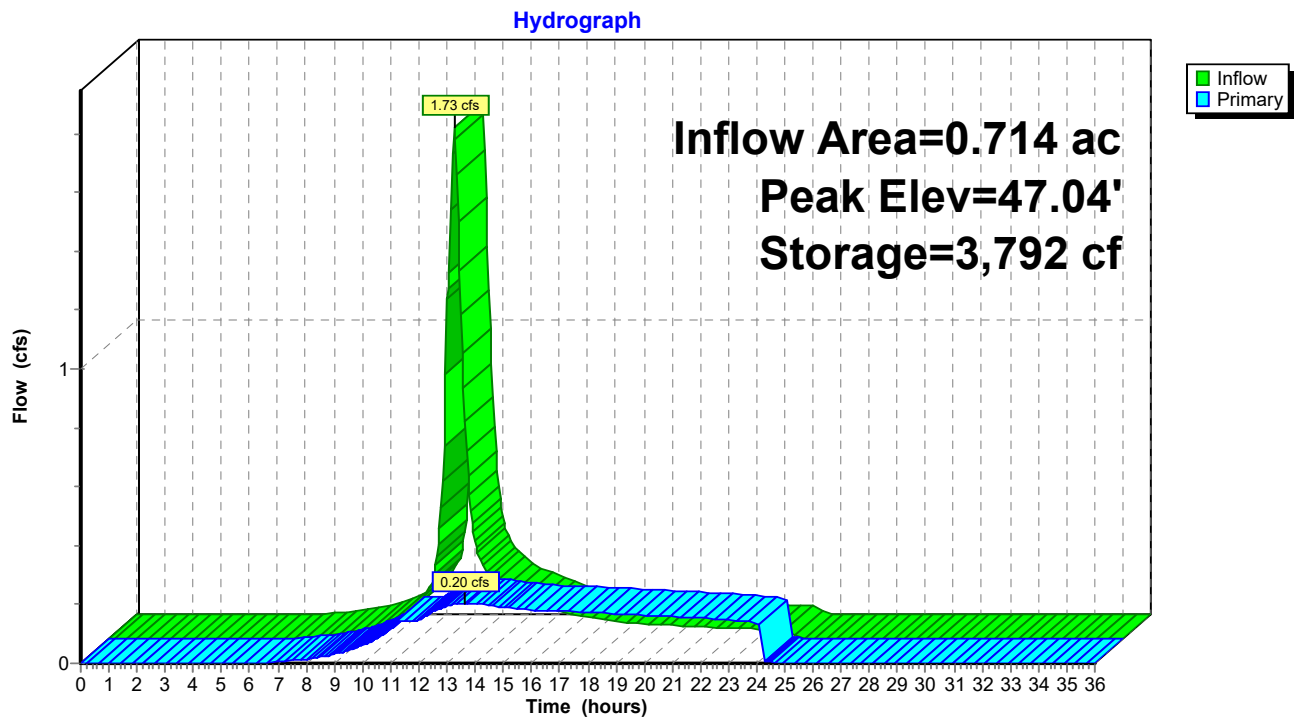

Summary for Pond BB 06 B: BB 06 B


Inflow Area = 0.714 ac, 1.93% Impervious, Inflow Depth = 3.33" for 10 yr event
 Inflow = 0.20 cfs @ 13.66 hrs, Volume= 0.198 af
 Outflow = 0.20 cfs @ 13.66 hrs, Volume= 0.198 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.20 cfs @ 13.66 hrs, Volume= 0.198 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 45.48' @ 13.66 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	45.25'	12.0" Round Culvert L= 112.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 45.25' / 44.69' S= 0.0050 '/ Cc= 0.900 n= 0.010, Flow Area= 0.79 sf

Primary OutFlow Max=0.20 cfs @ 13.66 hrs HW=45.48' TW=44.73' (Dynamic Tailwater)
 1=Culvert (Barrel Controls 0.20 cfs @ 2.23 fps)

Pond BB 06 B: BB 06 B

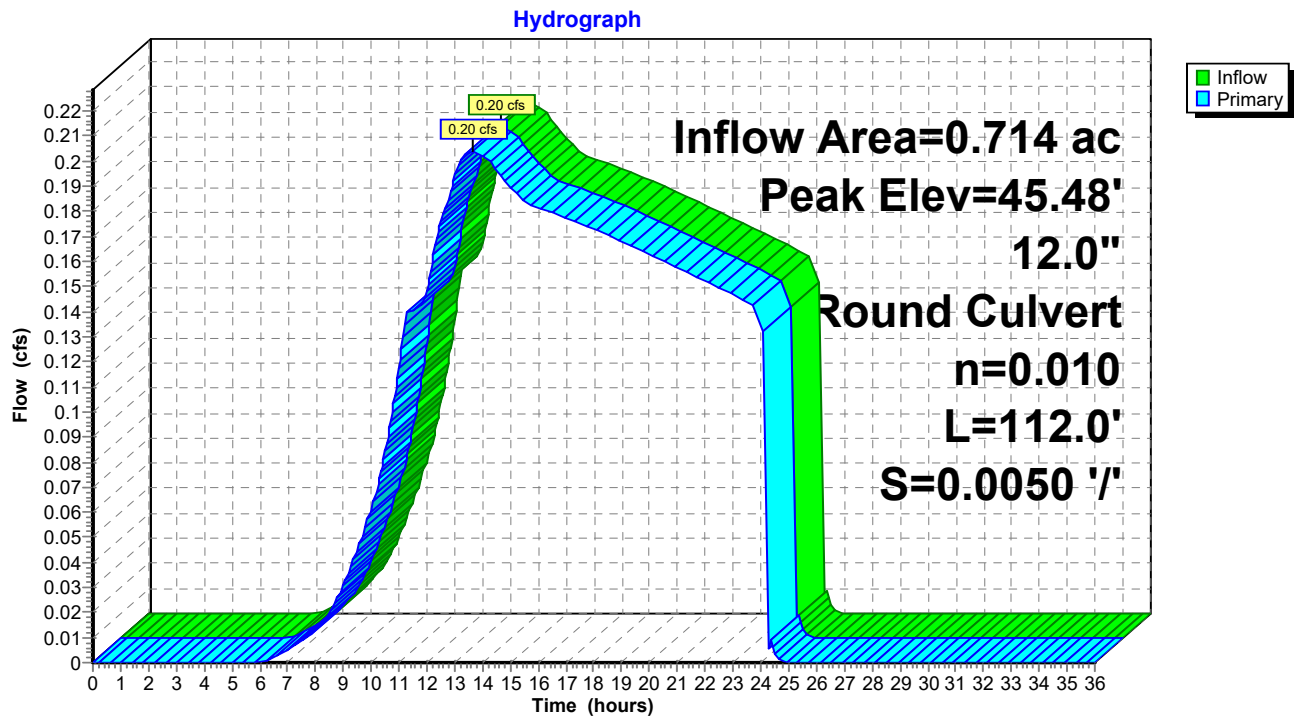

Summary for Pond BB 07 B: BB 07 B


Inflow Area = 0.714 ac, 1.93% Impervious, Inflow Depth = 3.33" for 10 yr event
 Inflow = 0.20 cfs @ 13.66 hrs, Volume= 0.198 af
 Outflow = 0.20 cfs @ 13.66 hrs, Volume= 0.198 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.20 cfs @ 13.66 hrs, Volume= 0.198 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 44.73' @ 13.55 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	44.50'	12.0" Round Culvert L= 88.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 44.50' / 44.06' S= 0.0050 '/ Cc= 0.900 n= 0.010, Flow Area= 0.79 sf

Primary OutFlow Max=0.20 cfs @ 13.66 hrs HW=44.73' TW=44.24' (Dynamic Tailwater)
 1=Culvert (Outlet Controls 0.20 cfs @ 2.20 fps)

Pond BB 07 B: BB 07 B

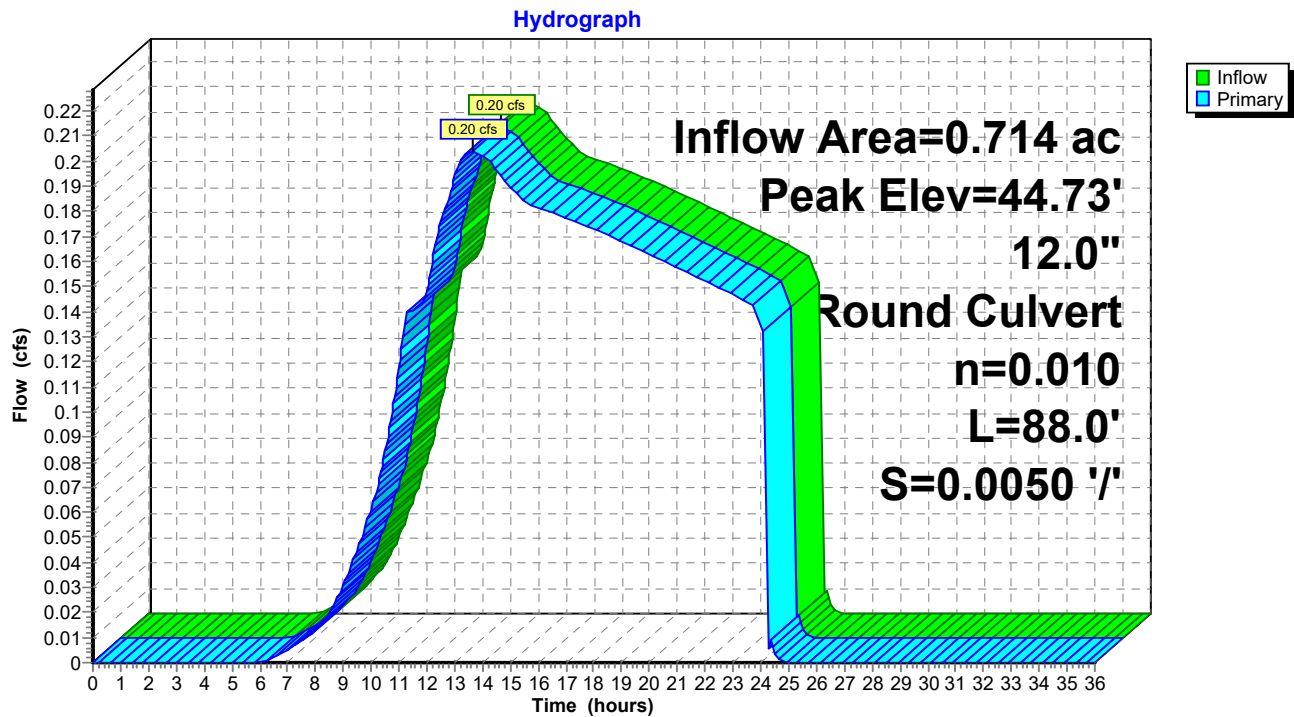

Summary for Pond BB 11 B: BB 11 B


Inflow Area = 1.680 ac, 0.00% Impervious, Inflow Depth = 3.53" for 10 yr event
 Inflow = 2.55 cfs @ 12.87 hrs, Volume= 0.494 af
 Outflow = 2.55 cfs @ 12.87 hrs, Volume= 0.494 af, Atten= 0%, Lag= 0.0 min
 Primary = 2.55 cfs @ 12.87 hrs, Volume= 0.494 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 46.36' @ 12.87 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	45.25'	12.0" Round Culvert L= 8.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 45.25' / 45.12' S= 0.0163 '/ Cc= 0.900 n= 0.020, Flow Area= 0.79 sf

Primary OutFlow Max=2.54 cfs @ 12.87 hrs HW=46.35' TW=45.28' (Dynamic Tailwater)
 1=Culvert (Barrel Controls 2.54 cfs @ 3.65 fps)

Pond BB 11 B: BB 11 B

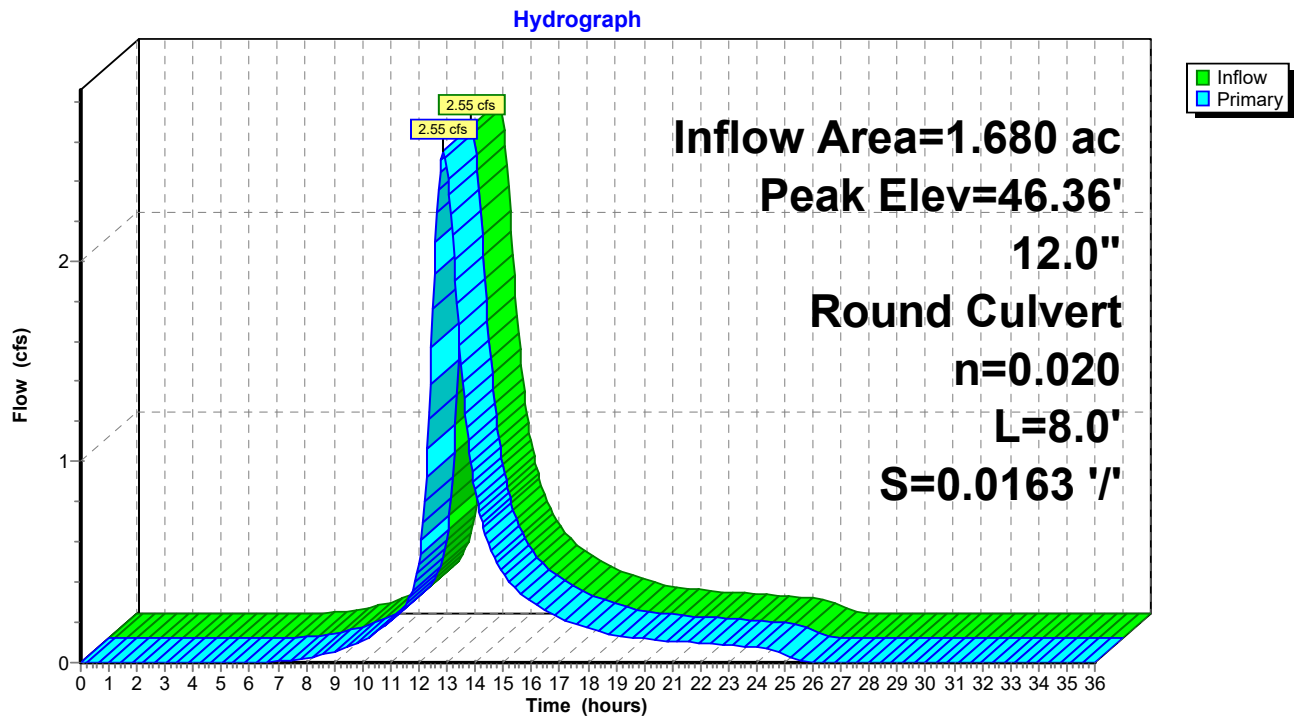

Summary for Pond BB 11 S: BB 11 S

Inflow Area = 1.680 ac, 0.00% Impervious, Inflow Depth = 3.53" for 10 yr event
 Inflow = 2.55 cfs @ 12.87 hrs, Volume= 0.494 af
 Outflow = 1.58 cfs @ 13.45 hrs, Volume= 0.494 af, Atten= 38%, Lag= 34.5 min
 Primary = 1.58 cfs @ 13.45 hrs, Volume= 0.494 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 45.49' @ 13.45 hrs Surf.Area= 0 sf Storage= 3,305 cf

Plug-Flow detention time= 15.1 min calculated for 0.493 af (100% of inflow)
 Center-of-Mass det. time= 15.1 min (877.7 - 862.7)


Volume	Invert	Avail.Storage	Storage Description
#1	44.14'	7,432 cf	Custom Stage Data Listed below

Elevation (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
44.14	0	0
44.97	16	16
45.47	3,131	3,147
45.97	3,156	6,303
46.47	1,129	7,432

Device	Routing	Invert	Outlet Devices
#1	Primary	44.14'	2.5" Vert. Orifice/Grate C= 0.600
#2	Primary	44.47'	8.0" Vert. Orifice/Grate C= 0.600
#3	Primary	45.47'	6.0" Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=1.58 cfs @ 13.45 hrs HW=45.49' TW=44.25' (Dynamic Tailwater)
 1=Orifice/Grate (Orifice Controls 0.18 cfs @ 5.38 fps)
 2=Orifice/Grate (Orifice Controls 1.40 cfs @ 4.00 fps)
 3=Orifice/Grate (Orifice Controls 0.00 cfs @ 0.54 fps)

Pond BB 11 S: BB 11 S

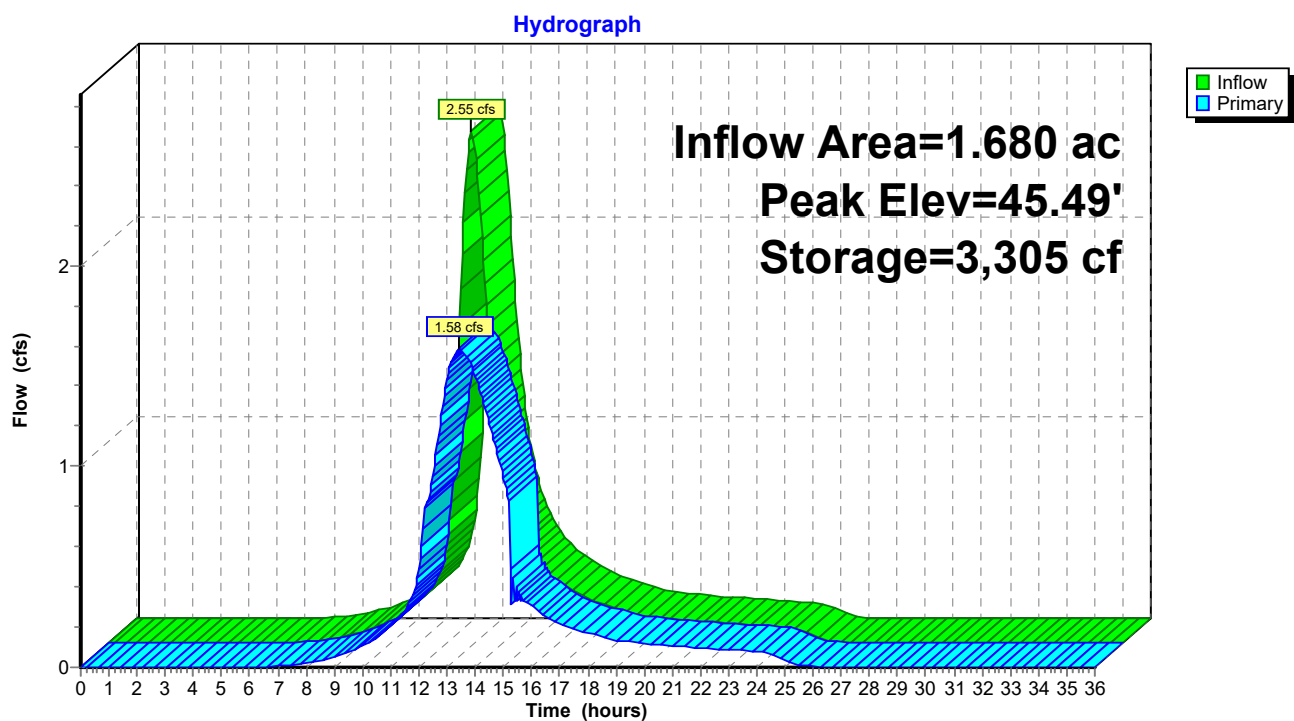

Summary for Pond PR-4: SB 01 DMH


Inflow Area = 1.921 ac, 1.31% Impervious, Inflow Depth = 3.48" for 10 yr event
 Inflow = 2.69 cfs @ 12.84 hrs, Volume= 0.558 af
 Outflow = 2.69 cfs @ 12.84 hrs, Volume= 0.558 af, Atten= 0%, Lag= 0.0 min
 Primary = 2.69 cfs @ 12.84 hrs, Volume= 0.558 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 49.31' @ 12.84 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	48.30'	12.0" Round Culvert L= 50.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 48.30' / 47.80' S= 0.0100 '/ Cc= 0.900 n= 0.010, Flow Area= 0.79 sf

Primary OutFlow Max=2.69 cfs @ 12.84 hrs HW=49.31' TW=0.00' (Dynamic Tailwater)
 1=Culvert (Inlet Controls 2.69 cfs @ 3.43 fps)

Pond PR-4: SB 01 DMH

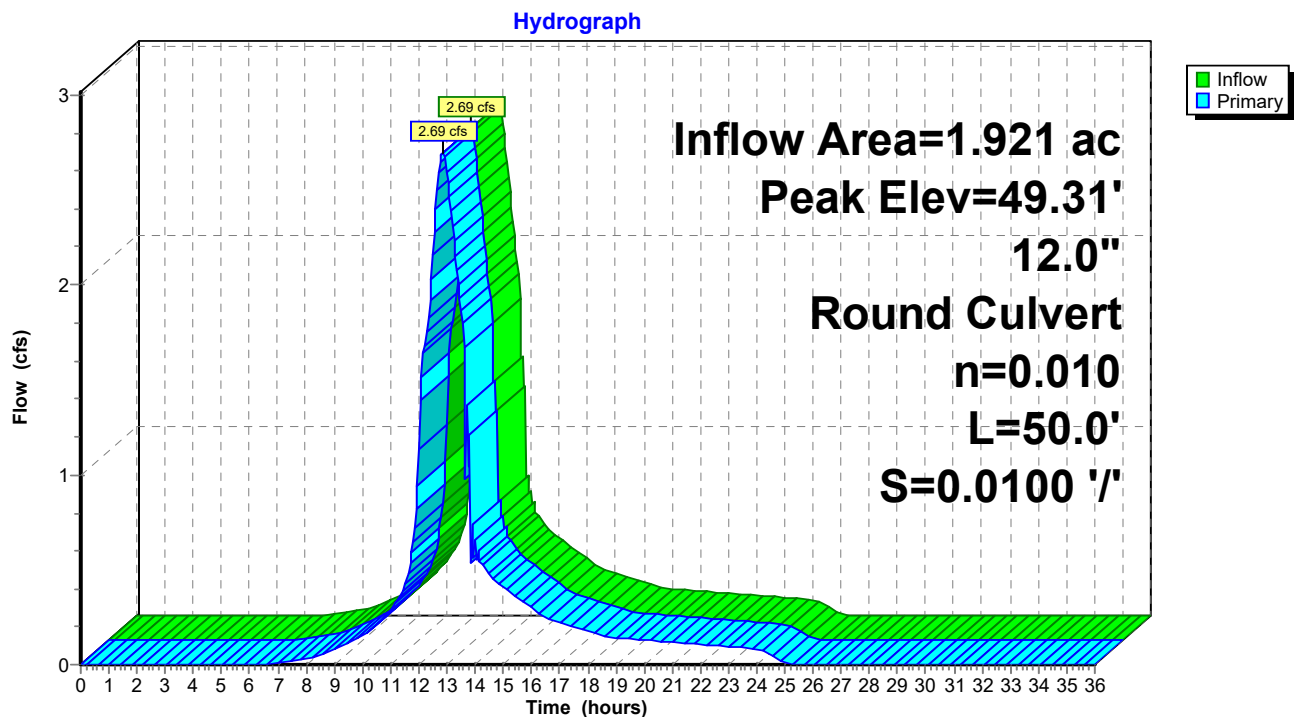

Summary for Pond PR-5: DMH 1


Inflow Area = 2.394 ac, 0.58% Impervious, Inflow Depth = 3.47" for 10 yr event
 Inflow = 1.79 cfs @ 13.45 hrs, Volume= 0.692 af
 Outflow = 1.79 cfs @ 13.45 hrs, Volume= 0.692 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.79 cfs @ 13.45 hrs, Volume= 0.692 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 44.25' @ 13.45 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	43.50'	15.0" Round Culvert L= 10.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 43.50' / 43.40' S= 0.0100 '/ Cc= 0.900 n= 0.010, Flow Area= 1.23 sf

Primary OutFlow Max=1.79 cfs @ 13.45 hrs HW=44.25' TW=0.00' (Dynamic Tailwater)
 1=Culvert (Barrel Controls 1.79 cfs @ 3.35 fps)

Pond PR-5: DMH 1

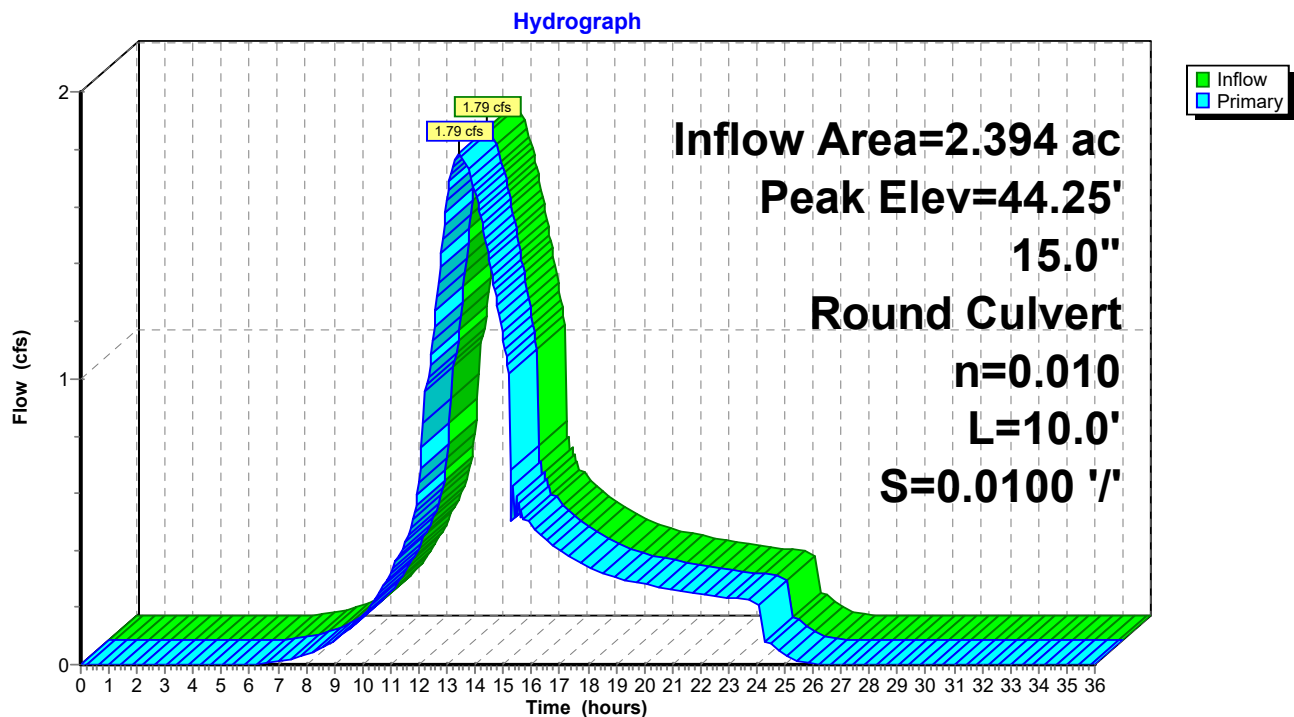

Summary for Pond SB 01 B: SB 01 B


Inflow Area = 1.049 ac, 2.41% Impervious, Inflow Depth = 3.45" for 10 yr event
 Inflow = 1.89 cfs @ 12.56 hrs, Volume= 0.301 af
 Outflow = 1.89 cfs @ 12.56 hrs, Volume= 0.301 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.89 cfs @ 12.56 hrs, Volume= 0.301 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 53.59' @ 12.56 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	52.00'	8.0" Round Culvert L= 8.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 52.00' / 51.92' S= 0.0100 '/ Cc= 0.900 n= 0.010, Flow Area= 0.35 sf

Primary OutFlow Max=1.88 cfs @ 12.56 hrs HW=53.59' TW=51.67' (Dynamic Tailwater)
 1=Culvert (Inlet Controls 1.88 cfs @ 5.39 fps)

Pond SB 01 B: SB 01 B

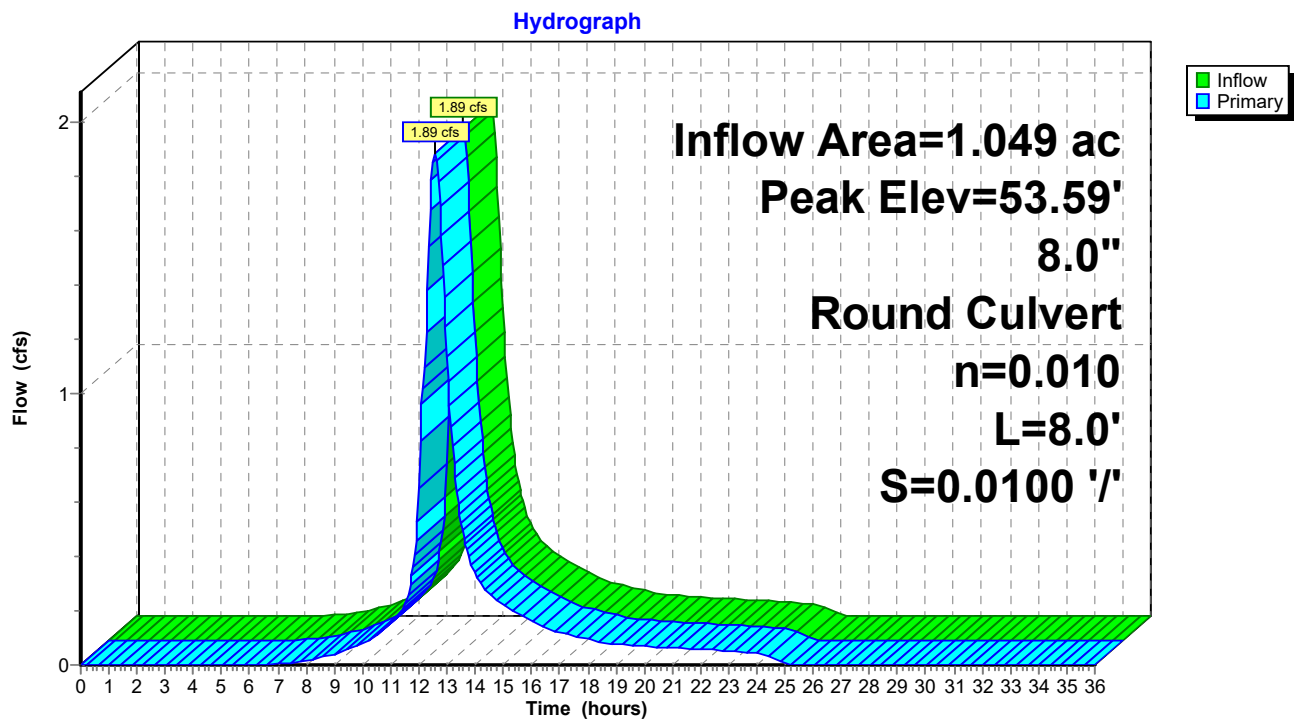

Summary for Pond SB 01 S: SB 01 S

Inflow Area = 1.049 ac, 2.41% Impervious, Inflow Depth = 3.45" for 10 yr event
 Inflow = 1.89 cfs @ 12.56 hrs, Volume= 0.301 af
 Outflow = 1.41 cfs @ 12.88 hrs, Volume= 0.301 af, Atten= 25%, Lag= 18.8 min
 Primary = 1.41 cfs @ 12.88 hrs, Volume= 0.301 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 51.77' @ 12.88 hrs Surf.Area= 0 sf Storage= 1,336 cf

Plug-Flow detention time= 6.5 min calculated for 0.301 af (100% of inflow)
 Center-of-Mass det. time= 6.1 min (845.8 - 839.8)

Volume	Invert	Avail.Storage	Storage Description
#1	50.64'	3,084 cf	Custom Stage Data Listed below


Elevation (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
50.64	0	0
51.47	16	16
51.97	2,170	2,186
52.47	898	3,084

Device	Routing	Invert	Outlet Devices
#1	Primary	50.64'	4.0" Vert. Orifice/Grate C= 0.600
#2	Primary	50.97'	6.0" Vert. Orifice/Grate C= 0.600
#3	Primary	51.47'	8.0" Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=1.41 cfs @ 12.88 hrs HW=51.77' TW=50.68' (Dynamic Tailwater)

1=Orifice/Grate (Orifice Controls 0.41 cfs @ 4.73 fps)
 2=Orifice/Grate (Orifice Controls 0.70 cfs @ 3.58 fps)
 3=Orifice/Grate (Orifice Controls 0.29 cfs @ 1.88 fps)

Pond SB 01 S: SB 01 S

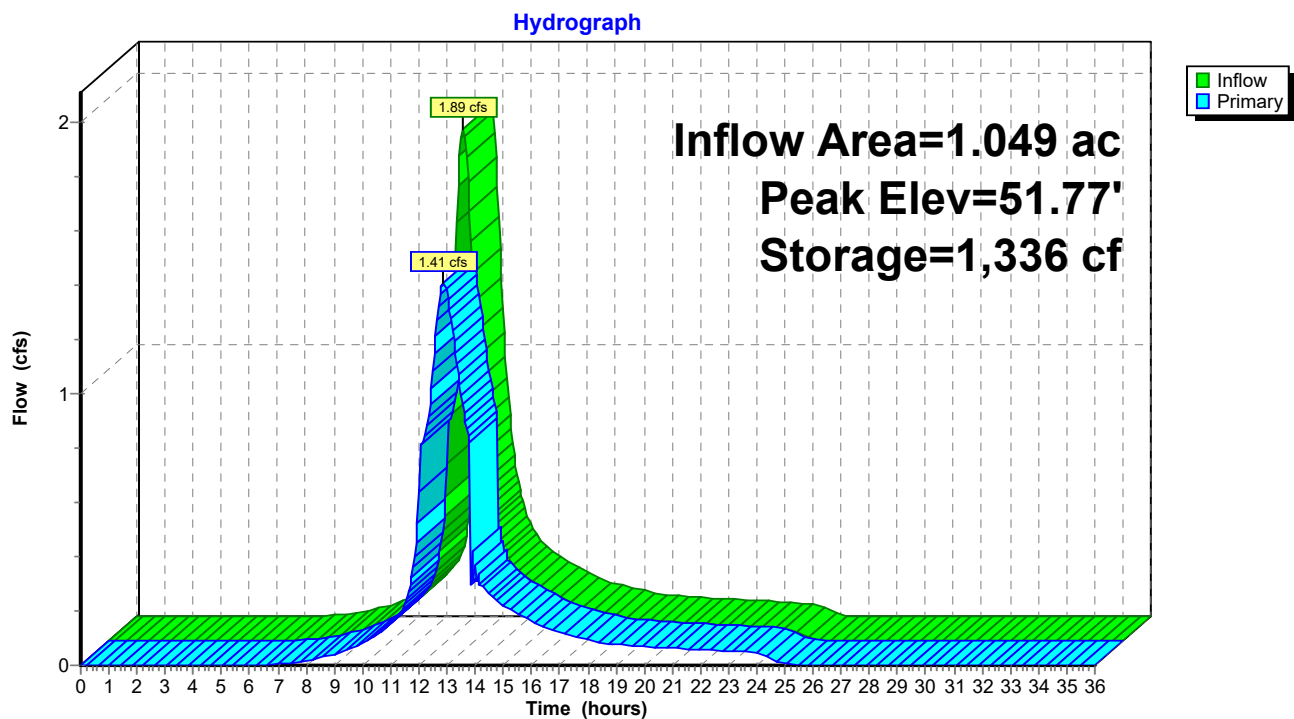

Summary for Pond SB 02 B: SB 02 B


Inflow Area = 1.049 ac, 2.41% Impervious, Inflow Depth = 3.45" for 10 yr event
 Inflow = 1.41 cfs @ 12.88 hrs, Volume= 0.301 af
 Outflow = 1.41 cfs @ 12.88 hrs, Volume= 0.301 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.41 cfs @ 12.88 hrs, Volume= 0.301 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 50.68' @ 12.88 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	49.97'	12.0" Round Culvert L= 12.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 49.97' / 49.85' S= 0.0100 '/ Cc= 0.900 n= 0.010, Flow Area= 0.79 sf

Primary OutFlow Max=1.41 cfs @ 12.88 hrs HW=50.68' TW=49.30' (Dynamic Tailwater)
 1=Culvert (Barrel Controls 1.41 cfs @ 3.34 fps)

Pond SB 02 B: SB 02 B

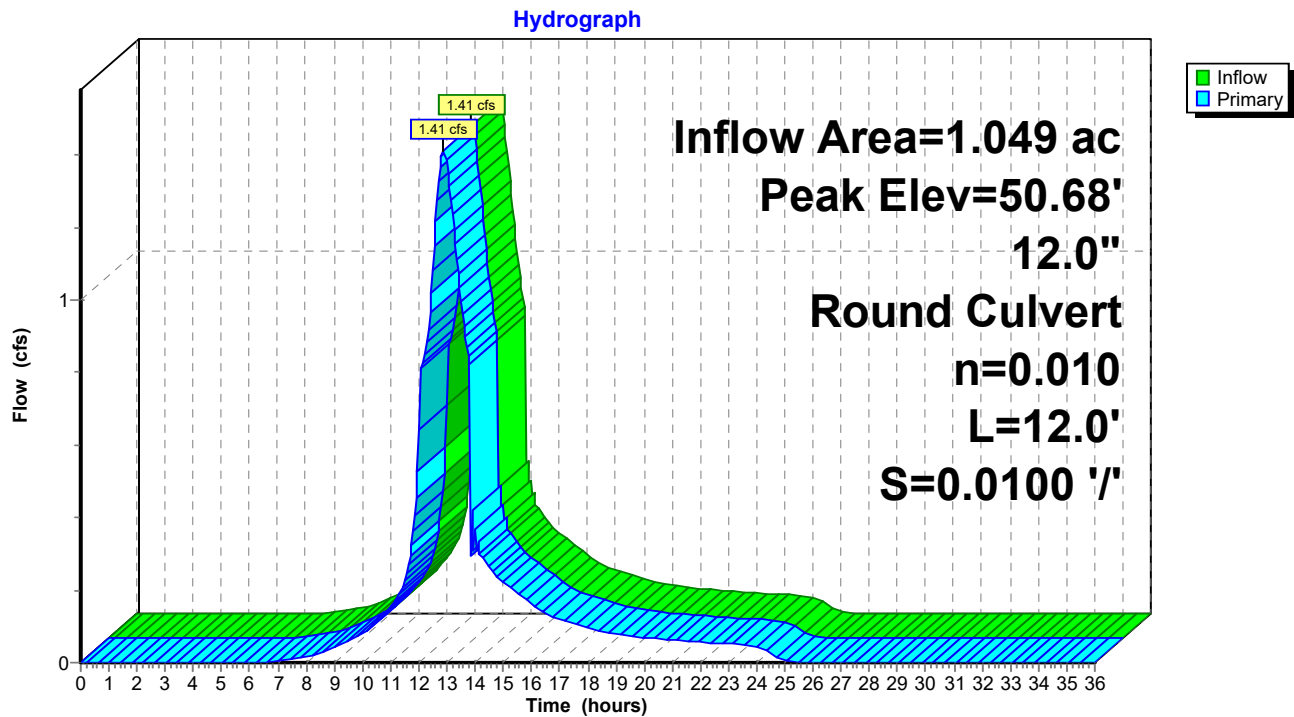

Summary for Pond SB 11 B: SB 11 B


Inflow Area = 0.872 ac, 0.00% Impervious, Inflow Depth = 3.53" for 10 yr event
 Inflow = 1.82 cfs @ 12.51 hrs, Volume= 0.256 af
 Outflow = 1.82 cfs @ 12.51 hrs, Volume= 0.256 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.82 cfs @ 12.51 hrs, Volume= 0.256 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 53.51' @ 12.51 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	52.00'	8.0" Round Culvert L= 24.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 52.00' / 51.76' S= 0.0100 '/ Cc= 0.900 n= 0.010, Flow Area= 0.35 sf

Primary OutFlow Max=1.82 cfs @ 12.51 hrs HW=53.50' TW=51.84' (Dynamic Tailwater)
 1=Culvert (Inlet Controls 1.82 cfs @ 5.21 fps)

Pond SB 11 B: SB 11 B

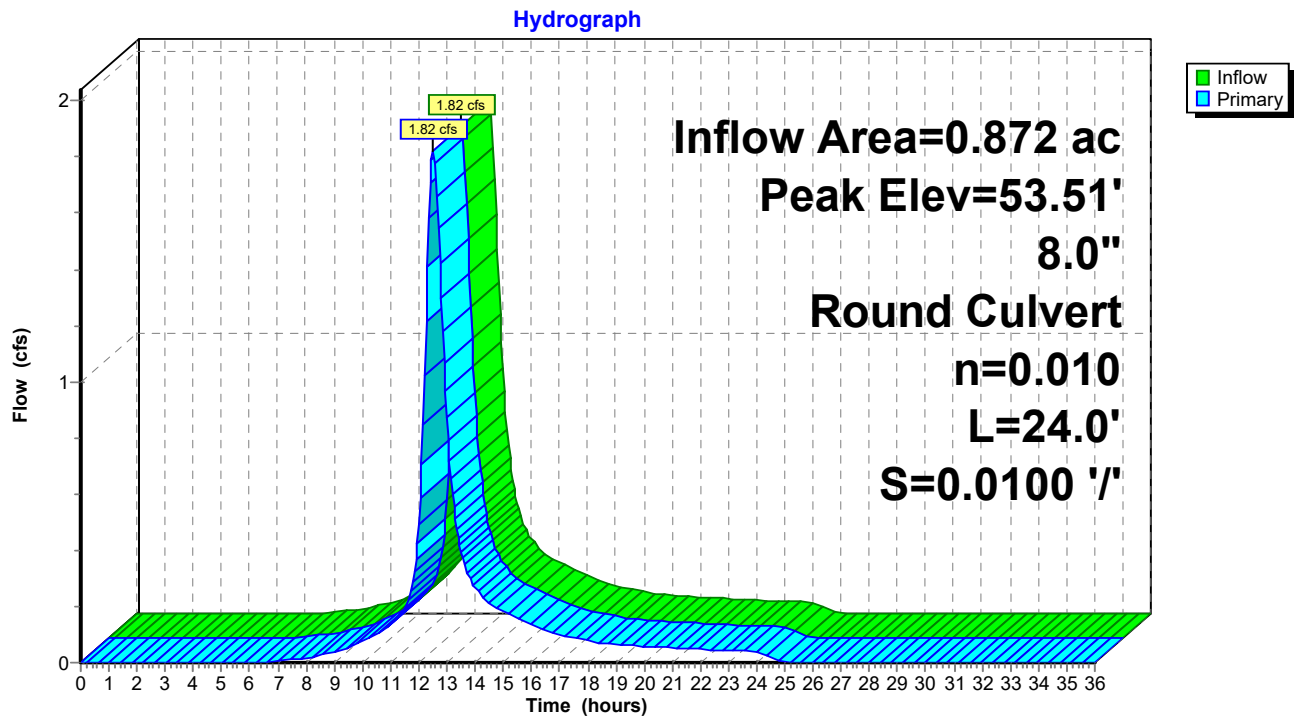

Summary for Pond SB 11 S: SB 11 S

Inflow Area = 0.872 ac, 0.00% Impervious, Inflow Depth = 3.53" for 10 yr event
 Inflow = 1.82 cfs @ 12.51 hrs, Volume= 0.256 af
 Outflow = 1.29 cfs @ 12.81 hrs, Volume= 0.256 af, Atten= 29%, Lag= 17.9 min
 Primary = 1.29 cfs @ 12.81 hrs, Volume= 0.256 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 51.95' @ 12.81 hrs Surf.Area= 0 sf Storage= 1,136 cf

Plug-Flow detention time= (not calculated: outflow precedes inflow)
 Center-of-Mass det. time= 5.3 min (840.7 - 835.4)

Volume	Invert	Avail.Storage	Storage Description
#1	50.84'	2,892 cf	Custom Stage Data Listed below


Elevation (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
50.84	0	0
51.67	16	16
52.17	2,035	2,051
52.67	841	2,892

Device	Routing	Invert	Outlet Devices
#1	Primary	50.84'	4.0" Vert. Orifice/Grate C= 0.600
#2	Primary	51.17'	6.0" Vert. Orifice/Grate C= 0.600
#3	Primary	51.67'	6.0" Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=1.29 cfs @ 12.81 hrs HW=51.94' TW=50.77' (Dynamic Tailwater)

1=Orifice/Grate (Orifice Controls 0.41 cfs @ 4.66 fps)
 2=Orifice/Grate (Orifice Controls 0.68 cfs @ 3.49 fps)
 3=Orifice/Grate (Orifice Controls 0.20 cfs @ 1.78 fps)

Pond SB 11 S: SB 11 S

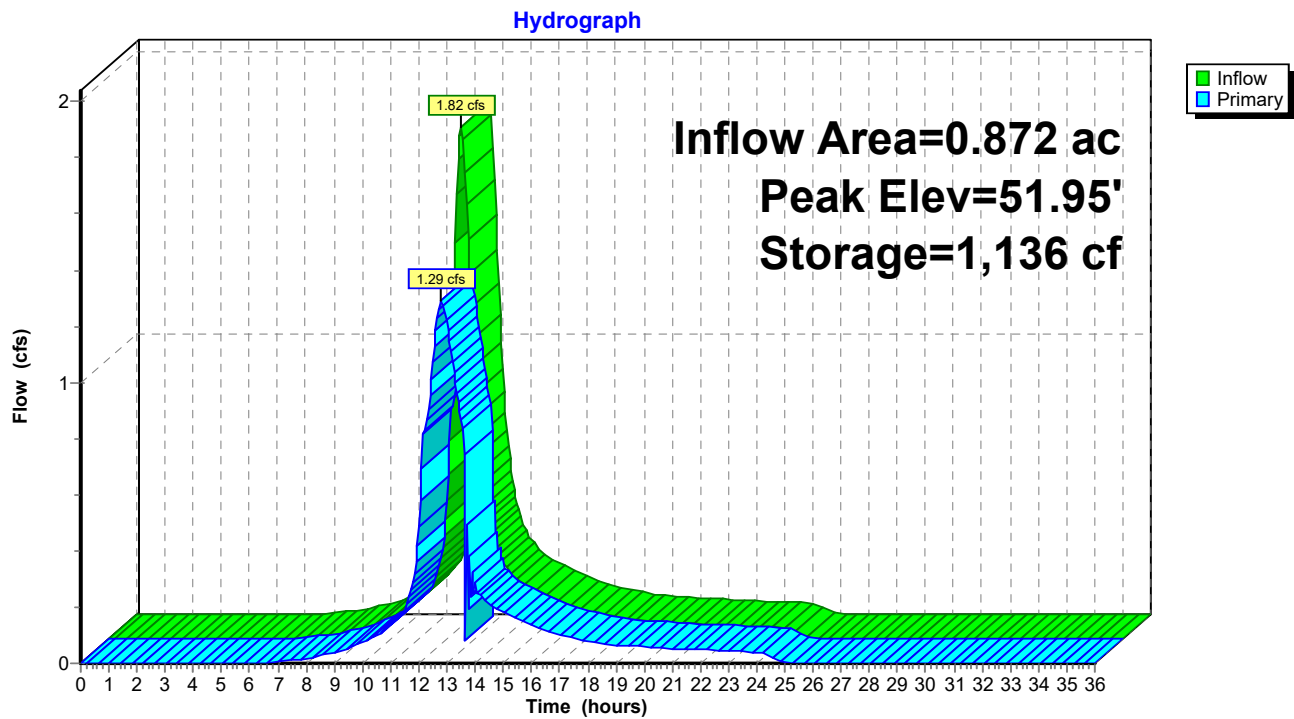

Summary for Pond SB 12 B: SB 12 B


Inflow Area = 0.872 ac, 0.00% Impervious, Inflow Depth = 3.53" for 10 yr event
 Inflow = 1.29 cfs @ 12.81 hrs, Volume= 0.256 af
 Outflow = 1.29 cfs @ 12.81 hrs, Volume= 0.256 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.29 cfs @ 12.81 hrs, Volume= 0.256 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 50.77' @ 12.81 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	50.17'	12.0" Round Culvert L= 160.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 50.17' / 48.57' S= 0.0100 '/ Cc= 0.900 n= 0.010, Flow Area= 0.79 sf

Primary OutFlow Max=1.29 cfs @ 12.81 hrs HW=50.77' TW=49.30' (Dynamic Tailwater)
 1=Culvert (Inlet Controls 1.29 cfs @ 2.63 fps)

Pond SB 12 B: SB 12 B

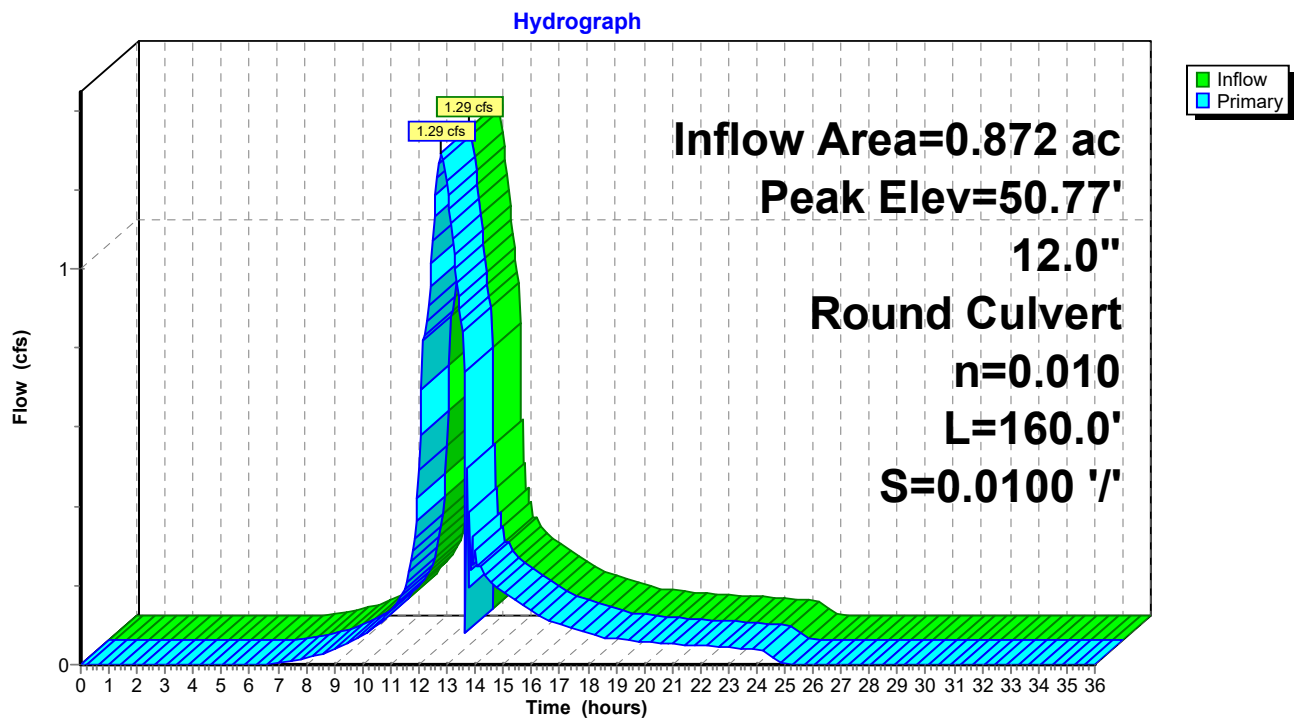


Summary for Link POA: POA

Inflow Area = 17.400 ac, 49.60% Impervious, Inflow Depth > 3.43" for 10 yr event
Inflow = 46.88 cfs @ 12.12 hrs, Volume= 4.978 af
Primary = 46.88 cfs @ 12.12 hrs, Volume= 4.978 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Link POA: POA

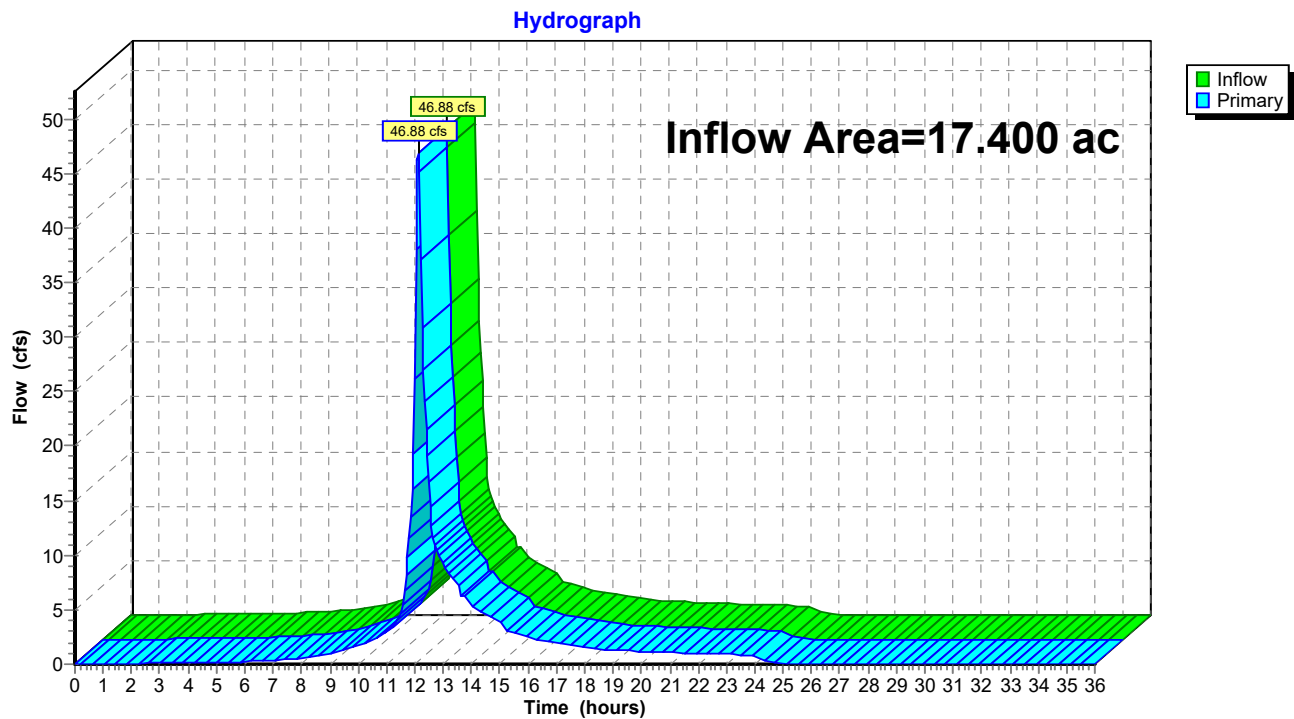

Summary for Subcatchment PR-1: PR-1

Runoff = 19.42 cfs @ 12.13 hrs, Volume= 1.581 af, Depth= 4.31"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 25 yr Rainfall=6.35"

Area (ac)	CN	Description
1.892	61	>75% Grass cover, Good, HSG B
2.510	98	Paved parking, HSG B
4.402	82	Weighted Average
1.892		42.98% Pervious Area
2.510		57.02% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.2	50	0.0050	0.69		Sheet Flow, A-B
					Smooth surfaces n= 0.011 P2= 3.20"
7.9	234	0.0050	0.49		Shallow Concentrated Flow, B-C
					Short Grass Pasture Kv= 7.0 fps
9.1	284	Total			

Subcatchment PR-1: PR-1

Hydrograph

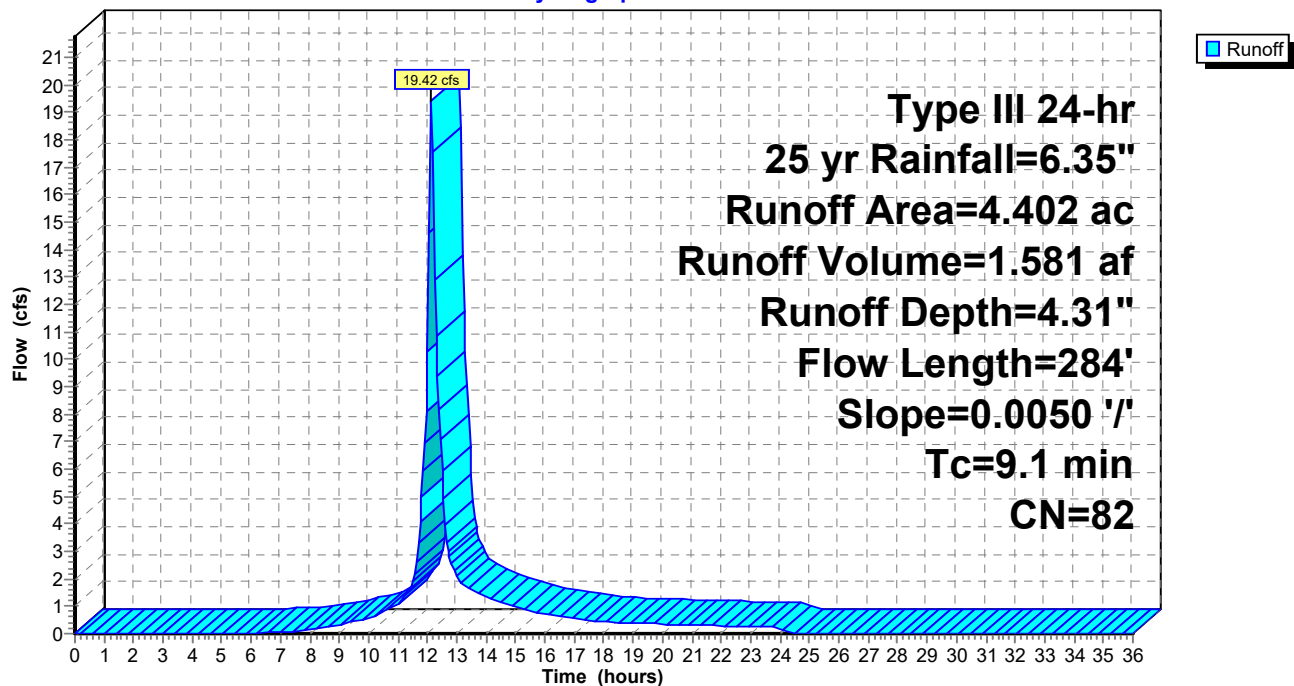

Summary for Subcatchment PR-1A: PR-1A


Runoff = 2.69 cfs @ 12.09 hrs, Volume= 0.208 af, Depth= 5.30"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 25 yr Rainfall=6.35"

Area (ac)	CN	Description
0.090	61	>75% Grass cover, Good, HSG B
0.380	98	Paved parking, HSG B
0.470	91	Weighted Average
0.090		19.15% Pervious Area
0.380		80.85% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-1A: PR-1A

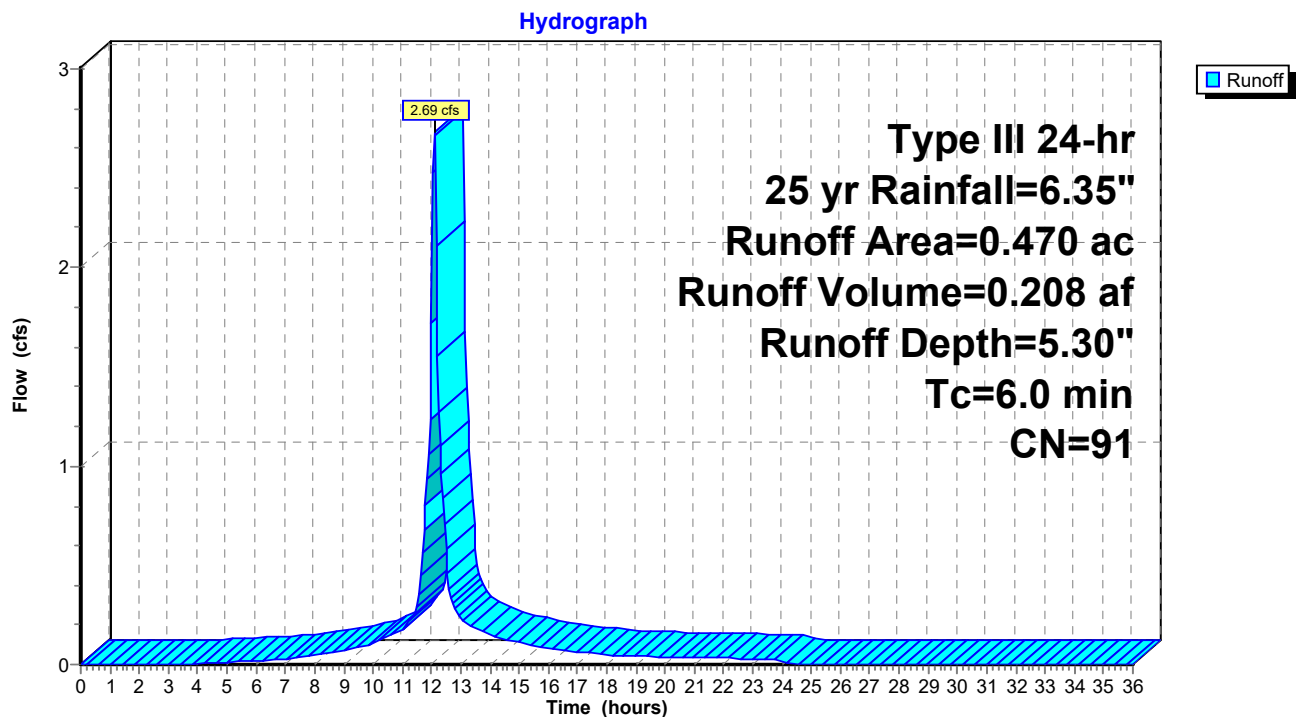

Summary for Subcatchment PR-1B: PR-1B

Runoff = 11.31 cfs @ 12.09 hrs, Volume= 0.948 af, Depth= 6.11"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 25 yr Rainfall=6.35"

Area (ac)	CN	Description
1.861	98	Roofs, HSG B
1.861		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-1B: PR-1B

Hydrograph

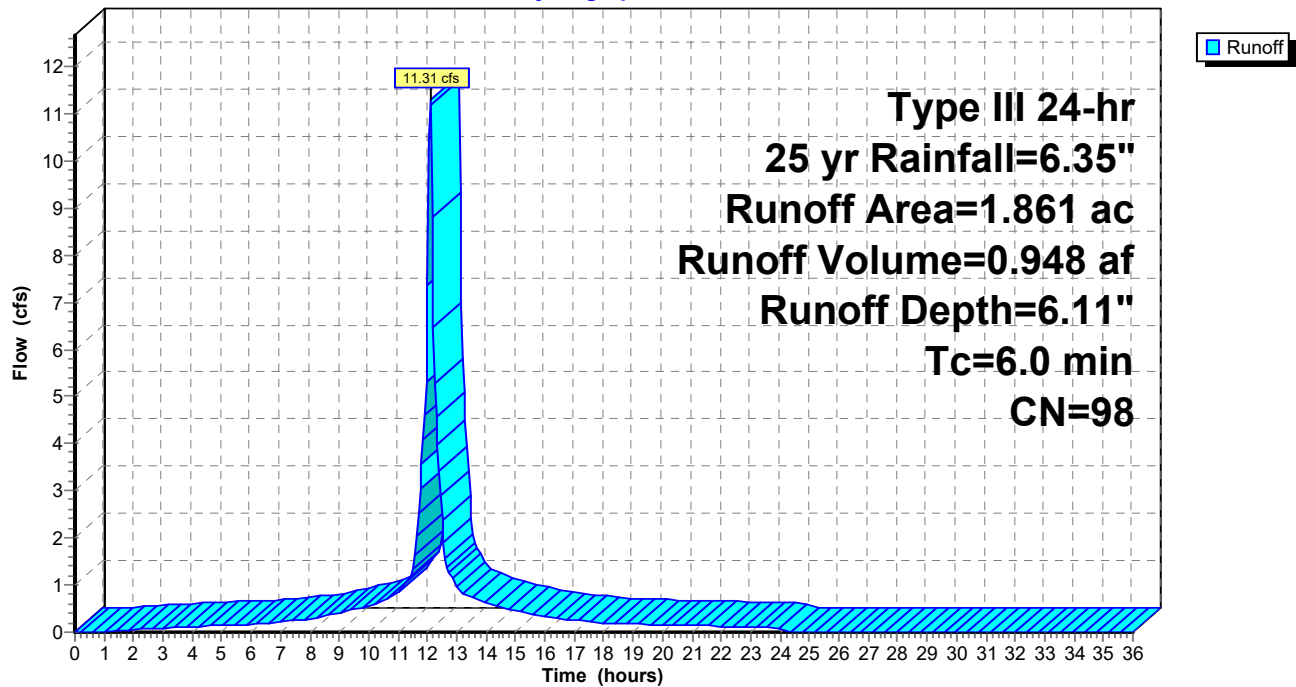

Summary for Subcatchment PR-1C: PR-1C


Runoff = 1.89 cfs @ 12.09 hrs, Volume= 0.137 af, Depth= 3.58"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 25 yr Rainfall=6.35"

Area (ac)	CN	Description
0.020	55	Woods, Good, HSG B
0.260	61	>75% Grass cover, Good, HSG B
0.180	98	Paved parking, HSG B
0.460	75	Weighted Average
0.280		60.87% Pervious Area
0.180		39.13% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.6	20	0.0700	0.09		Sheet Flow, 20' SF
					Woods: Light underbrush n= 0.400 P2= 3.20"
1.9	40	0.5000	0.35		Sheet Flow, 30' SF
					Grass: Dense n= 0.240 P2= 3.20"
0.1	12	0.0100	1.61		Shallow Concentrated Flow, 12' SCF
					Unpaved Kv= 16.1 fps
0.2	48	0.0400	4.06		Shallow Concentrated Flow, 48' SCF
					Paved Kv= 20.3 fps
5.8	120	Total, Increased to minimum Tc = 6.0 min			

Subcatchment PR-1C: PR-1C

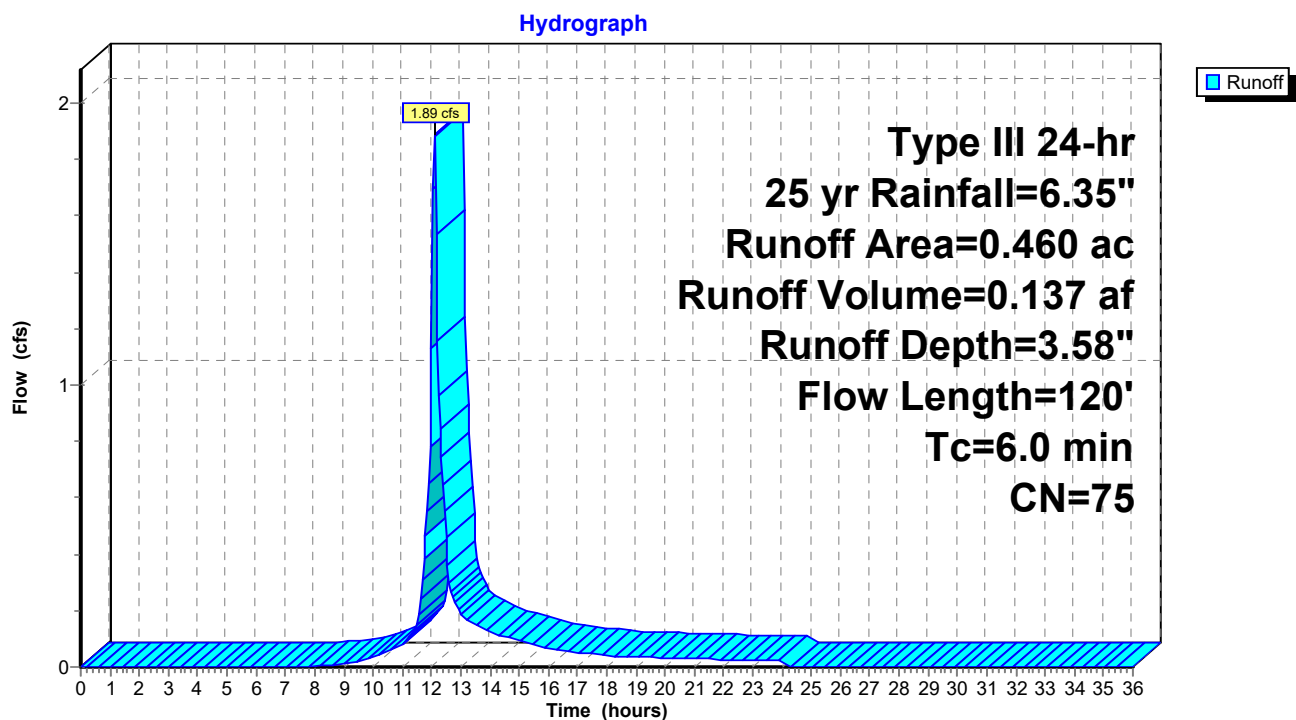

Summary for Subcatchment PR-1D: PR-1D

Runoff = 9.12 cfs @ 12.09 hrs, Volume= 0.764 af, Depth= 6.11"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 25 yr Rainfall=6.35"

Area (ac)	CN	Description
1.501	98	Roofs, HSG B
1.501		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-1D: PR-1D

Hydrograph

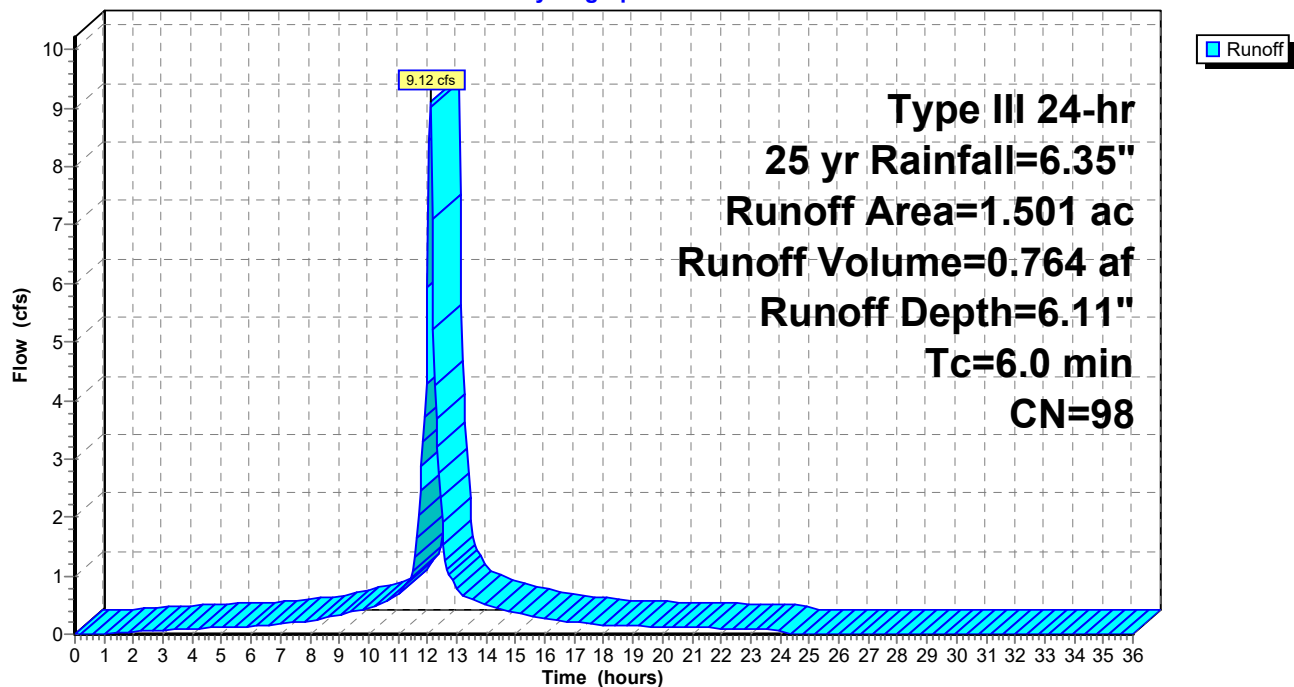

Summary for Subcatchment PR-1E: PR-1E


Runoff = 5.06 cfs @ 12.17 hrs, Volume= 0.445 af, Depth= 3.48"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 25 yr Rainfall=6.35"

Area (ac)	CN	Description
1.000	61	>75% Grass cover, Good, HSG B
0.533	98	Paved parking, HSG B
1.533	74	Weighted Average
1.000		65.23% Pervious Area
0.533		34.77% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.8	50	0.0050	0.09		Sheet Flow, 50' SF
					Grass: Short n= 0.150 P2= 3.20"
2.5	170	0.0050	1.14		Shallow Concentrated Flow, 170' SCF
					Unpaved Kv= 16.1 fps
12.3	220	Total			

Subcatchment PR-1E: PR-1E

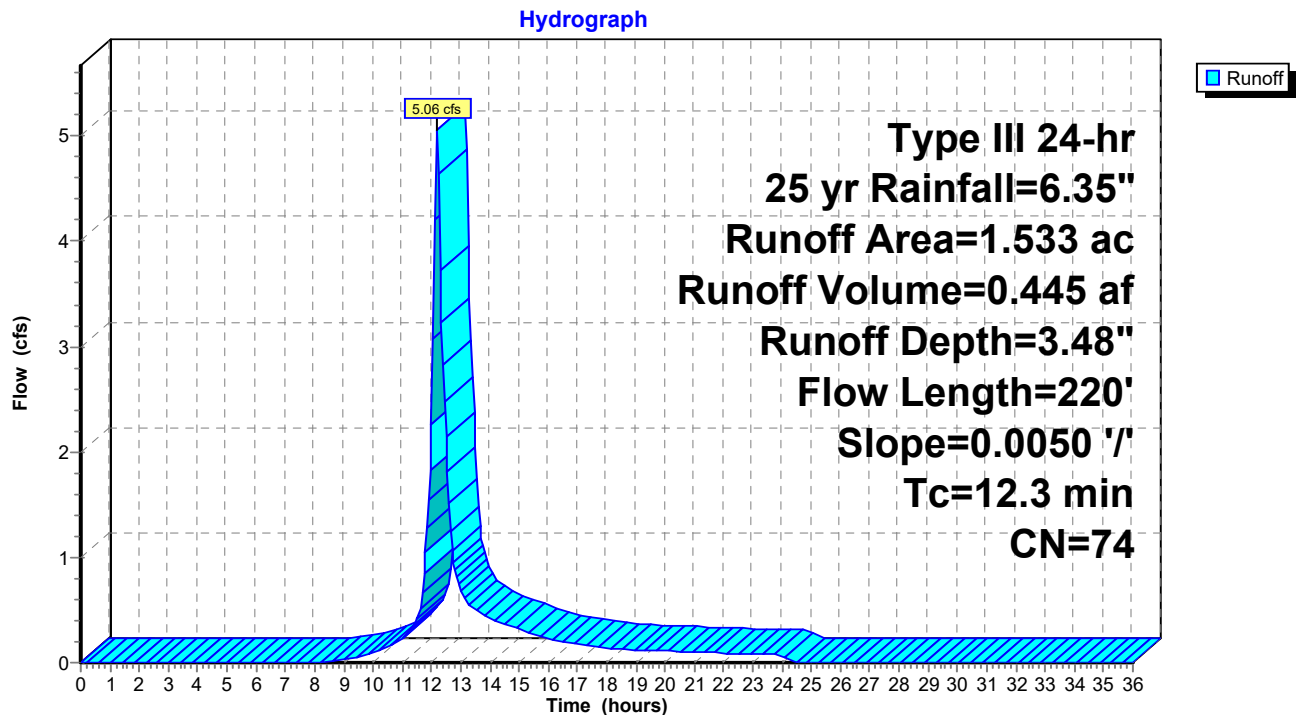

Summary for Subcatchment PR-2: PR-2

Runoff = 6.89 cfs @ 12.09 hrs, Volume= 0.504 af, Depth= 4.20"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 25 yr Rainfall=6.35"

Area (ac)	CN	Description
0.672	61	>75% Grass cover, Good, HSG B
0.768	98	Paved parking, HSG B
1.440	81	Weighted Average
0.672		46.67% Pervious Area
0.768		53.33% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-2: PR-2

Hydrograph

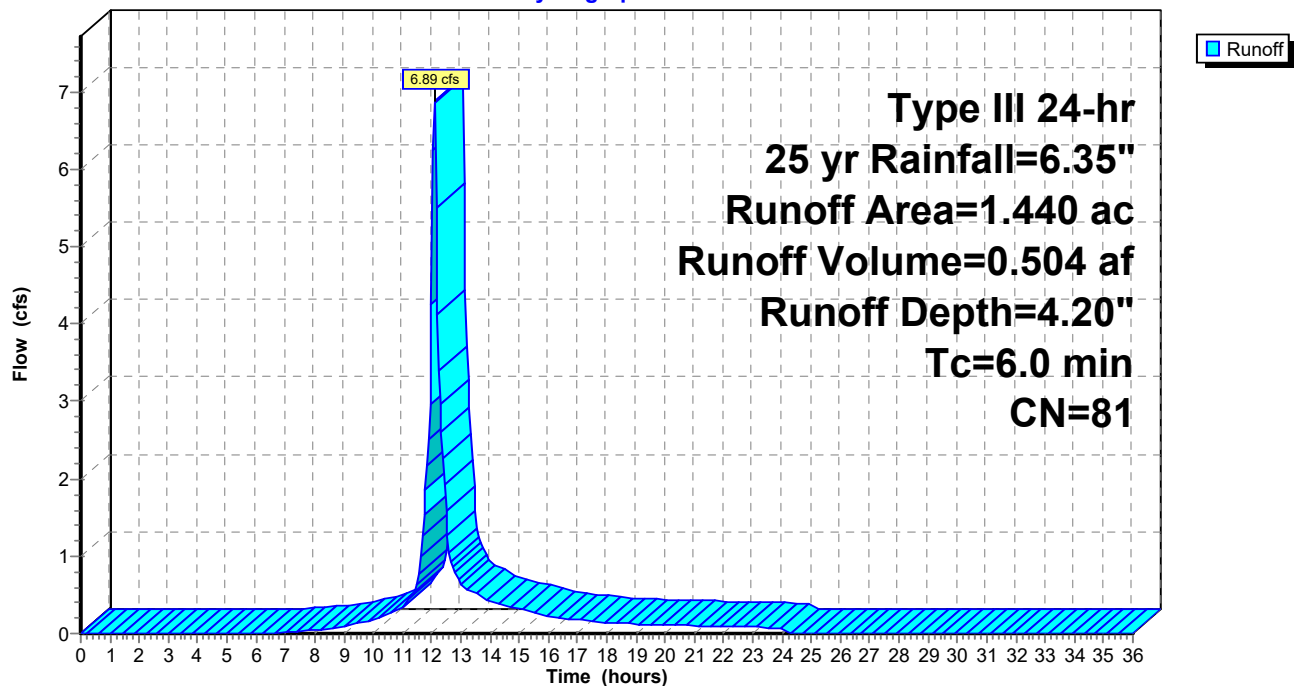

Summary for Subcatchment PR-2B: PR-2B

Runoff = 1.61 cfs @ 12.09 hrs, Volume= 0.135 af, Depth= 6.11"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 25 yr Rainfall=6.35"

Area (ac)	CN	Description
0.265	98	Roofs, HSG B
0.265		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-2B: PR-2B

Hydrograph

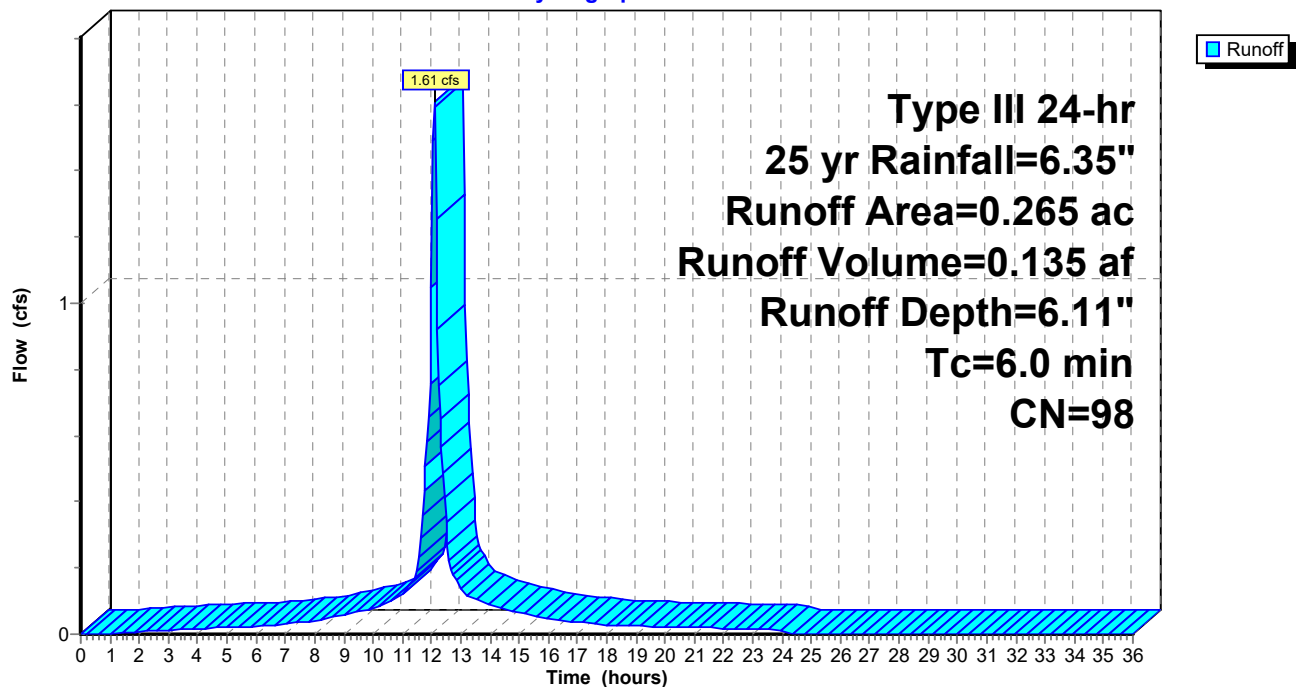

Summary for Subcatchment PR-3A: PR-3A

Runoff = 3.77 cfs @ 12.09 hrs, Volume= 0.280 af, Depth= 4.63"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 25 yr Rainfall=6.35"

Area (ac)	CN	Description
0.249	61	>75% Grass cover, Good, HSG B
0.476	98	Paved parking, HSG B
0.725	85	Weighted Average
0.249		34.34% Pervious Area
0.476		65.66% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-3A: PR-3A

Hydrograph

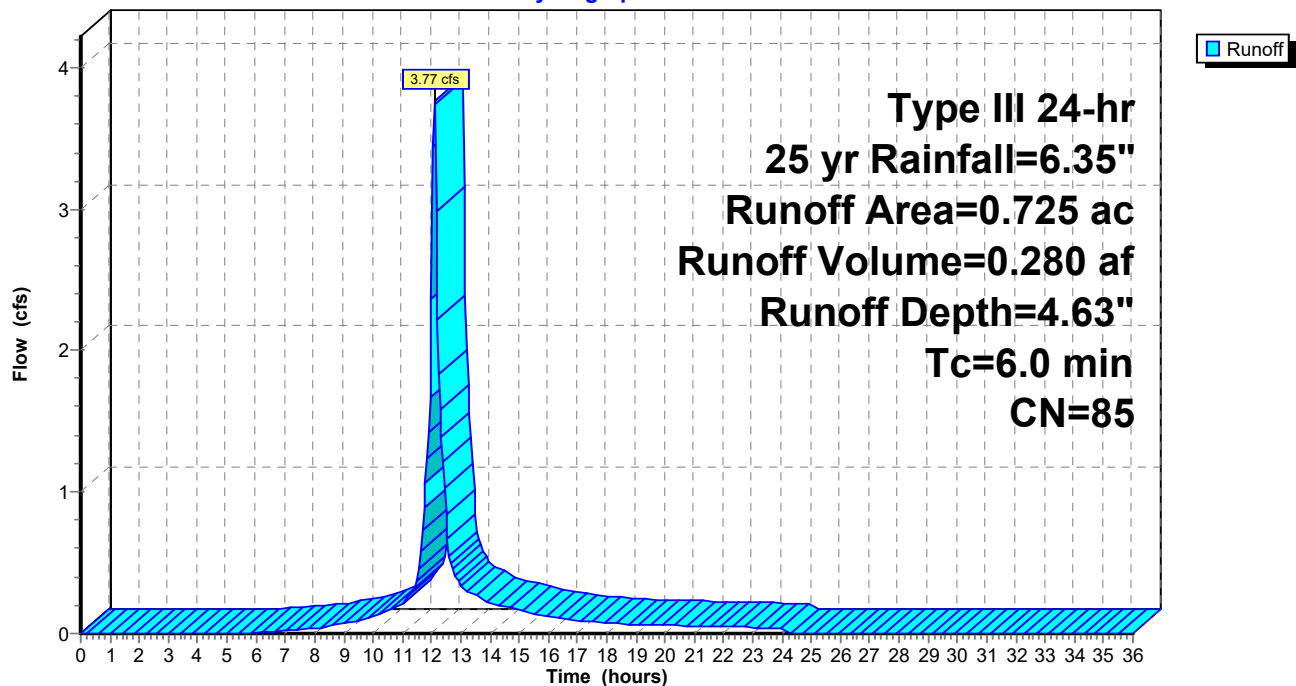

Summary for Subcatchment PR-3B: PR-3B


Runoff = 1.10 cfs @ 12.09 hrs, Volume= 0.080 af, Depth= 3.99"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 25 yr Rainfall=6.35"

Area (ac)	CN	Description
0.124	61	>75% Grass cover, Good, HSG B
0.117	98	Paved parking, HSG B
0.241	79	Weighted Average
0.124		51.45% Pervious Area
0.117		48.55% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-3B: PR-3B

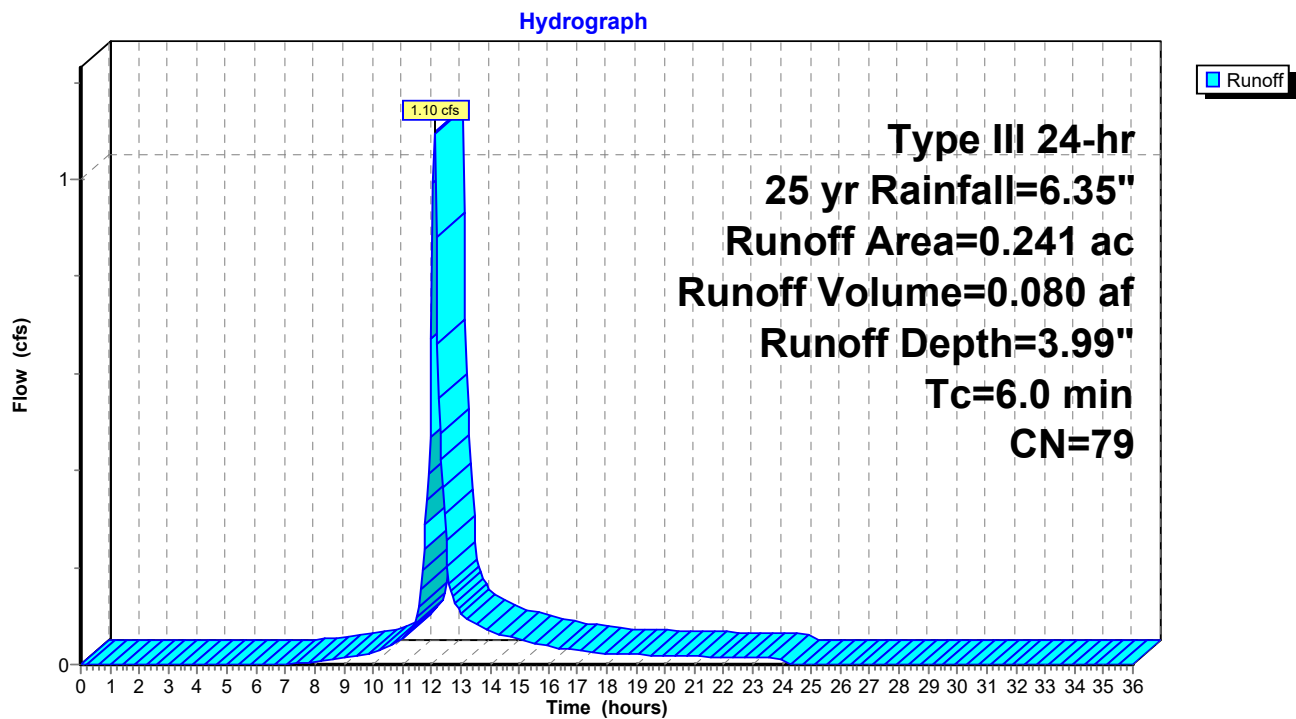

Summary for Subcatchment PR-3C: PR-3C

Runoff = 0.46 cfs @ 12.10 hrs, Volume= 0.035 af, Depth= 2.24"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 25 yr Rainfall=6.35"

Area (ac)	CN	Description
0.186	61	>75% Grass cover, Good, HSG B
0.186		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-3C: PR-3C

Hydrograph

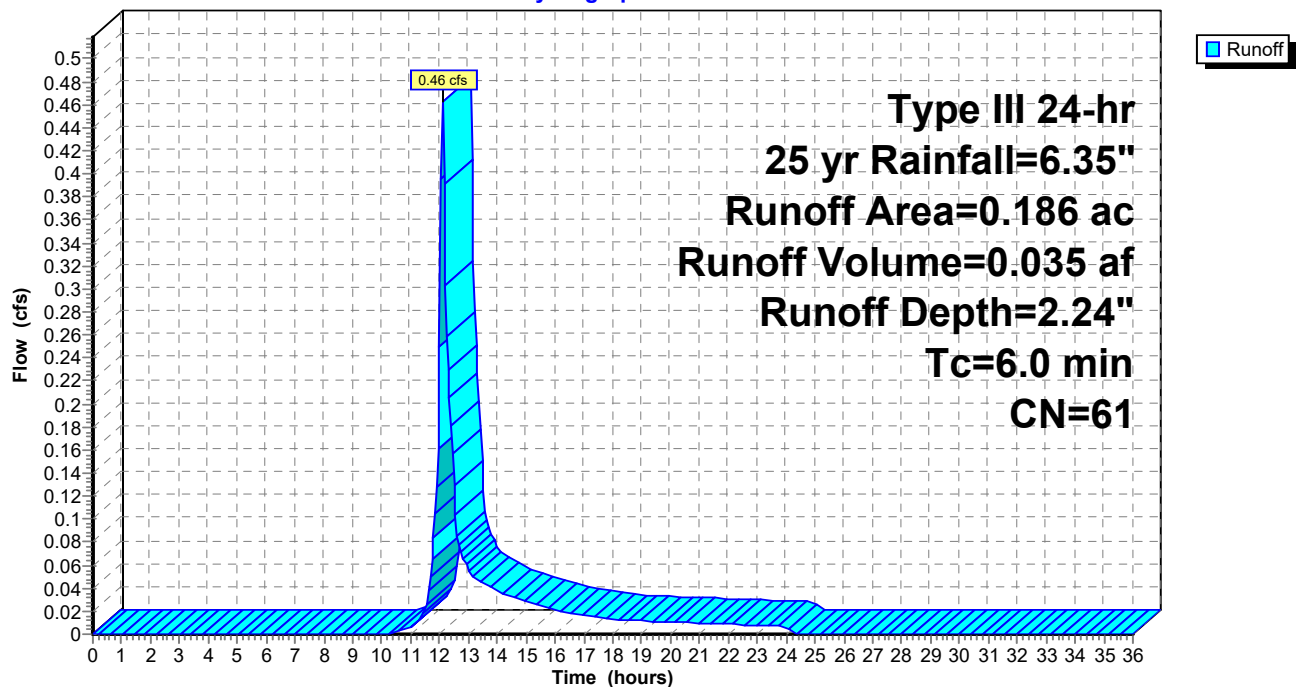

Summary for Subcatchment PR-4A: SB 01 A


Runoff = 2.38 cfs @ 12.57 hrs, Volume= 0.363 af, Depth= 4.63"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 25 yr Rainfall=6.35"

Area (sf)	CN	Description
* 41,000	85	SYNTHETIC TURF- PAD- LINER
41,000		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
39.6	110	0.0055	0.05		Sheet Flow, Through Turf Section Grass: Bermuda n= 0.410 P2= 3.20"
3.7	100	0.0001	0.45	0.16	Pipe Channel, TRENCH DRAIN LEVEL 8.0" Round Area= 0.3 sf Perim= 2.1' r= 0.17' n= 0.010
43.3	210	Total			

Subcatchment PR-4A: SB 01 A

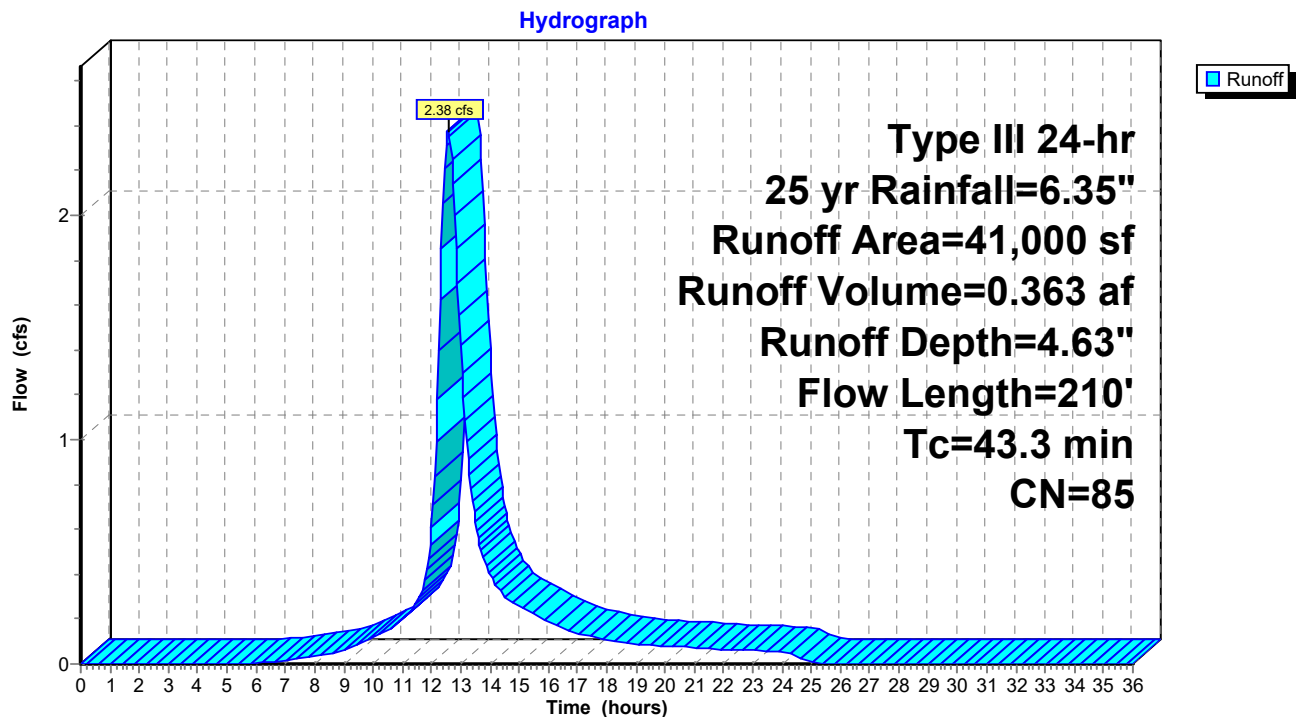

Summary for Subcatchment PR-4B: SB 11 A


Runoff = 2.37 cfs @ 12.50 hrs, Volume= 0.337 af, Depth= 4.63"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 25 yr Rainfall=6.35"

Area (sf)	CN	Description
* 38,000	85	SYNTHETIC TURF- PAD- LINER
38,000		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
33.7	90	0.0055	0.04		Sheet Flow, Through Turf Section Grass: Bermuda n= 0.410 P2= 3.20"
3.7	100	0.0001	0.45	0.16	Pipe Channel, TRENCH DRAIN LEVEL 8.0" Round Area= 0.3 sf Perim= 2.1' r= 0.17' n= 0.010
37.4	190	Total			

Subcatchment PR-4B: SB 11 A

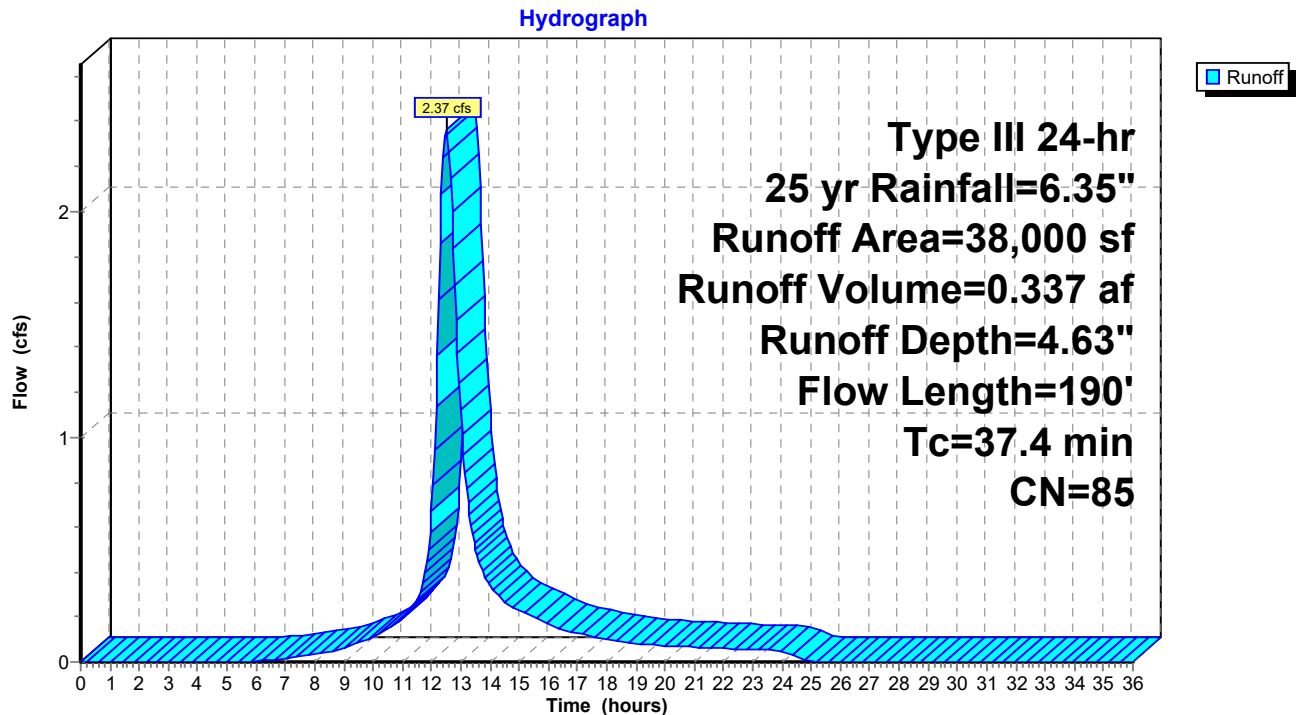

Summary for Subcatchment PR-4C: SB 00 DPW SLOPE


Runoff = 0.47 cfs @ 12.09 hrs, Volume= 0.034 af, Depth= 3.79"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 25 yr Rainfall=6.35"

Area (sf)	CN	Adj	Description
1,100	98		Unconnected pavement, HSG A
3,600	74		>75% Grass cover, Good, HSG C
4,700	80	77	Weighted Average, UI Adjusted
3,600			76.60% Pervious Area
1,100			23.40% Impervious Area
1,100			100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.3	25	0.5000	0.32		Sheet Flow, SLOPING LAND
					Grass: Dense n= 0.240 P2= 3.20"
1.3	25	Total, Increased to minimum Tc = 6.0 min			

Subcatchment PR-4C: SB 00 DPW SLOPE

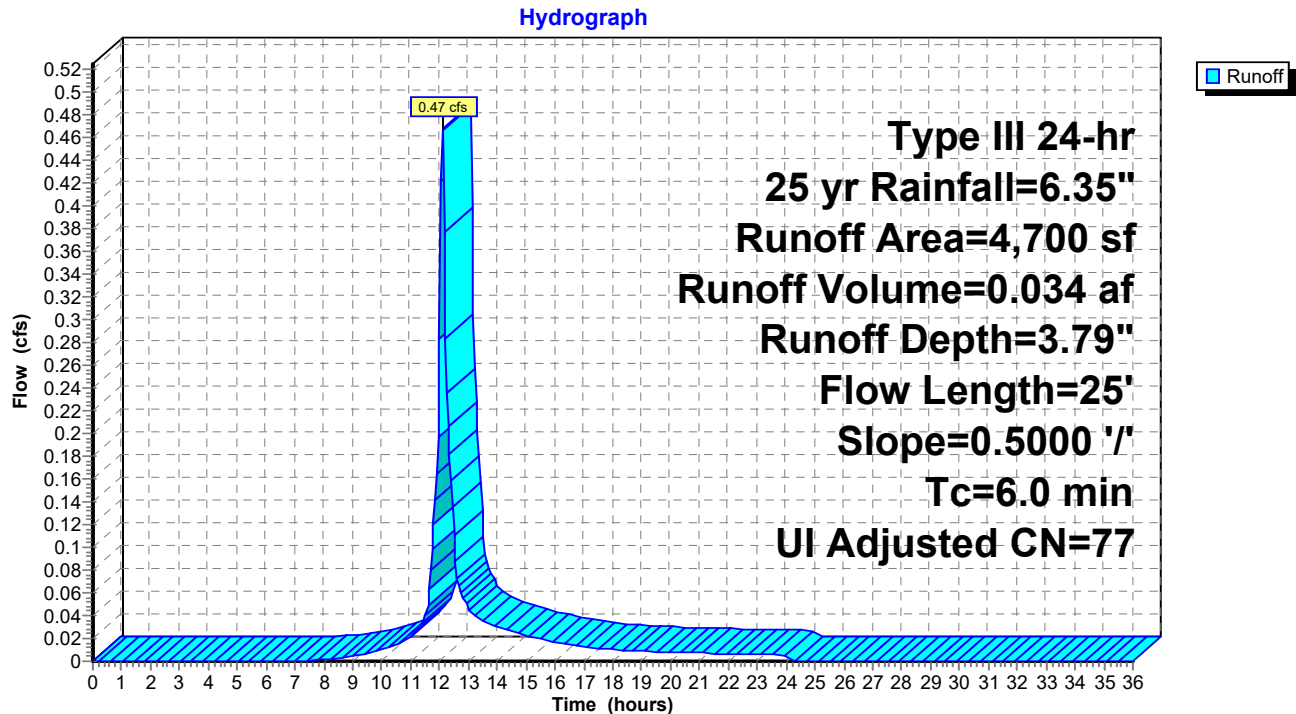

Summary for Subcatchment PR-5A: BB 01 A


Runoff = 2.03 cfs @ 12.27 hrs, Volume= 0.217 af, Depth= 4.63"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 25 yr Rainfall=6.35"

Area (sf)	CN	Description
* 24,500	85	SYNTHETIC TURF- PAD- LINER
24,500		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
18.2	46	0.0067	0.04		Sheet Flow, Through Turf Section Grass: Bermuda n= 0.410 P2= 3.20"
1.7	47	0.0001	0.45	0.16	Pipe Channel, TRENCH DRAIN LEVEL 8.0" Round Area= 0.3 sf Perim= 2.1' r= 0.17' n= 0.010
19.9	93	Total			

Subcatchment PR-5A: BB 01 A

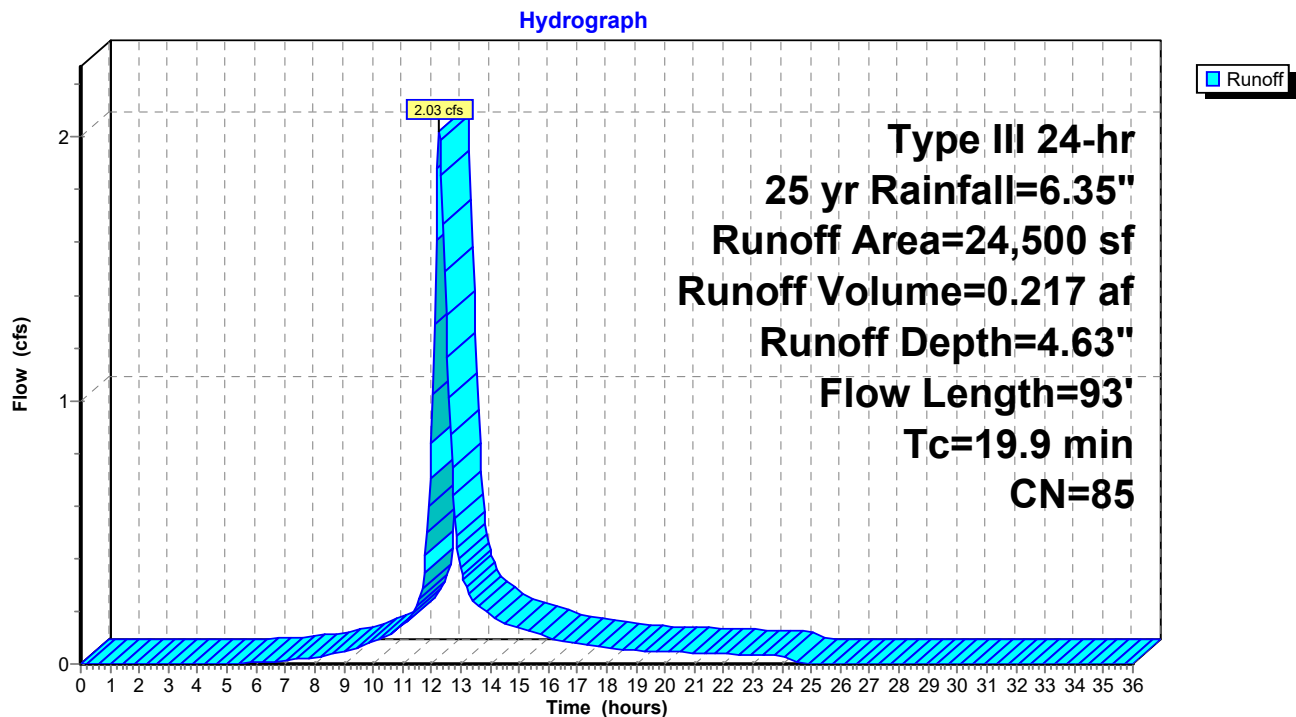

Summary for Subcatchment PR-5B: BB 11 A


Runoff = 3.32 cfs @ 12.87 hrs, Volume= 0.649 af, Depth= 4.63"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 25 yr Rainfall=6.35"

Area (sf)	CN	Description
* 73,200	85	SYNTHETIC TURF- PAD- LINER
73,200		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
22.1	53	0.0055	0.04		Sheet Flow, Through Turf Section Grass: Bermuda n= 0.410 P2= 3.20"
43.1	150	0.0083	0.06		Sheet Flow, SYNTHETIC TURF Grass: Bermuda n= 0.410 P2= 3.20"
1.7	47	0.0001	0.45	0.16	Pipe Channel, TRENCH DRAIN LEVEL 8.0" Round Area= 0.3 sf Perim= 2.1' r= 0.17' n= 0.010
66.9	250	Total			

Subcatchment PR-5B: BB 11 A

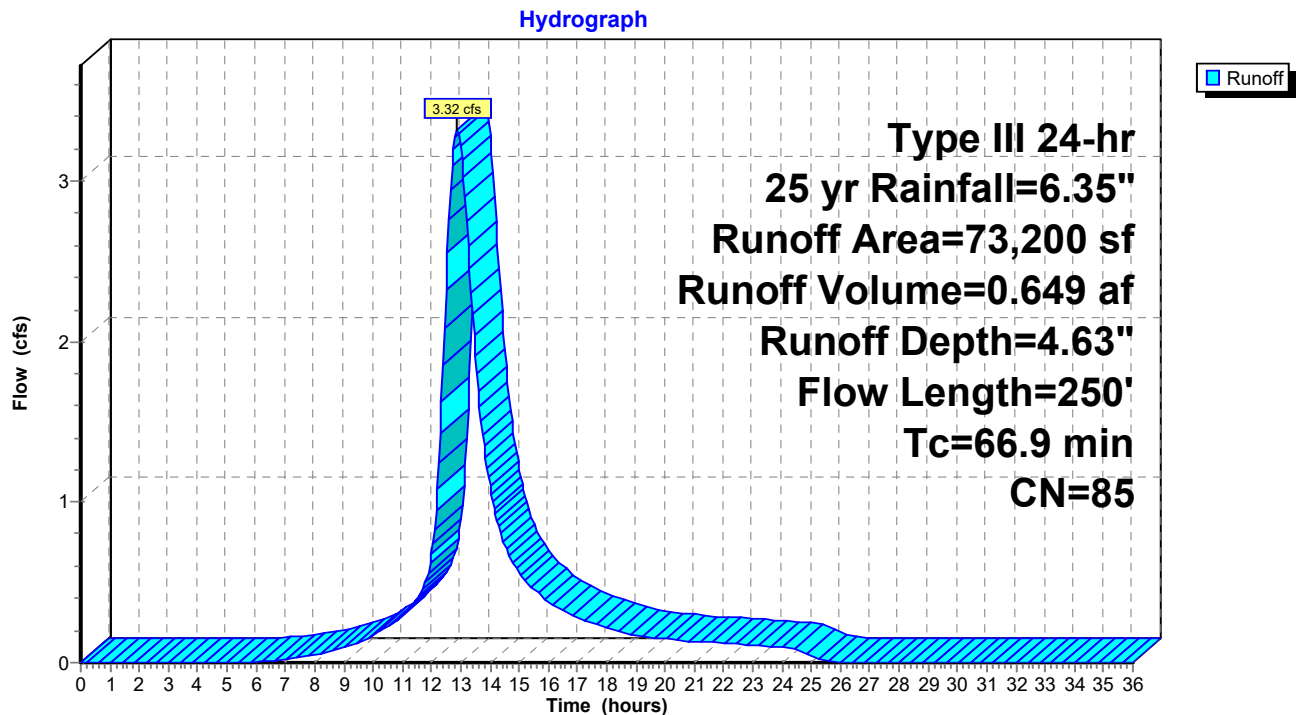


Summary for Subcatchment PR-5C: SLOPE

Runoff = 0.73 cfs @ 12.00 hrs, Volume= 0.045 af, Depth= 3.58"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 25 yr Rainfall=6.35"

Area (sf)	CN	Adj	Description
600	98		Unconnected roofs, HSG C
6,000	74		>75% Grass cover, Good, HSG C
6,600	76	75	Weighted Average, UI Adjusted
6,000			90.91% Pervious Area
600			9.09% Impervious Area
600			100.00% Unconnected

Subcatchment PR-5C: SLOPE

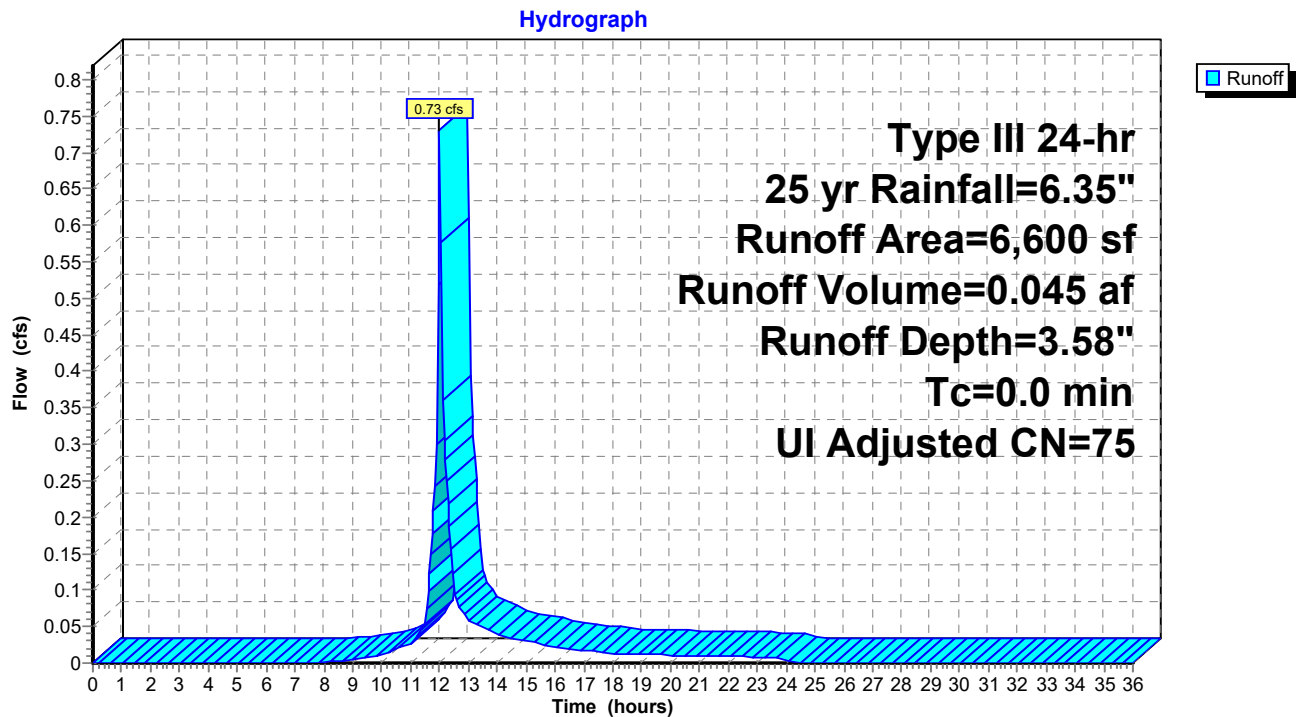

Summary for Pond 2P: rain garden#2 cascading

Inflow Area = 0.966 ac, 61.39% Impervious, Inflow Depth > 4.42" for 25 yr event
 Inflow = 4.88 cfs @ 12.09 hrs, Volume= 0.356 af
 Outflow = 4.87 cfs @ 12.10 hrs, Volume= 0.339 af, Atten= 0%, Lag= 0.5 min
 Primary = 0.03 cfs @ 12.10 hrs, Volume= 0.049 af
 Secondary = 4.85 cfs @ 12.10 hrs, Volume= 0.290 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 54.68' @ 12.10 hrs Surf.Area= 1,127 sf Storage= 1,397 cf
 Flood Elev= 55.00' Surf.Area= 1,326 sf Storage= 1,784 cf

Plug-Flow detention time= 84.5 min calculated for 0.339 af (95% of inflow)
 Center-of-Mass det. time= 47.9 min (883.5 - 835.6)

Volume	Invert	Avail.Storage	Storage Description
#1	51.00'	1,557 cf	Rain Garden Envelope (Prismatic) Listed below (Recalc) 2,357 cf Overall - 800 cf Embedded = 1,557 cf
#2	51.00'	80 cf	crush stone (Prismatic) Listed below (Recalc) Inside #1 200 cf Overall x 40.0% Voids
#3	51.50'	133 cf	Bio Media (Prismatic) Listed below (Recalc) Inside #1 532 cf Overall x 25.0% Voids
#4	52.83'	14 cf	Mulch (Prismatic) Listed below (Recalc) Inside #1 68 cf Overall x 20.0% Voids
1,784 cf			Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
51.00	400	0	0
53.00	400	800	800
54.00	694	547	1,347
55.00	1,326	1,010	2,357

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
51.00	400	0	0
51.50	400	200	200

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
51.50	400	0	0
52.83	400	532	532


Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
52.83	400	0	0
53.00	400	68	68

Device	Routing	Invert	Outlet Devices
#1	Device 3	51.00'	1.020 in/hr Exfiltration over Surface area 25.0' long x 3.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 Coef. (English) 2.44 2.58 2.68 2.67 2.65 2.64 2.64 2.68 2.68 2.72 2.81 2.92 2.97 3.07 3.32
#2	Secondary	54.50'	
#3	Primary	51.00'	12.0" Round Culvert L= 25.0' Ke= 0.500 Inlet / Outlet Invert= 51.00' / 50.88' S= 0.0048 '/' Cc= 0.900 n= 0.012, Flow Area= 0.79 sf

Primary OutFlow Max=0.03 cfs @ 12.10 hrs HW=54.68' TW=50.25' (Dynamic Tailwater)
 ↳ **3=Culvert** (Passes 0.03 cfs of 6.75 cfs potential flow)
 ↳ **1=Exfiltration** (Exfiltration Controls 0.03 cfs)

Secondary OutFlow Max=4.82 cfs @ 12.10 hrs HW=54.68' TW=50.25' (Dynamic Tailwater)
 ↳ **2=Broad-Crested Rectangular Weir** (Weir Controls 4.82 cfs @ 1.05 fps)

Pond 2P: rain garden#2 cascading

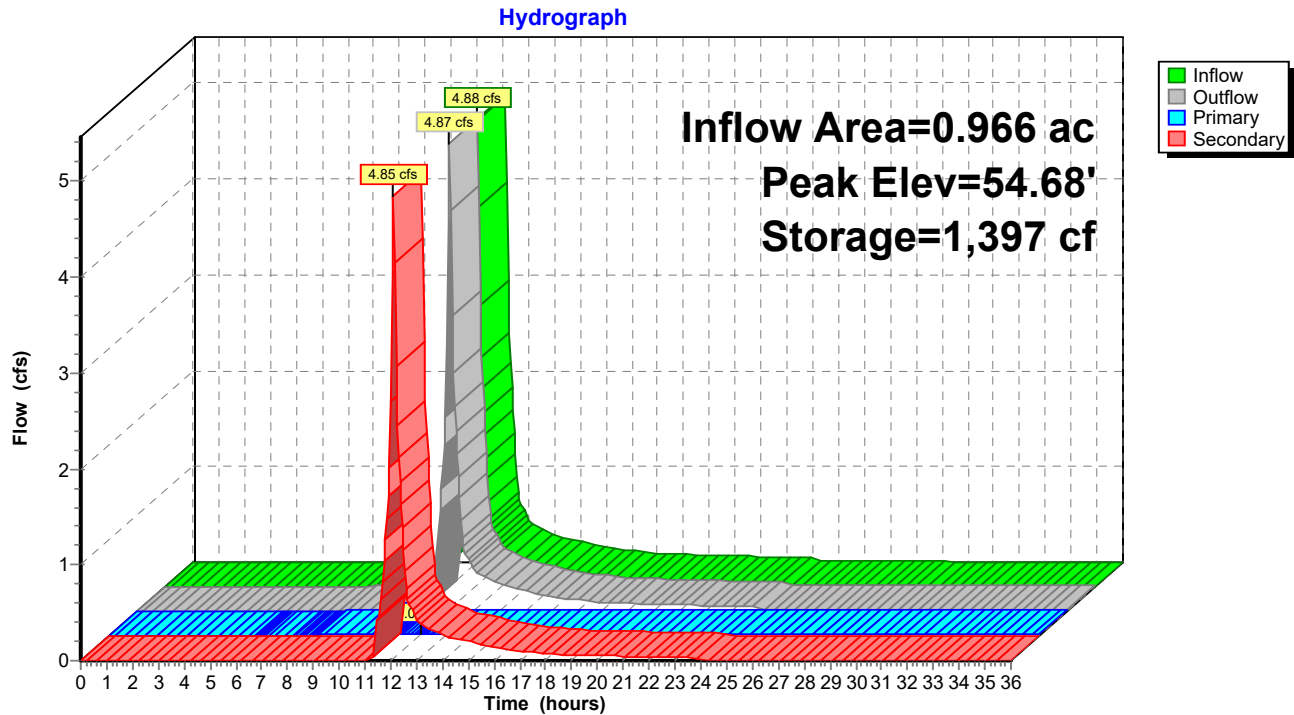

Summary for Pond 3P: rain garden#3 cascading

Inflow Area = 1.152 ac, 51.48% Impervious, Inflow Depth > 3.90" for 25 yr event
 Inflow = 5.34 cfs @ 12.10 hrs, Volume= 0.374 af
 Outflow = 5.15 cfs @ 12.12 hrs, Volume= 0.332 af, Atten= 4%, Lag= 0.9 min
 Primary = 5.15 cfs @ 12.12 hrs, Volume= 0.332 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 50.26' @ 12.12 hrs Surf.Area= 1,539 sf Storage= 2,658 cf
 Flood Elev= 50.00' Surf.Area= 1,373 sf Storage= 2,283 cf

Plug-Flow detention time= 142.8 min calculated for 0.332 af (89% of inflow)
 Center-of-Mass det. time= 60.5 min (941.5 - 881.0)

Volume	Invert	Avail.Storage	Storage Description
#1	46.00'	2,710 cf	Rain Garden Envelope (Prismatic) Listed below (Recalc) 3,911 cf Overall - 1,200 cf Embedded = 2,710 cf
#2	46.00'	120 cf	crush stone (Prismatic) Listed below (Recalc) Inside #1 300 cf Overall x 40.0% Voids
#3	46.50'	199 cf	Bio Media (Prismatic) Listed below (Recalc) Inside #1 798 cf Overall x 25.0% Voids
#4	47.83'	20 cf	Mulch (Prismatic) Listed below (Recalc) Inside #1 102 cf Overall x 20.0% Voids
3,050 cf			Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
46.00	600	0	0
48.00	600	1,200	1,200
49.00	957	779	1,979
50.00	1,373	1,165	3,144
50.50	1,695	767	3,911

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
46.00	600	0	0
46.50	600	300	300

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
46.50	600	0	0
47.83	600	798	798


Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
47.83	600	0	0
48.00	600	102	102

Device	Routing	Invert	Outlet Devices
#1	Device 3	46.00'	1.020 in/hr Exfiltration over Surface area
#2	Device 3	50.00'	24.0" x 48.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#3	Primary	46.00'	15.0" Round Culvert L= 26.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 46.00' / 45.87' S= 0.0050 ' S= 0.0050 ' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

Primary OutFlow Max=5.03 cfs @ 12.12 hrs HW=50.25' TW=0.00' (Dynamic Tailwater)

- 3=Culvert (Passes 5.03 cfs of 8.89 cfs potential flow)
- 1=Exfiltration (Exfiltration Controls 0.04 cfs)
- 2=Orifice/Grate (Weir Controls 4.99 cfs @ 1.64 fps)

Pond 3P: rain garden#3 cascading

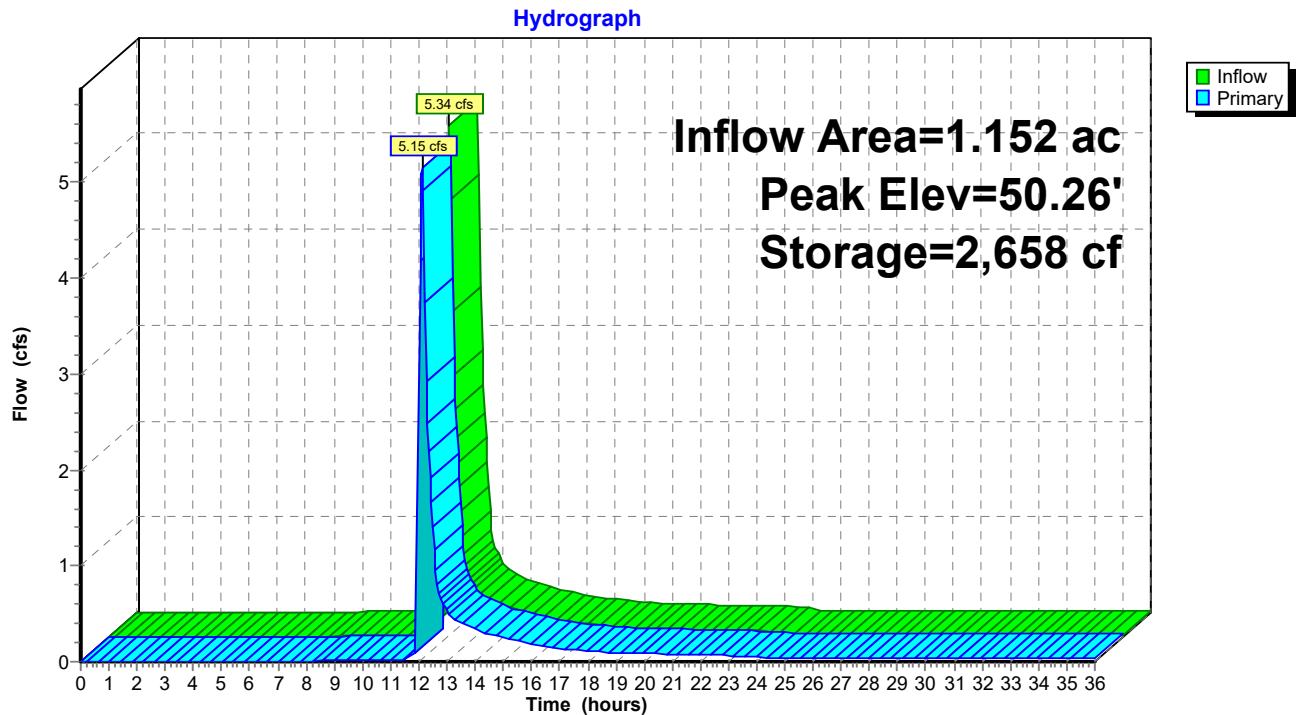

Summary for Pond 4P: UGS-1

Inflow Area = 1.705 ac, 60.59% Impervious, Inflow Depth = 4.50" for 25 yr event
 Inflow = 8.50 cfs @ 12.09 hrs, Volume= 0.639 af
 Outflow = 8.48 cfs @ 12.10 hrs, Volume= 0.601 af, Atten= 0%, Lag= 0.6 min
 Discarded = 0.04 cfs @ 7.70 hrs, Volume= 0.103 af
 Primary = 8.44 cfs @ 12.10 hrs, Volume= 0.498 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 44.02' @ 12.10 hrs Surf.Area= 1,672 sf Storage= 4,722 cf

Plug-Flow detention time= (not calculated: outflow precedes inflow)
 Center-of-Mass det. time= 93.7 min (889.3 - 795.6)

Volume	Invert	Avail.Storage	Storage Description
#1A	39.50'	2,099 cf	29.92'W x 55.89'L x 5.50'H Field A 9,196 cf Overall - 3,198 cf Embedded = 5,998 cf x 35.0% Voids
#2A	40.25'	3,198 cf	ADS_StormTech MC-3500 d +Cap x 28 Inside #1 Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap 28 Chambers in 4 Rows Cap Storage= +14.9 cf x 2 x 4 rows = 119.2 cf
		5,297 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	39.25'	24.0" Round Culvert L= 50.0' Ke= 0.500 Inlet / Outlet Invert= 39.25' / 38.75' S= 0.0100 '/' Cc= 0.900 n= 0.012, Flow Area= 3.14 sf
#2	Device 1	43.67'	5.0' long x 4.00' rise Sharp-Crested Rectangular Weir 2 End Contraction(s)
#3	Discarded	39.50'	1.020 in/hr Exfiltration over Surface area
#4	Device 1	42.42'	9.0" Vert. Orifice/Grate X 3 rows with 6.0" cc spacing C= 0.600

Discarded OutFlow Max=0.04 cfs @ 7.70 hrs HW=39.59' (Free Discharge)
 ↑ **3=Exfiltration** (Exfiltration Controls 0.04 cfs)

Primary OutFlow Max=8.41 cfs @ 12.10 hrs HW=44.02' TW=0.00' (Dynamic Tailwater)
 ↑ **1=Culvert** (Passes 8.41 cfs of 29.35 cfs potential flow)
 ↑ **2=Sharp-Crested Rectangular Weir** (Weir Controls 3.27 cfs @ 1.92 fps)
 ↑ **4=Orifice/Grate** (Orifice Controls 5.14 cfs @ 4.08 fps)

Pond 4P: UGS-1 - Chamber Wizard Field A

Chamber Model = ADS_StormTechMC-3500 d +Cap (ADS StormTech®MC-3500 d rev 03/14 with Cap volume)

Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf

Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap

Cap Storage= +14.9 cf x 2 x 4 rows = 119.2 cf

77.0" Wide + 9.0" Spacing = 86.0" C-C Row Spacing

7 Chambers/Row x 7.17' Long +1.85' Cap Length x 2 = 53.89' Row Length +12.0" End Stone x 2 = 55.89' Base Length

4 Rows x 77.0" Wide + 9.0" Spacing x 3 + 12.0" Side Stone x 2 = 29.92' Base Width

9.0" Base + 45.0" Chamber Height + 12.0" Cover = 5.50' Field Height

28 Chambers x 110.0 cf + 14.9 cf Cap Volume x 2 x 4 Rows = 3,197.9 cf Chamber Storage

9,196.2 cf Field - 3,197.9 cf Chambers = 5,998.4 cf Stone x 35.0% Voids = 2,099.4 cf Stone Storage

Chamber Storage + Stone Storage = 5,297.3 cf = 0.122 af



Overall Storage Efficiency = 57.6%

Overall System Size = 55.89' x 29.92' x 5.50'


28 Chambers

340.6 cy Field

222.2 cy Stone

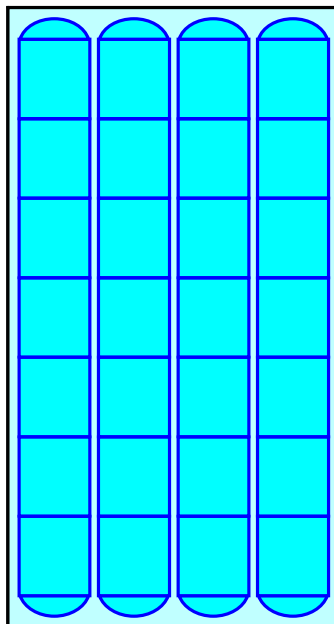

Pond 4P: UGS-1

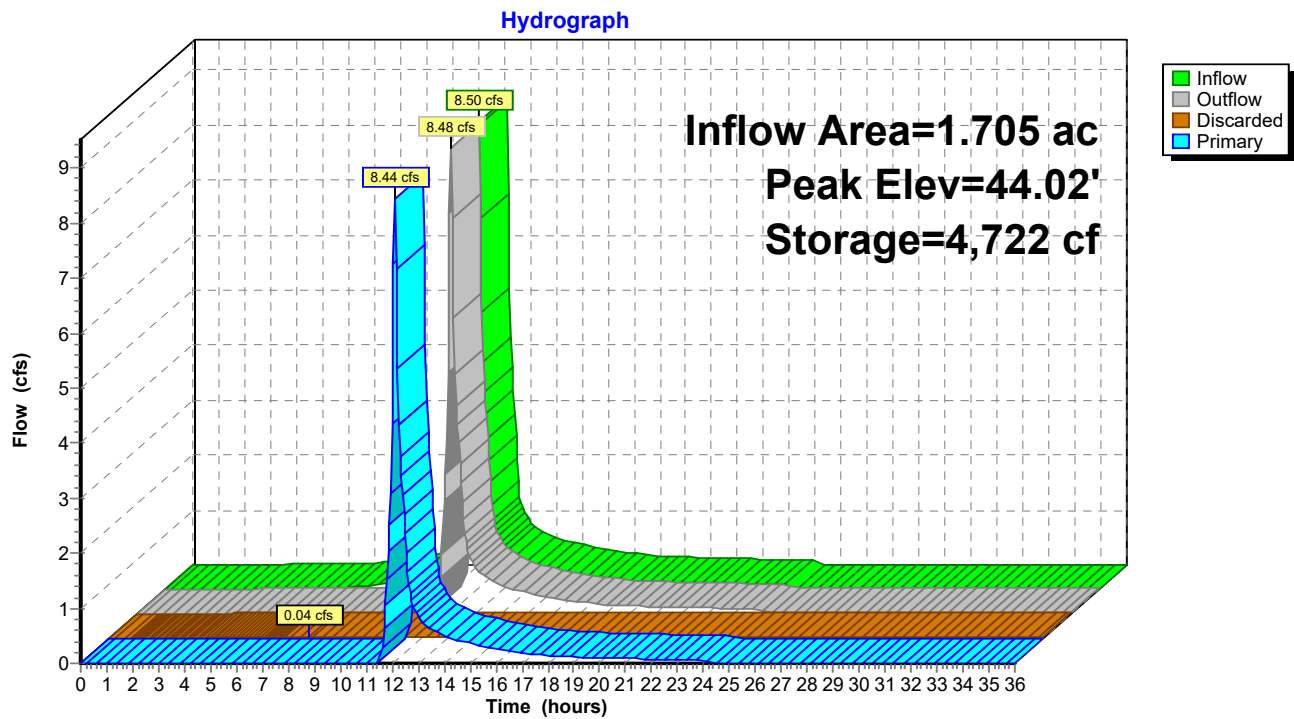

Summary for Pond 5P: rain garden#1 cascading

Inflow Area = 0.725 ac, 65.66% Impervious, Inflow Depth = 4.63" for 25 yr event
 Inflow = 3.77 cfs @ 12.09 hrs, Volume= 0.280 af
 Outflow = 3.78 cfs @ 12.09 hrs, Volume= 0.276 af, Atten= 0%, Lag= 0.3 min
 Primary = 0.01 cfs @ 12.09 hrs, Volume= 0.025 af
 Secondary = 3.77 cfs @ 12.09 hrs, Volume= 0.251 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 62.16' @ 12.09 hrs Surf.Area= 528 sf Storage= 631 cf
 Flood Elev= 63.00' Surf.Area= 660 sf Storage= 1,132 cf

Plug-Flow detention time= 51.3 min calculated for 0.275 af (98% of inflow)
 Center-of-Mass det. time= 43.2 min (841.7 - 798.6)

Volume	Invert	Avail.Storage	Storage Description
#1	58.50'	1,048 cf	Rain Garden Envelope (Prismatic) Listed below (Recalc) 1,348 cf Overall - 300 cf Embedded = 1,048 cf
#2	58.50'	30 cf	crush stone (Prismatic) Listed below (Recalc) Inside #1 75 cf Overall x 40.0% Voids
#3	59.00'	50 cf	Bio Media (Prismatic) Listed below (Recalc) Inside #1 199 cf Overall x 25.0% Voids
#4	60.33'	5 cf	Mulch (Prismatic) Listed below (Recalc) Inside #1 26 cf Overall x 20.0% Voids
1,132 cf			Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
58.50	150	0	0
60.50	150	300	300
61.00	236	97	397
62.00	503	370	766
63.00	660	582	1,348

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
58.50	150	0	0
59.00	150	75	75

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
59.00	150	0	0
60.33	150	199	199

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
60.33	150	0	0
60.50	150	26	26

17211.00 Arlington HS - Proposed Conditions - NOI Res_{type III} 24-hr 25 yr Rainfall=6.35"

Prepared by Samiotes Engineering

Printed 5/28/2020

HydroCAD® 10.00-24 s/n 03575 © 2018 HydroCAD Software Solutions LLC

Page 118

Device	Routing	Invert	Outlet Devices
#1	Device 3	58.50'	1.020 in/hr Exfiltration over Surface area
#2	Secondary	62.00'	25.0' long x 3.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 Coef. (English) 2.44 2.58 2.68 2.67 2.65 2.64 2.64 2.68 2.68 2.72 2.81 2.92 2.97 3.07 3.32
#3	Primary	58.50'	8.0" Round Culvert L= 20.0' Ke= 0.500 Inlet / Outlet Invert= 58.50' / 58.40' S= 0.0050 ' / Cc= 0.900 n= 0.012, Flow Area= 0.35 sf

Primary OutFlow Max=0.01 cfs @ 12.09 hrs HW=62.15' TW=54.68' (Dynamic Tailwater)


↑ **3=Culvert** (Passes 0.01 cfs of 3.06 cfs potential flow)

↑ **1=Exfiltration** (Exfiltration Controls 0.01 cfs)

Secondary OutFlow Max=3.71 cfs @ 12.09 hrs HW=62.15' TW=54.68' (Dynamic Tailwater)

↑ **2=Broad-Crested Rectangular Weir** (Weir Controls 3.71 cfs @ 0.96 fps)

Pond 5P: rain garden#1 cascading

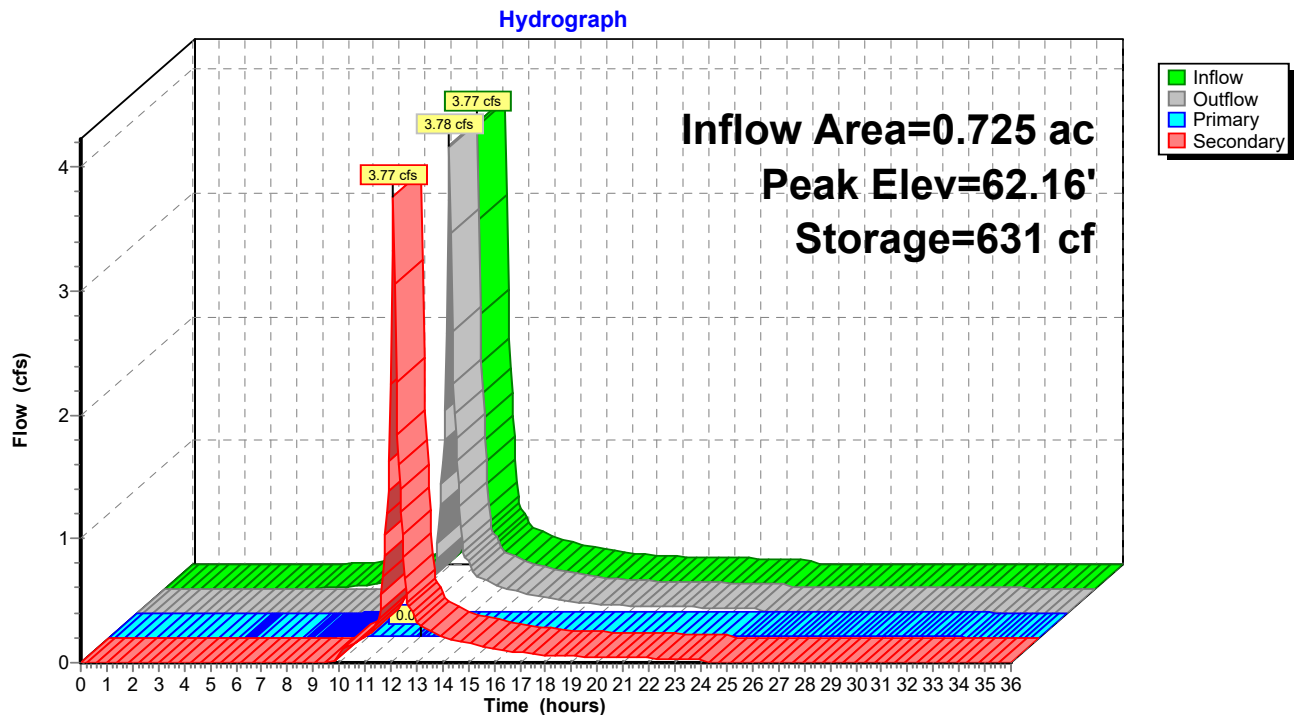

Summary for Pond BB 01 B: BB 01 B


Inflow Area = 0.714 ac, 1.93% Impervious, Inflow Depth = 4.41" for 25 yr event
 Inflow = 2.27 cfs @ 12.26 hrs, Volume= 0.262 af
 Outflow = 2.27 cfs @ 12.26 hrs, Volume= 0.262 af, Atten= 0%, Lag= 0.0 min
 Primary = 2.27 cfs @ 12.26 hrs, Volume= 0.262 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 48.65' @ 12.26 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	47.63'	12.0" Round Culvert L= 5.0' CMP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 47.63' / 47.58' S= 0.0100 '/ Cc= 0.900 n= 0.010, Flow Area= 0.79 sf

Primary OutFlow Max=2.26 cfs @ 12.26 hrs HW=48.64' TW=46.87' (Dynamic Tailwater)
 1=Culvert (Barrel Controls 2.26 cfs @ 3.52 fps)

Pond BB 01 B: BB 01 B

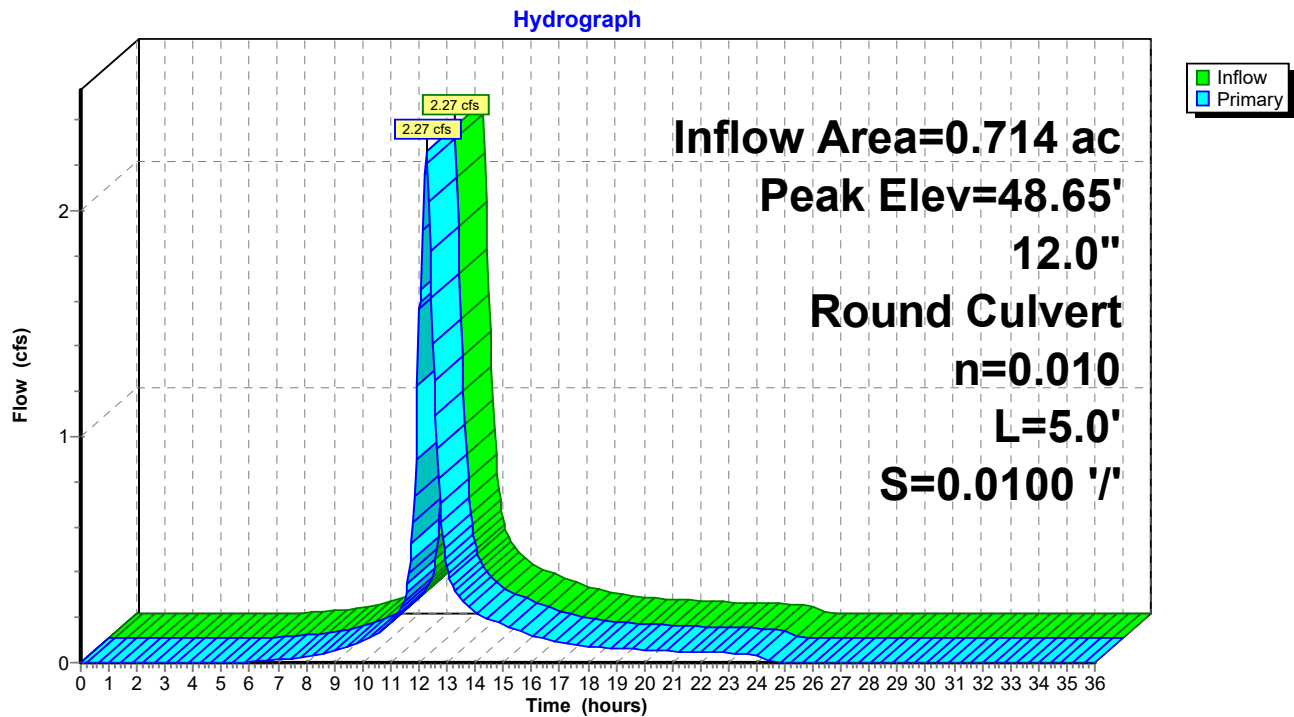

Summary for Pond BB 01 S: BB 01 S

Inflow Area = 0.714 ac, 1.93% Impervious, Inflow Depth = 4.41" for 25 yr event
 Inflow = 2.27 cfs @ 12.26 hrs, Volume= 0.262 af
 Outflow = 0.41 cfs @ 13.02 hrs, Volume= 0.262 af, Atten= 82%, Lag= 46.0 min
 Primary = 0.41 cfs @ 13.02 hrs, Volume= 0.262 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 47.20' @ 13.02 hrs Surf.Area= 0 sf Storage= 4,898 cf

Plug-Flow detention time= 192.5 min calculated for 0.262 af (100% of inflow)
 Center-of-Mass det. time= 192.4 min (1,005.0 - 812.6)


Volume	Invert	Avail.Storage	Storage Description
#1	45.65'	8,017 cf	Custom Stage Data Listed below

Elevation (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
45.65	0	0
46.48	16	16
46.98	3,378	3,394
47.48	3,405	6,799
47.98	1,218	8,017

Device	Routing	Invert	Outlet Devices
#1	Primary	45.65'	2.5" Vert. Orifice/Grate C= 0.600
#2	Primary	46.98'	4.0" Vert. Orifice/Grate C= 0.600
#3	Primary	46.98'	5.0" Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=0.41 cfs @ 13.02 hrs HW=47.20' TW=45.58' (Dynamic Tailwater)
 1=Orifice/Grate (Orifice Controls 0.20 cfs @ 5.79 fps)
 2=Orifice/Grate (Orifice Controls 0.10 cfs @ 1.60 fps)
 3=Orifice/Grate (Orifice Controls 0.12 cfs @ 1.60 fps)

Pond BB 01 S: BB 01 S

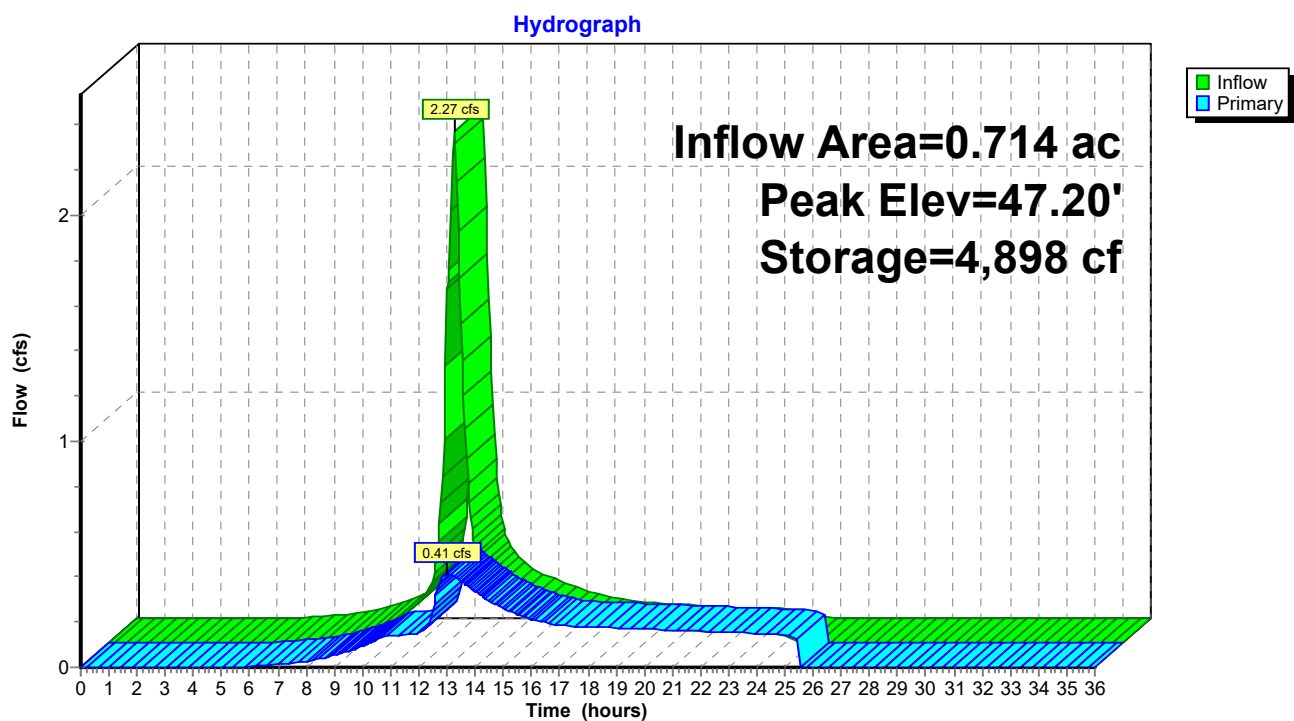

Summary for Pond BB 06 B: BB 06 B


Inflow Area = 0.714 ac, 1.93% Impervious, Inflow Depth = 4.41" for 25 yr event
 Inflow = 0.41 cfs @ 13.02 hrs, Volume= 0.262 af
 Outflow = 0.41 cfs @ 13.02 hrs, Volume= 0.262 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.41 cfs @ 13.02 hrs, Volume= 0.262 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 45.58' @ 13.02 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	45.25'	12.0" Round Culvert L= 112.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 45.25' / 44.69' S= 0.0050 '/ Cc= 0.900 n= 0.010, Flow Area= 0.79 sf

Primary OutFlow Max=0.41 cfs @ 13.02 hrs HW=45.58' TW=44.84' (Dynamic Tailwater)
 1=Culvert (Barrel Controls 0.41 cfs @ 2.69 fps)

Pond BB 06 B: BB 06 B

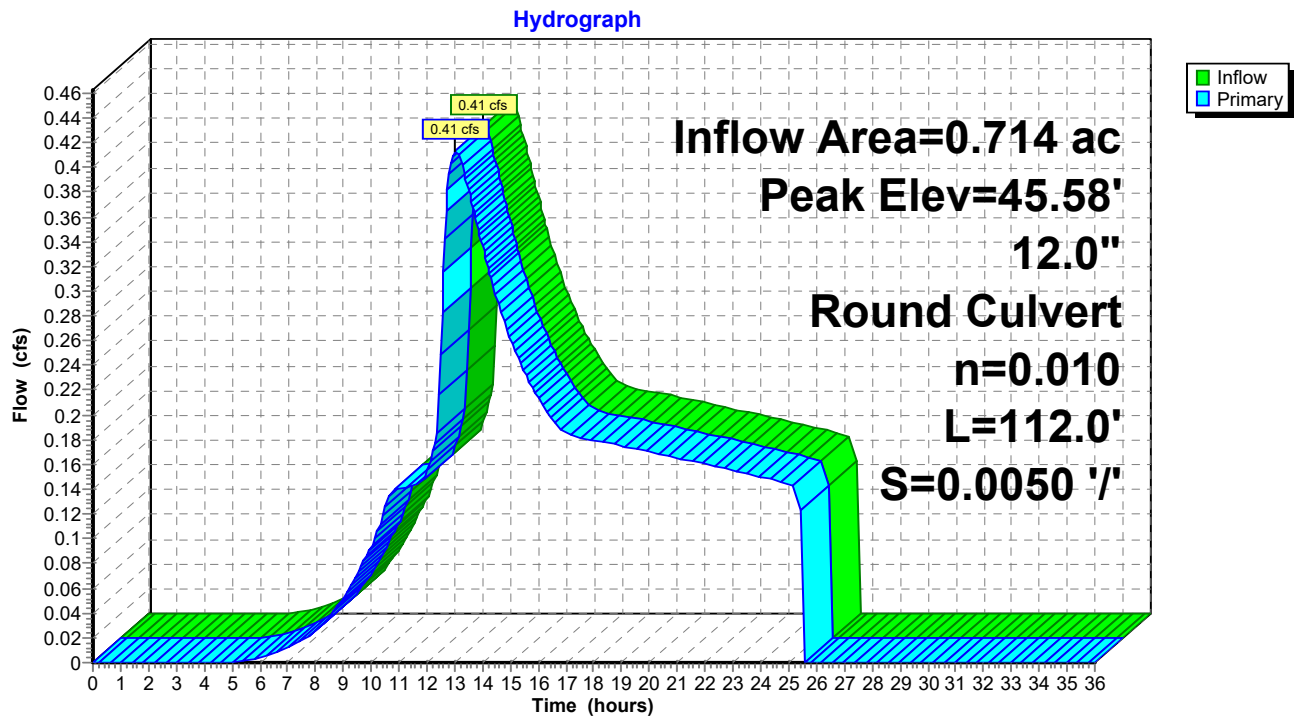

Summary for Pond BB 07 B: BB 07 B


Inflow Area = 0.714 ac, 1.93% Impervious, Inflow Depth = 4.41" for 25 yr event
 Inflow = 0.41 cfs @ 13.02 hrs, Volume= 0.262 af
 Outflow = 0.41 cfs @ 13.02 hrs, Volume= 0.262 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.41 cfs @ 13.02 hrs, Volume= 0.262 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 44.84' @ 13.28 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	44.50'	12.0" Round Culvert L= 88.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 44.50' / 44.06' S= 0.0050 '/ Cc= 0.900 n= 0.010, Flow Area= 0.79 sf

Primary OutFlow Max=0.41 cfs @ 13.02 hrs HW=44.84' TW=44.34' (Dynamic Tailwater)
 1=Culvert (Outlet Controls 0.41 cfs @ 2.60 fps)

Pond BB 07 B: BB 07 B

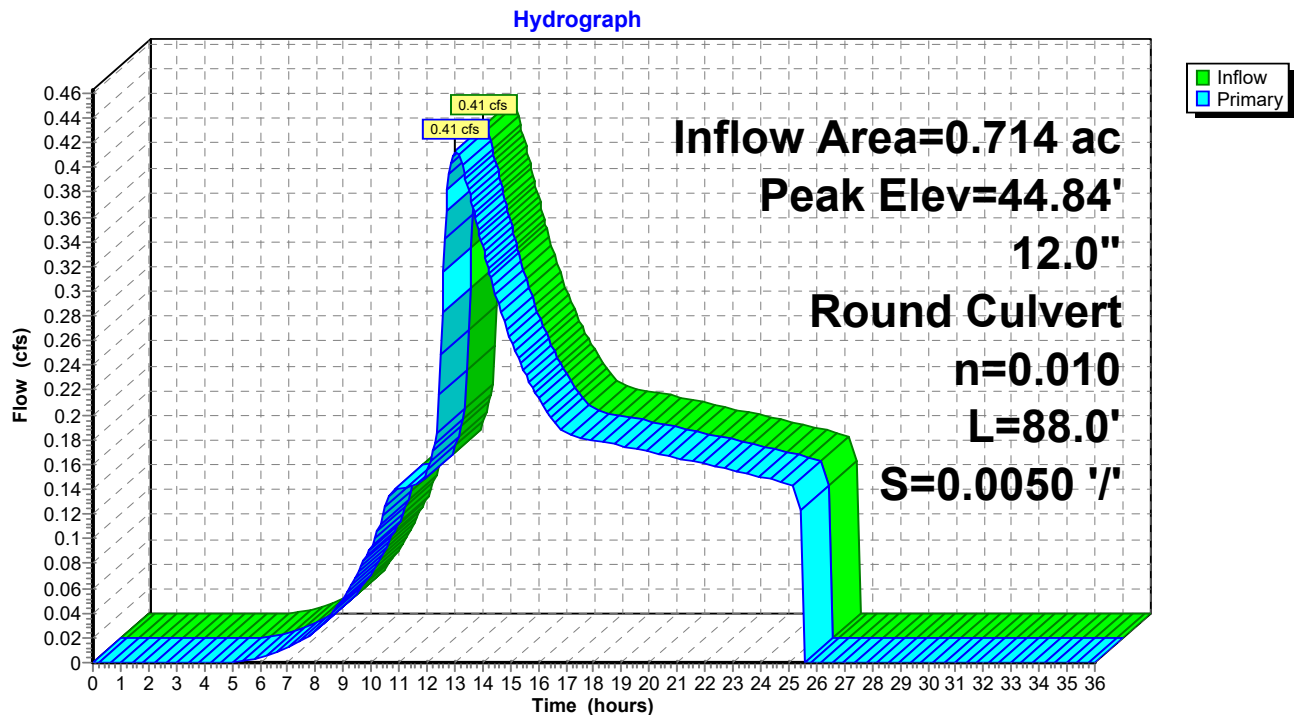

Summary for Pond BB 11 B: BB 11 B


Inflow Area = 1.680 ac, 0.00% Impervious, Inflow Depth = 4.63" for 25 yr event
 Inflow = 3.32 cfs @ 12.87 hrs, Volume= 0.649 af
 Outflow = 3.32 cfs @ 12.87 hrs, Volume= 0.649 af, Atten= 0%, Lag= 0.0 min
 Primary = 3.32 cfs @ 12.87 hrs, Volume= 0.649 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 46.70' @ 12.87 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	45.25'	12.0" Round Culvert L= 8.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 45.25' / 45.12' S= 0.0163 '/ Cc= 0.900 n= 0.020, Flow Area= 0.79 sf

Primary OutFlow Max=3.32 cfs @ 12.87 hrs HW=46.70' TW=45.45' (Dynamic Tailwater)
 1=Culvert (Barrel Controls 3.32 cfs @ 4.22 fps)

Pond BB 11 B: BB 11 B

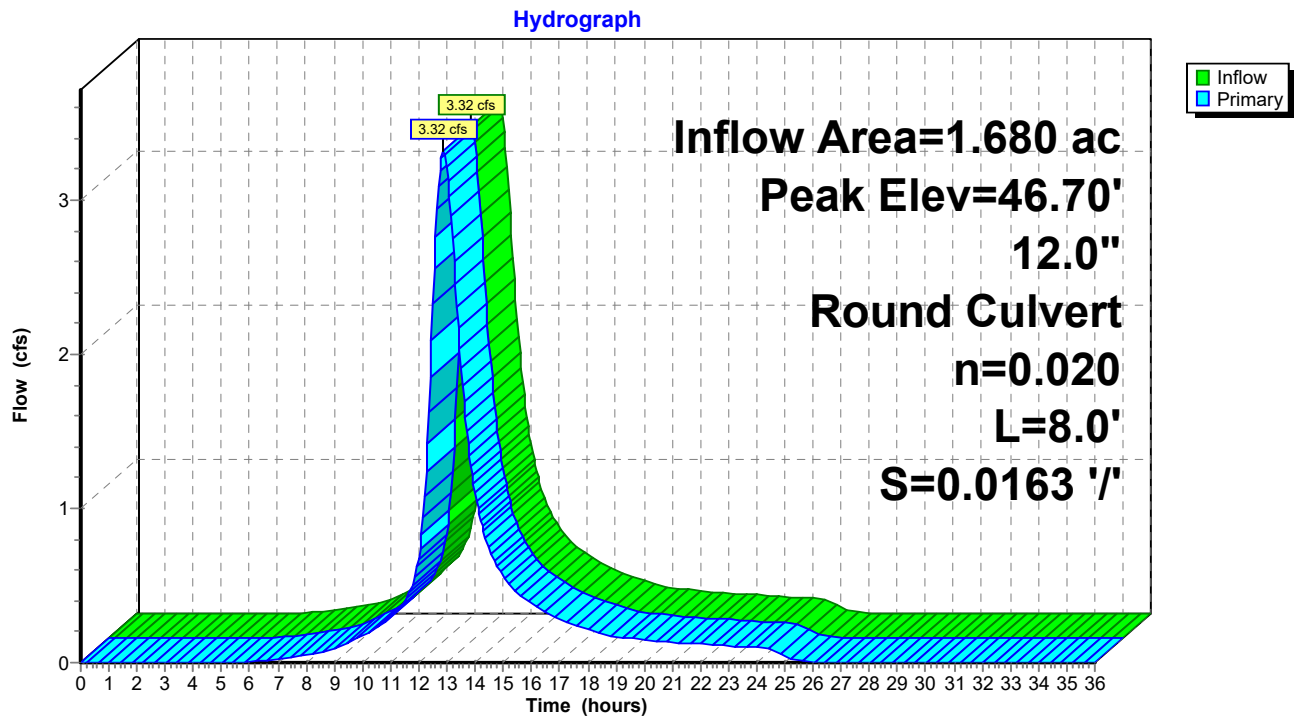

Summary for Pond BB 11 S: BB 11 S

Inflow Area = 1.680 ac, 0.00% Impervious, Inflow Depth = 4.63" for 25 yr event
 Inflow = 3.32 cfs @ 12.87 hrs, Volume= 0.649 af
 Outflow = 2.06 cfs @ 13.44 hrs, Volume= 0.649 af, Atten= 38%, Lag= 34.4 min
 Primary = 2.06 cfs @ 13.44 hrs, Volume= 0.649 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 45.77' @ 13.44 hrs Surf.Area= 0 sf Storage= 5,009 cf

Plug-Flow detention time= 20.3 min calculated for 0.649 af (100% of inflow)
 Center-of-Mass det. time= 19.9 min (874.9 - 855.0)


Volume	Invert	Avail.Storage	Storage Description
#1	44.14'	7,432 cf	Custom Stage Data Listed below

Elevation (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
44.14	0	0
44.97	16	16
45.47	3,131	3,147
45.97	3,156	6,303
46.47	1,129	7,432

Device	Routing	Invert	Outlet Devices
#1	Primary	44.14'	2.5" Vert. Orifice/Grate C= 0.600
#2	Primary	44.47'	8.0" Vert. Orifice/Grate C= 0.600
#3	Primary	45.47'	6.0" Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=2.06 cfs @ 13.44 hrs HW=45.76' TW=44.41' (Dynamic Tailwater)
 1=Orifice/Grate (Orifice Controls 0.19 cfs @ 5.61 fps)
 2=Orifice/Grate (Orifice Controls 1.65 cfs @ 4.72 fps)
 3=Orifice/Grate (Orifice Controls 0.22 cfs @ 1.85 fps)

Pond BB 11 S: BB 11 S

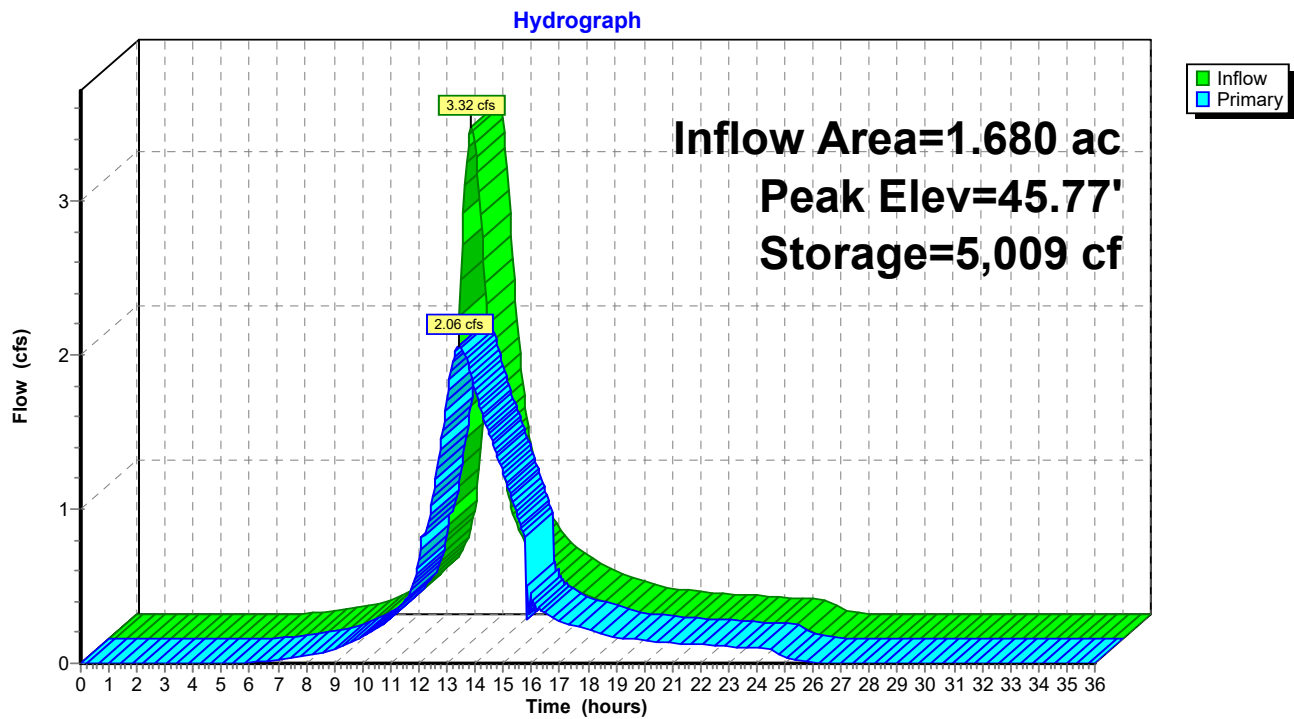

Summary for Pond PR-4: SB 01 DMH


Inflow Area = 1.921 ac, 1.31% Impervious, Inflow Depth = 4.59" for 25 yr event
 Inflow = 3.49 cfs @ 12.84 hrs, Volume= 0.734 af
 Outflow = 3.49 cfs @ 12.84 hrs, Volume= 0.734 af, Atten= 0%, Lag= 0.0 min
 Primary = 3.49 cfs @ 12.84 hrs, Volume= 0.734 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 49.65' @ 12.84 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	48.30'	12.0" Round Culvert L= 50.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 48.30' / 47.80' S= 0.0100 '/ Cc= 0.900 n= 0.010, Flow Area= 0.79 sf

Primary OutFlow Max=3.49 cfs @ 12.84 hrs HW=49.65' TW=0.00' (Dynamic Tailwater)
 1=Culvert (Inlet Controls 3.49 cfs @ 4.44 fps)

Pond PR-4: SB 01 DMH

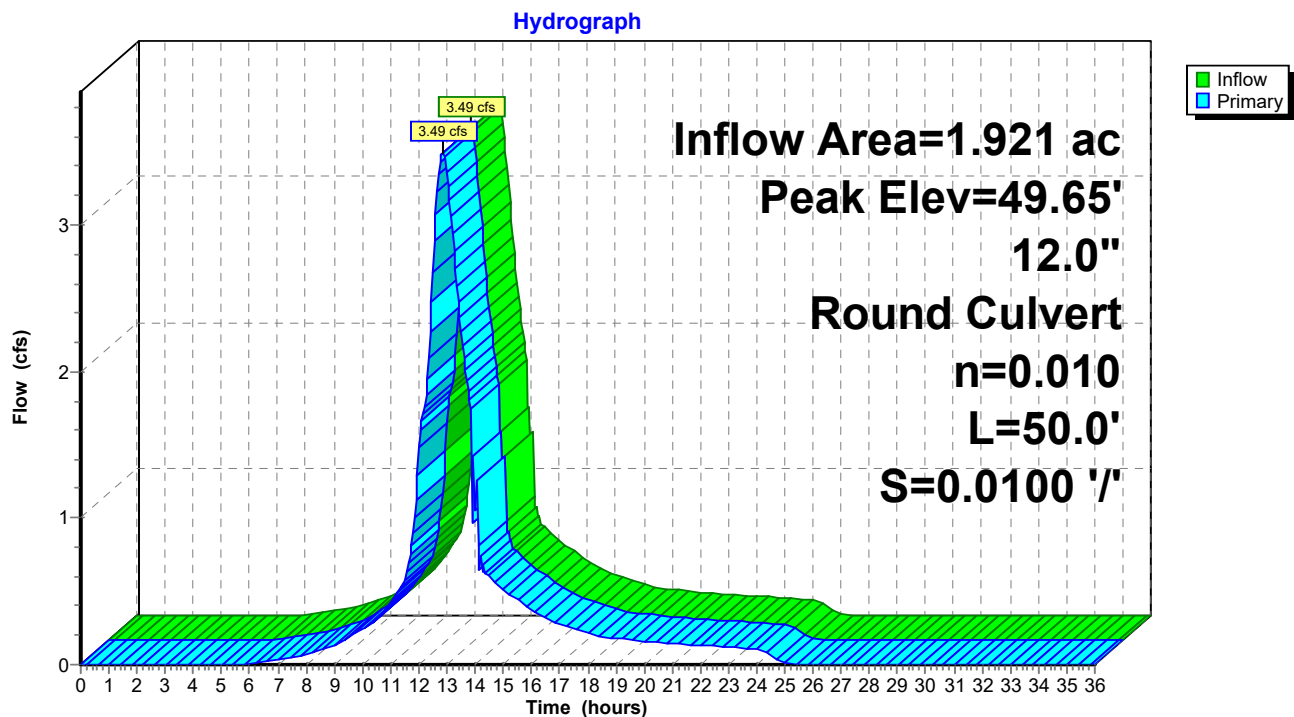

Summary for Pond PR-5: DMH 1


Inflow Area = 2.394 ac, 0.58% Impervious, Inflow Depth = 4.57" for 25 yr event
 Inflow = 2.45 cfs @ 13.41 hrs, Volume= 0.911 af
 Outflow = 2.45 cfs @ 13.41 hrs, Volume= 0.911 af, Atten= 0%, Lag= 0.0 min
 Primary = 2.45 cfs @ 13.41 hrs, Volume= 0.911 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 44.41' @ 13.41 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	43.50'	15.0" Round Culvert L= 10.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 43.50' / 43.40' S= 0.0100 '/ Cc= 0.900 n= 0.010, Flow Area= 1.23 sf

Primary OutFlow Max=2.45 cfs @ 13.41 hrs HW=44.41' TW=0.00' (Dynamic Tailwater)
 1=Culvert (Barrel Controls 2.45 cfs @ 3.59 fps)

Pond PR-5: DMH 1

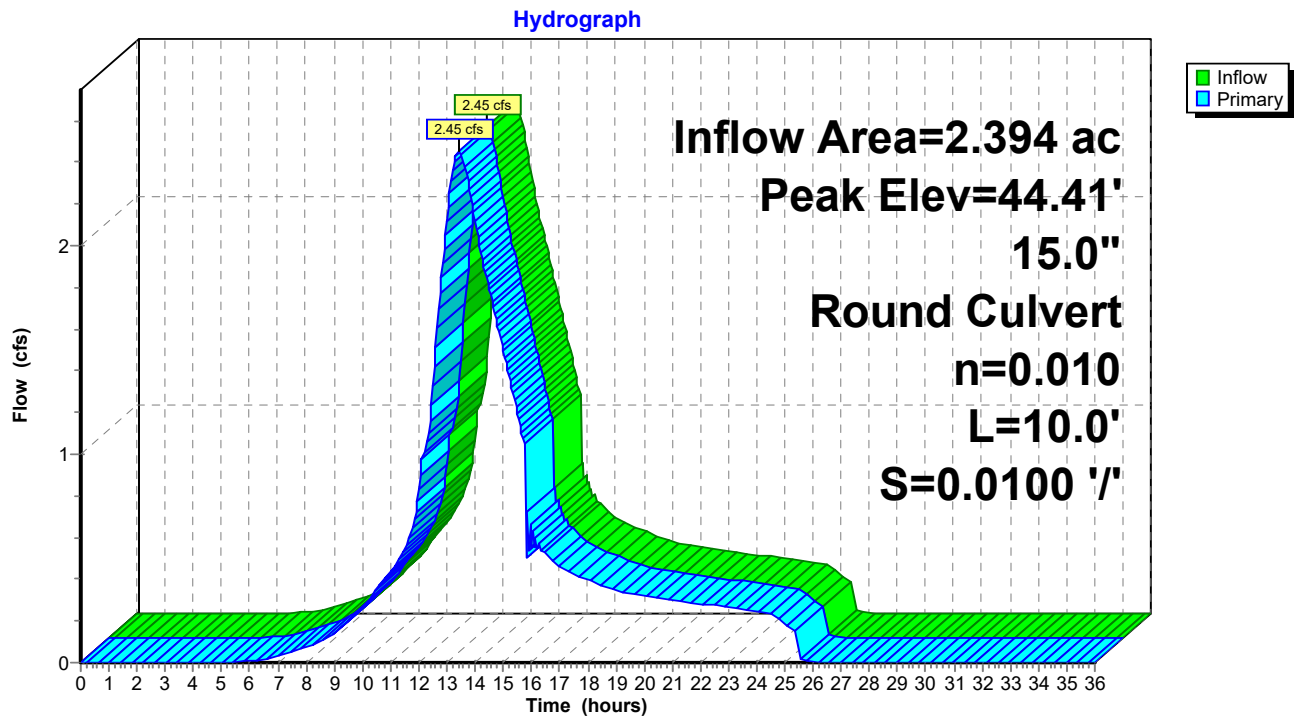

Summary for Pond SB 01 B: SB 01 B


Inflow Area = 1.049 ac, 2.41% Impervious, Inflow Depth = 4.55" for 25 yr event
 Inflow = 2.46 cfs @ 12.56 hrs, Volume= 0.397 af
 Outflow = 2.46 cfs @ 12.56 hrs, Volume= 0.397 af, Atten= 0%, Lag= 0.0 min
 Primary = 2.46 cfs @ 12.56 hrs, Volume= 0.397 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 54.48' @ 12.56 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	52.00'	8.0" Round Culvert L= 8.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 52.00' / 51.92' S= 0.0100 '/ Cc= 0.900 n= 0.010, Flow Area= 0.35 sf

Primary OutFlow Max=2.46 cfs @ 12.56 hrs HW=54.47' TW=51.81' (Dynamic Tailwater)
 1=Culvert (Inlet Controls 2.46 cfs @ 7.04 fps)

Pond SB 01 B: SB 01 B

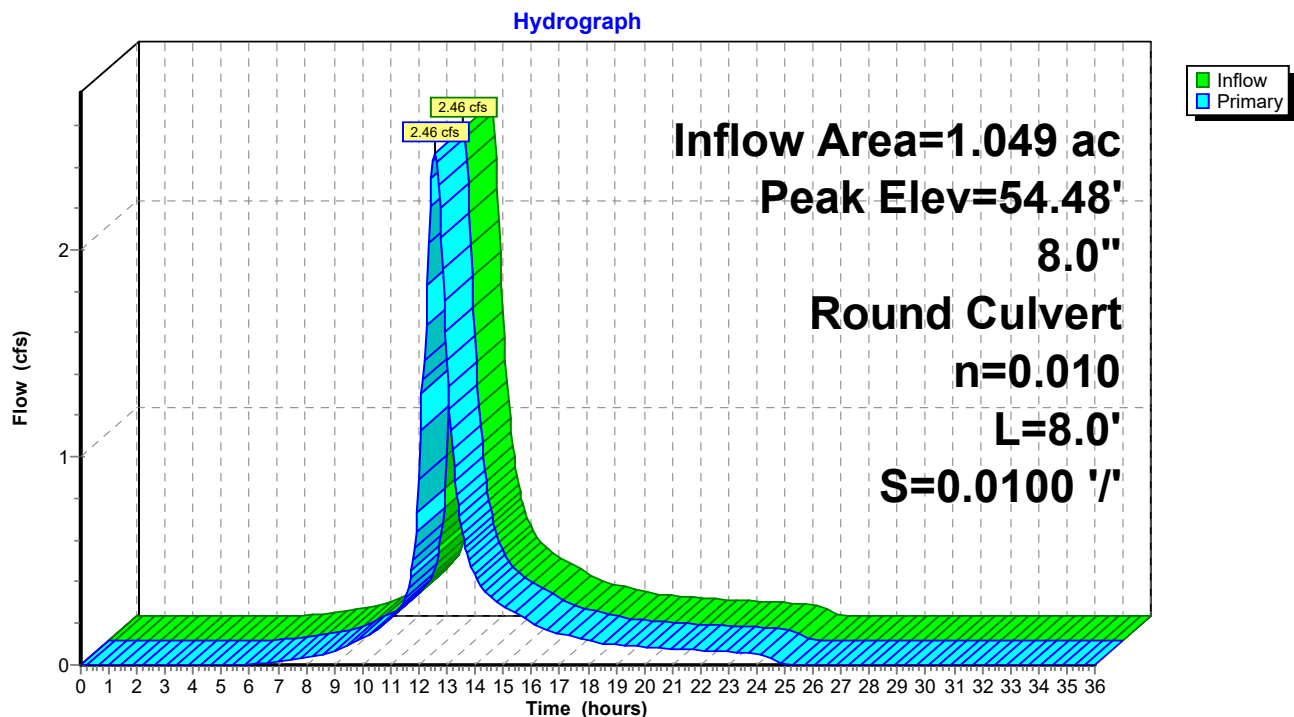

Summary for Pond SB 01 S: SB 01 S

Inflow Area = 1.049 ac, 2.41% Impervious, Inflow Depth = 4.55" for 25 yr event
 Inflow = 2.46 cfs @ 12.56 hrs, Volume= 0.397 af
 Outflow = 1.86 cfs @ 12.86 hrs, Volume= 0.397 af, Atten= 25%, Lag= 18.3 min
 Primary = 1.86 cfs @ 12.86 hrs, Volume= 0.397 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 51.94' @ 12.87 hrs Surf.Area= 0 sf Storage= 2,047 cf

Plug-Flow detention time= 8.4 min calculated for 0.397 af (100% of inflow)
 Center-of-Mass det. time= 8.0 min (839.9 - 832.0)

Volume	Invert	Avail.Storage	Storage Description
#1	50.64'	3,084 cf	Custom Stage Data Listed below


Elevation (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
50.64	0	0
51.47	16	16
51.97	2,170	2,186
52.47	898	3,084

Device	Routing	Invert	Outlet Devices
#1	Primary	50.64'	4.0" Vert. Orifice/Grate C= 0.600
#2	Primary	50.97'	6.0" Vert. Orifice/Grate C= 0.600
#3	Primary	51.47'	8.0" Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=1.85 cfs @ 12.86 hrs HW=51.94' TW=50.81' (Dynamic Tailwater)

1=Orifice/Grate (Orifice Controls 0.45 cfs @ 5.11 fps)
 2=Orifice/Grate (Orifice Controls 0.80 cfs @ 4.08 fps)
 3=Orifice/Grate (Orifice Controls 0.61 cfs @ 2.33 fps)

Pond SB 01 S: SB 01 S

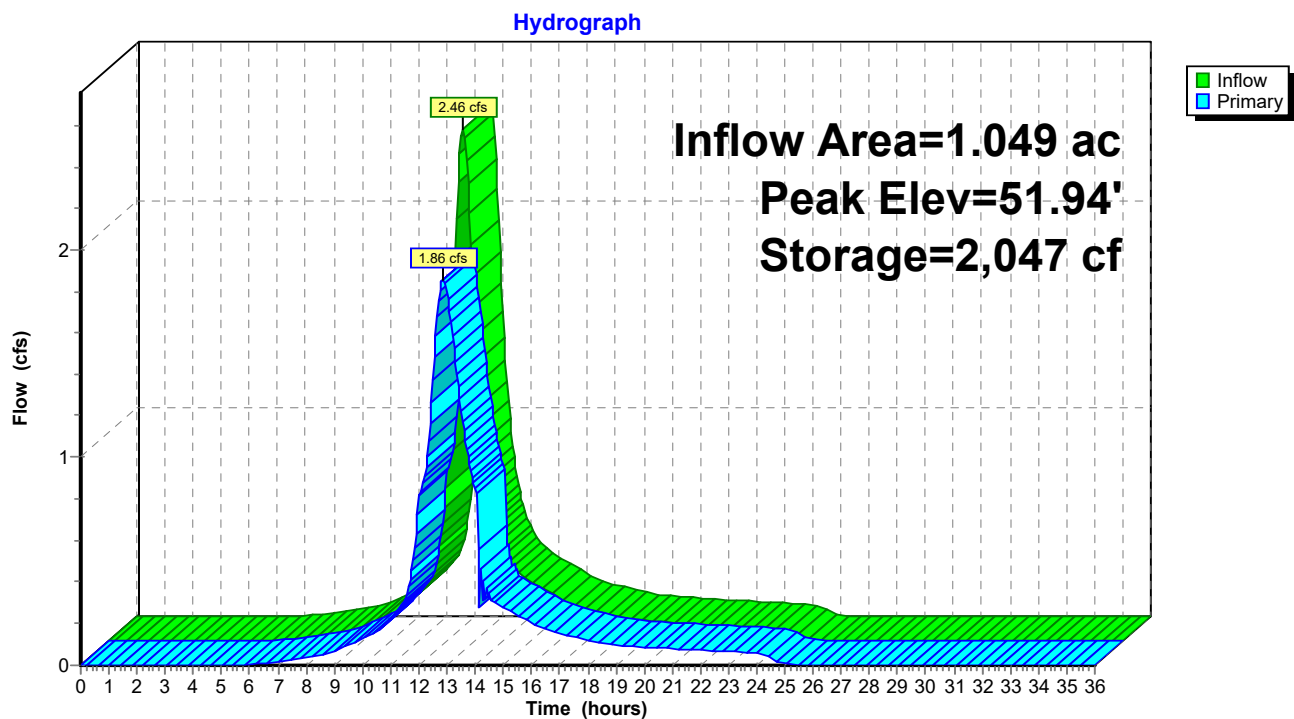

Summary for Pond SB 02 B: SB 02 B


Inflow Area = 1.049 ac, 2.41% Impervious, Inflow Depth = 4.55" for 25 yr event
 Inflow = 1.86 cfs @ 12.86 hrs, Volume= 0.397 af
 Outflow = 1.86 cfs @ 12.86 hrs, Volume= 0.397 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.86 cfs @ 12.86 hrs, Volume= 0.397 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 50.81' @ 12.86 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	49.97'	12.0" Round Culvert L= 12.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 49.97' / 49.85' S= 0.0100 '/ Cc= 0.900 n= 0.010, Flow Area= 0.79 sf

Primary OutFlow Max=1.86 cfs @ 12.86 hrs HW=50.81' TW=49.65' (Dynamic Tailwater)
 1=Culvert (Barrel Controls 1.86 cfs @ 3.55 fps)

Pond SB 02 B: SB 02 B

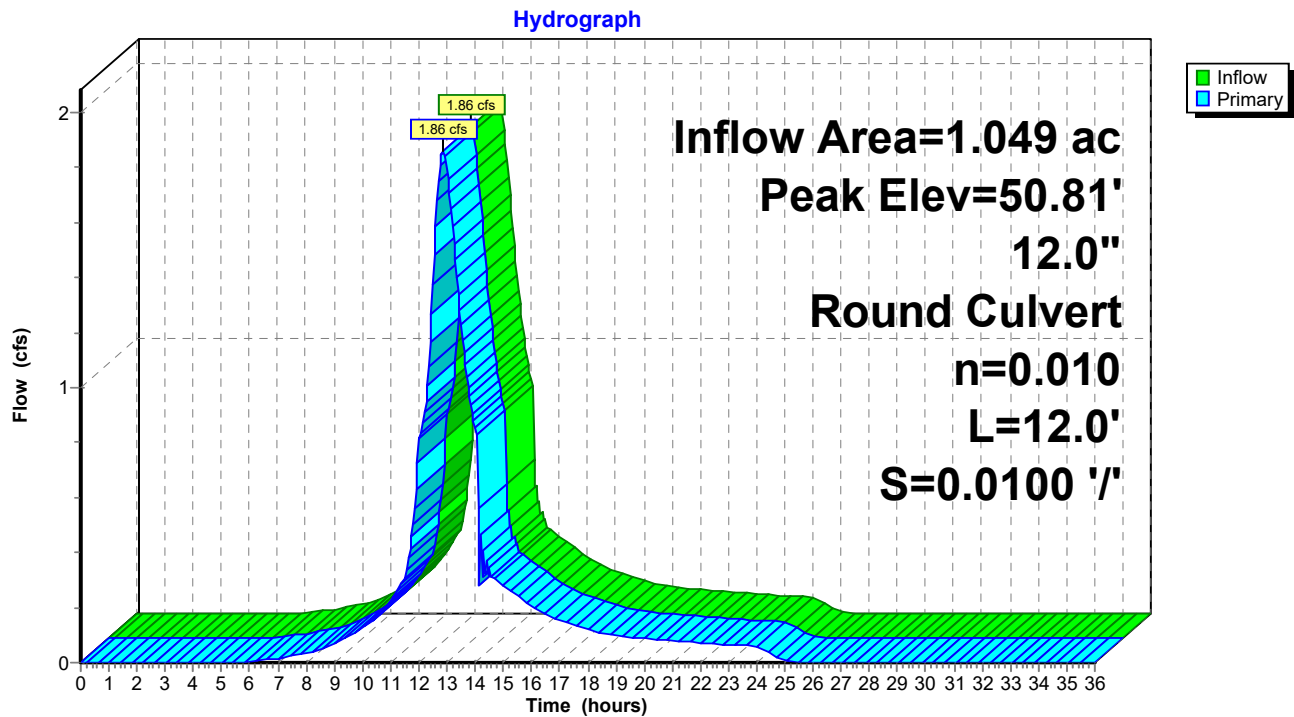

Summary for Pond SB 11 B: SB 11 B


Inflow Area = 0.872 ac, 0.00% Impervious, Inflow Depth = 4.63" for 25 yr event
 Inflow = 2.37 cfs @ 12.50 hrs, Volume= 0.337 af
 Outflow = 2.37 cfs @ 12.50 hrs, Volume= 0.337 af, Atten= 0%, Lag= 0.0 min
 Primary = 2.37 cfs @ 12.50 hrs, Volume= 0.337 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 54.33' @ 12.50 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	52.00'	8.0" Round Culvert L= 24.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 52.00' / 51.76' S= 0.0100 '/ Cc= 0.900 n= 0.010, Flow Area= 0.35 sf

Primary OutFlow Max=2.37 cfs @ 12.50 hrs HW=54.32' TW=51.96' (Dynamic Tailwater)
 1=Culvert (Inlet Controls 2.37 cfs @ 6.79 fps)

Pond SB 11 B: SB 11 B

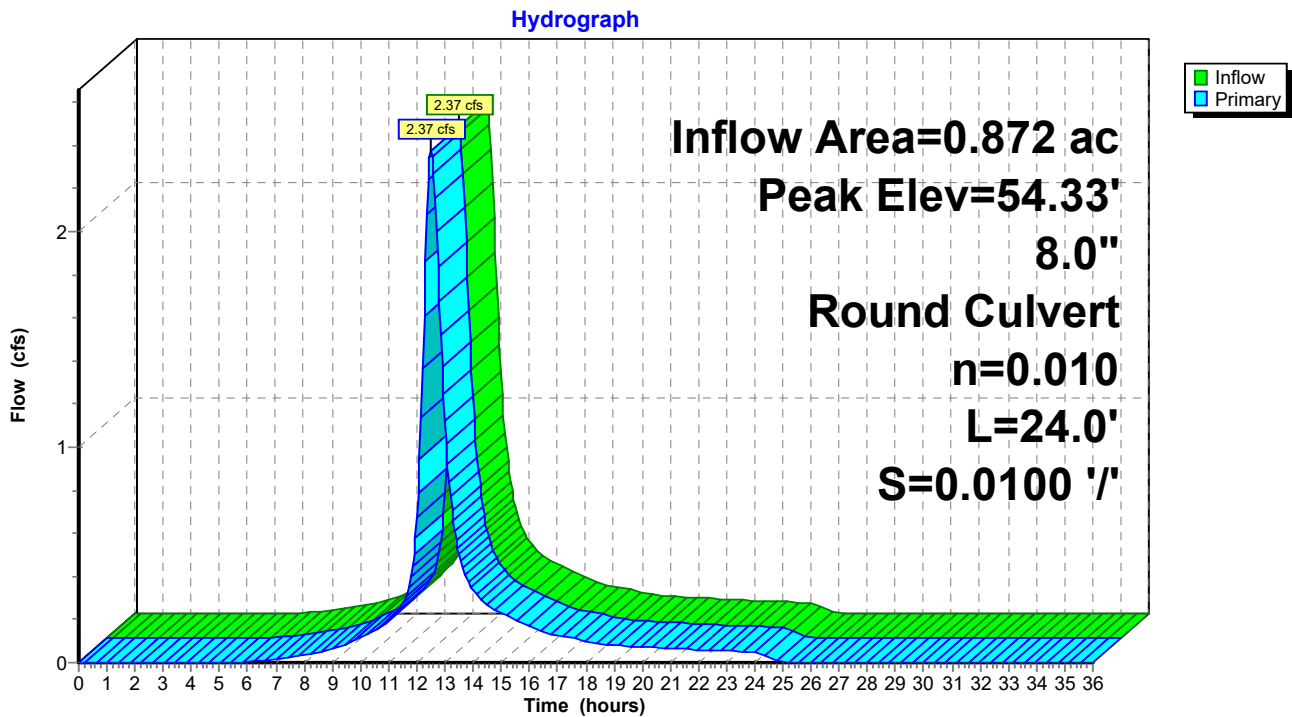

Summary for Pond SB 11 S: SB 11 S

Inflow Area = 0.872 ac, 0.00% Impervious, Inflow Depth = 4.63" for 25 yr event
 Inflow = 2.37 cfs @ 12.50 hrs, Volume= 0.337 af
 Outflow = 1.64 cfs @ 12.81 hrs, Volume= 0.337 af, Atten= 31%, Lag= 18.6 min
 Primary = 1.64 cfs @ 12.81 hrs, Volume= 0.337 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 52.11' @ 12.81 hrs Surf.Area= 0 sf Storage= 1,803 cf

Plug-Flow detention time= (not calculated: outflow precedes inflow)
 Center-of-Mass det. time= 7.3 min (834.9 - 827.7)

Volume	Invert	Avail.Storage	Storage Description
#1	50.84'	2,892 cf	Custom Stage Data Listed below


Elevation (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
50.84	0	0
51.67	16	16
52.17	2,035	2,051
52.67	841	2,892

Device	Routing	Invert	Outlet Devices
#1	Primary	50.84'	4.0" Vert. Orifice/Grate C= 0.600
#2	Primary	51.17'	6.0" Vert. Orifice/Grate C= 0.600
#3	Primary	51.67'	6.0" Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=1.64 cfs @ 12.81 hrs HW=52.11' TW=50.86' (Dynamic Tailwater)

1=Orifice/Grate (Orifice Controls 0.44 cfs @ 5.05 fps)
 2=Orifice/Grate (Orifice Controls 0.78 cfs @ 3.99 fps)
 3=Orifice/Grate (Orifice Controls 0.41 cfs @ 2.25 fps)

Pond SB 11 S: SB 11 S

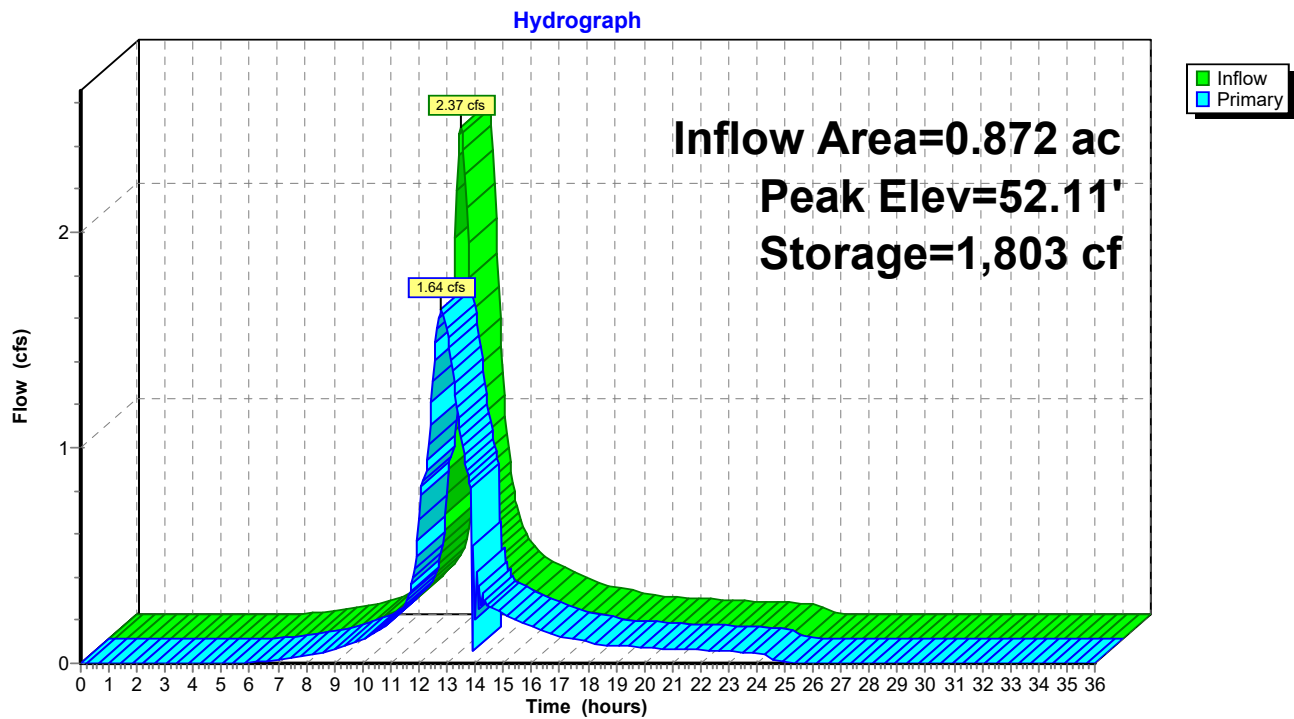

Summary for Pond SB 12 B: SB 12 B


Inflow Area = 0.872 ac, 0.00% Impervious, Inflow Depth = 4.63" for 25 yr event
 Inflow = 1.64 cfs @ 12.81 hrs, Volume= 0.337 af
 Outflow = 1.64 cfs @ 12.81 hrs, Volume= 0.337 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.64 cfs @ 12.81 hrs, Volume= 0.337 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 50.86' @ 12.81 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	50.17'	12.0" Round Culvert L= 160.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 50.17' / 48.57' S= 0.0100 '/ Cc= 0.900 n= 0.010, Flow Area= 0.79 sf

Primary OutFlow Max=1.64 cfs @ 12.81 hrs HW=50.86' TW=49.65' (Dynamic Tailwater)
 1=Culvert (Inlet Controls 1.64 cfs @ 2.83 fps)

Pond SB 12 B: SB 12 B

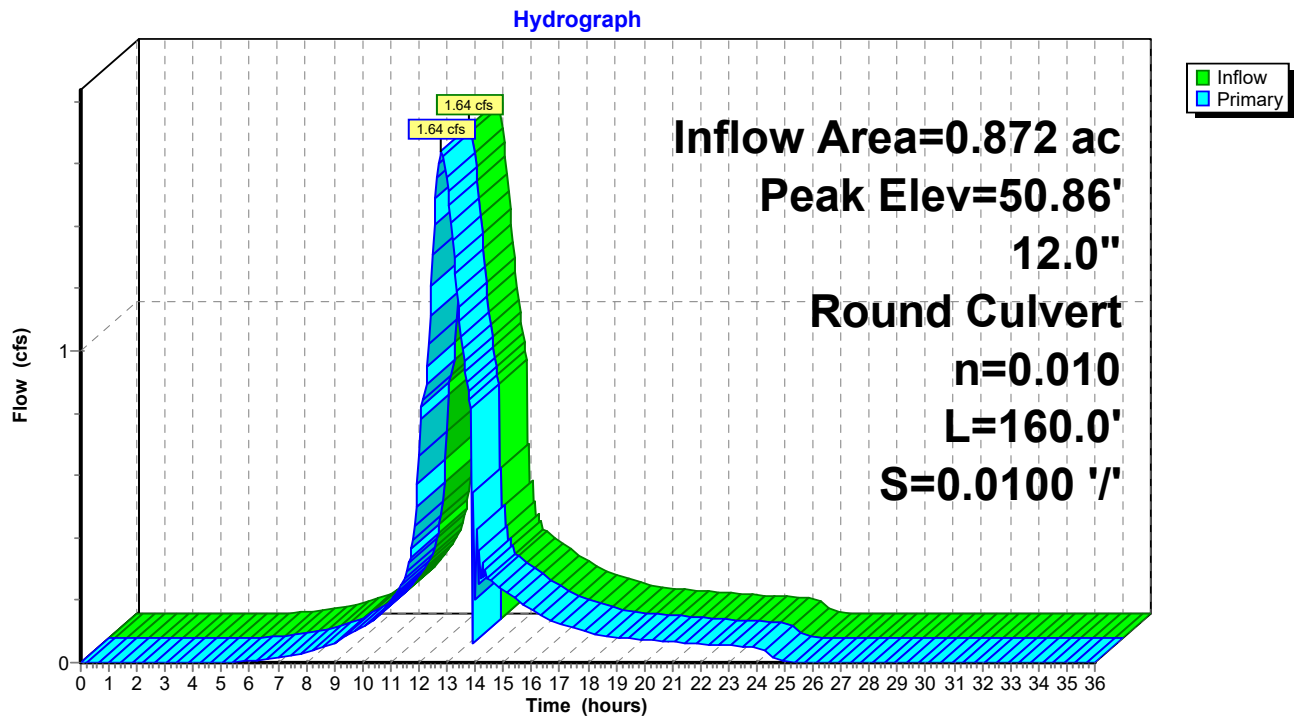


Summary for Link POA: POA

Inflow Area = 17.400 ac, 49.60% Impervious, Inflow Depth > 4.52" for 25 yr event
Inflow = 64.17 cfs @ 12.11 hrs, Volume= 6.559 af
Primary = 64.17 cfs @ 12.11 hrs, Volume= 6.559 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Link POA: POA

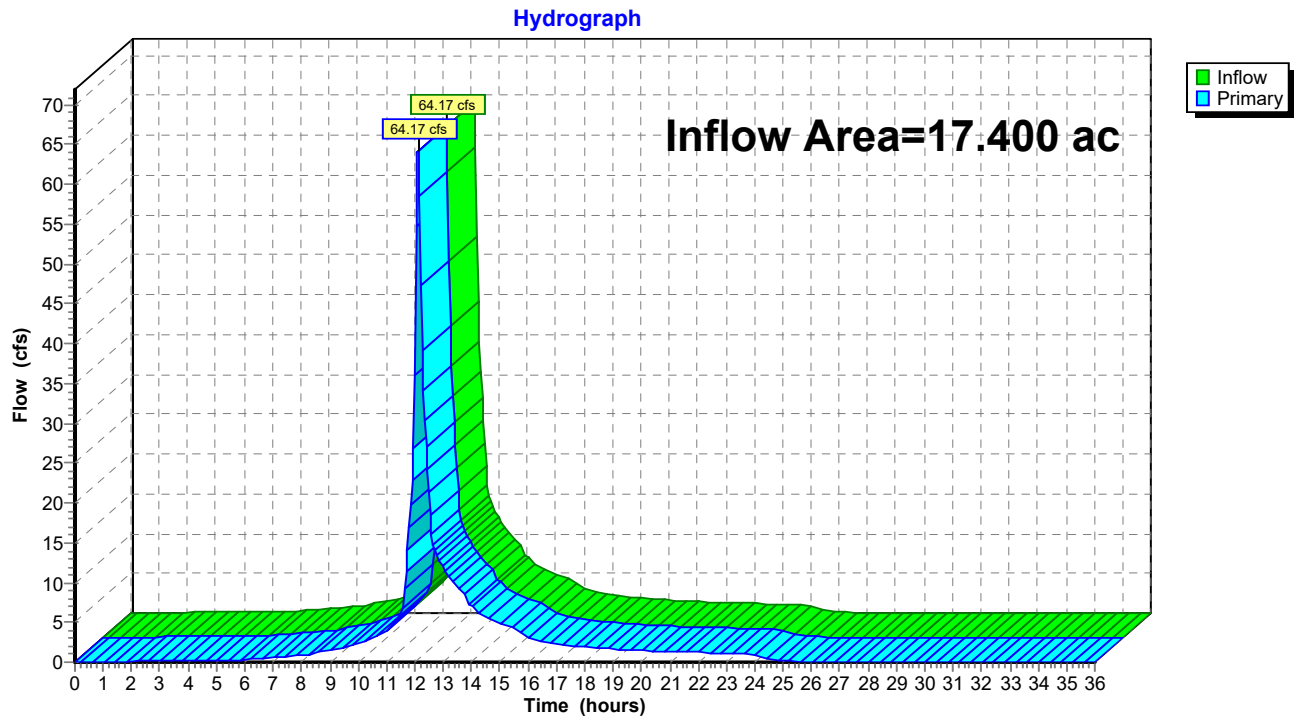

Summary for Subcatchment PR-1: PR-1

Runoff = 26.79 cfs @ 12.13 hrs, Volume= 2.209 af, Depth= 6.02"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 100 yr Rainfall=8.17"

Area (ac)	CN	Description
1.892	61	>75% Grass cover, Good, HSG B
2.510	98	Paved parking, HSG B
4.402	82	Weighted Average
1.892		42.98% Pervious Area
2.510		57.02% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.2	50	0.0050	0.69		Sheet Flow, A-B
					Smooth surfaces n= 0.011 P2= 3.20"
7.9	234	0.0050	0.49		Shallow Concentrated Flow, B-C
					Short Grass Pasture Kv= 7.0 fps
9.1	284	Total			

Subcatchment PR-1: PR-1

Hydrograph

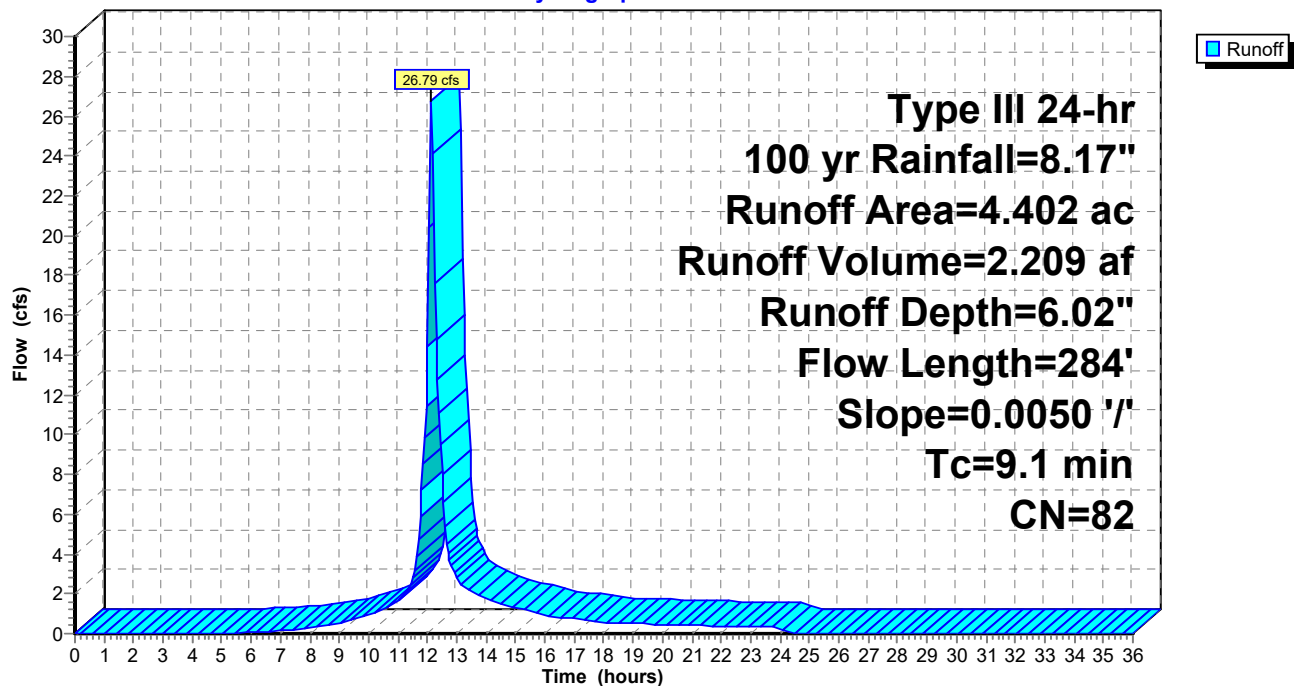

Summary for Subcatchment PR-1A: PR-1A


Runoff = 3.54 cfs @ 12.09 hrs, Volume= 0.278 af, Depth= 7.09"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 100 yr Rainfall=8.17"

Area (ac)	CN	Description
0.090	61	>75% Grass cover, Good, HSG B
0.380	98	Paved parking, HSG B
0.470	91	Weighted Average
0.090		19.15% Pervious Area
0.380		80.85% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-1A: PR-1A

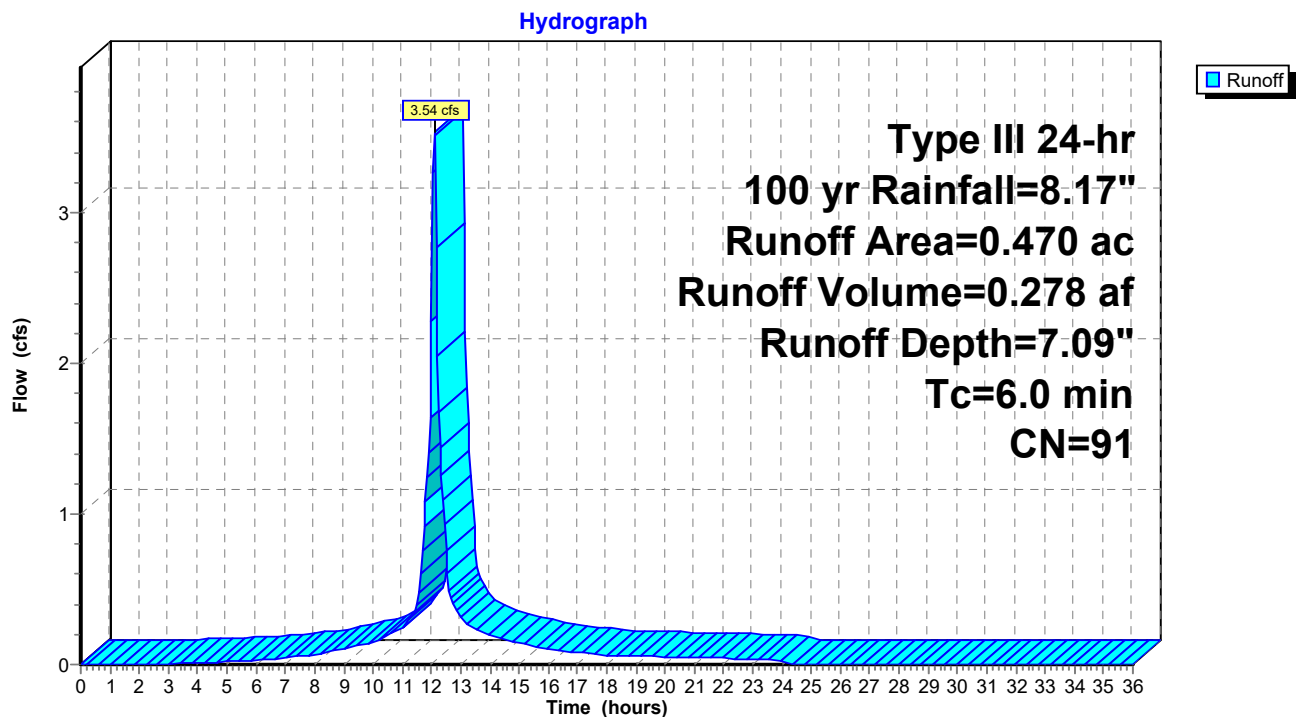

Summary for Subcatchment PR-1B: PR-1B

Runoff = 14.58 cfs @ 12.09 hrs, Volume= 1.230 af, Depth= 7.93"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 100 yr Rainfall=8.17"

Area (ac)	CN	Description
1.861	98	Roofs, HSG B
1.861		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-1B: PR-1B

Hydrograph

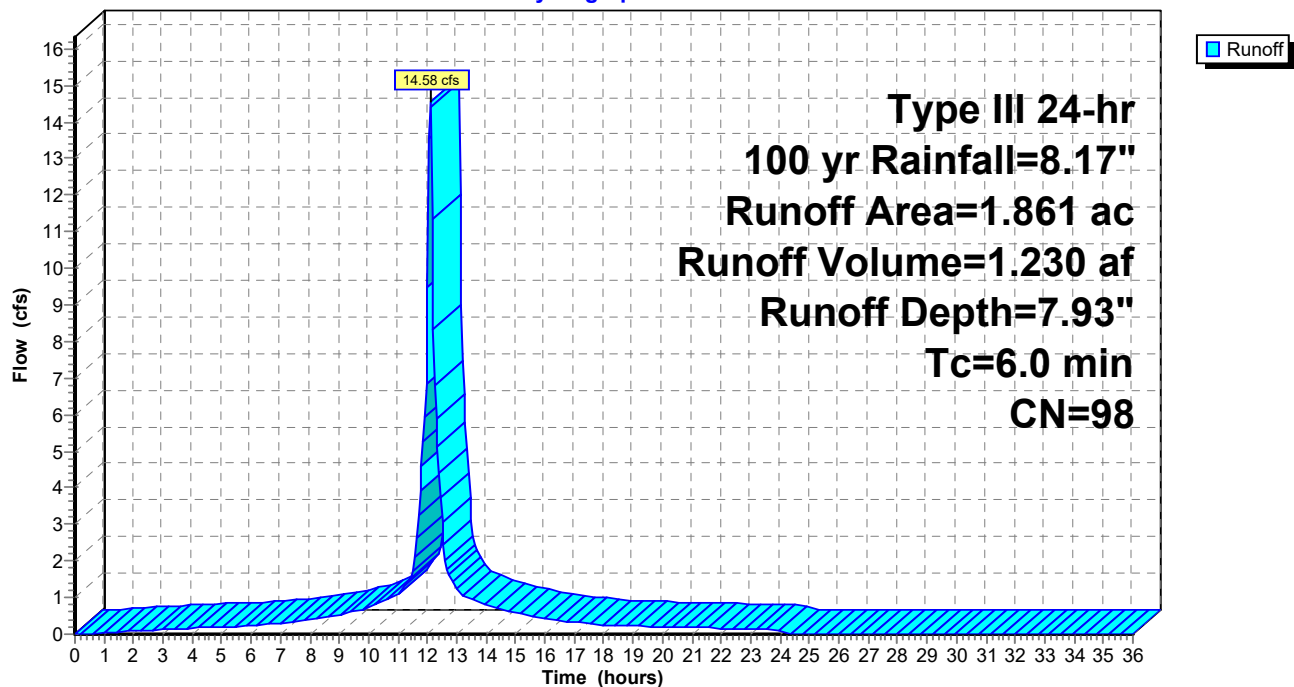

Summary for Subcatchment PR-1C: PR-1C


Runoff = 2.73 cfs @ 12.09 hrs, Volume= 0.199 af, Depth= 5.20"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 100 yr Rainfall=8.17"

Area (ac)	CN	Description
0.020	55	Woods, Good, HSG B
0.260	61	>75% Grass cover, Good, HSG B
0.180	98	Paved parking, HSG B
0.460	75	Weighted Average
0.280		60.87% Pervious Area
0.180		39.13% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.6	20	0.0700	0.09		Sheet Flow, 20' SF Woods: Light underbrush n= 0.400 P2= 3.20"
1.9	40	0.5000	0.35		Sheet Flow, 30' SF Grass: Dense n= 0.240 P2= 3.20"
0.1	12	0.0100	1.61		Shallow Concentrated Flow, 12' SCF Unpaved Kv= 16.1 fps
0.2	48	0.0400	4.06		Shallow Concentrated Flow, 48' SCF Paved Kv= 20.3 fps
5.8	120	Total, Increased to minimum Tc = 6.0 min			

Subcatchment PR-1C: PR-1C

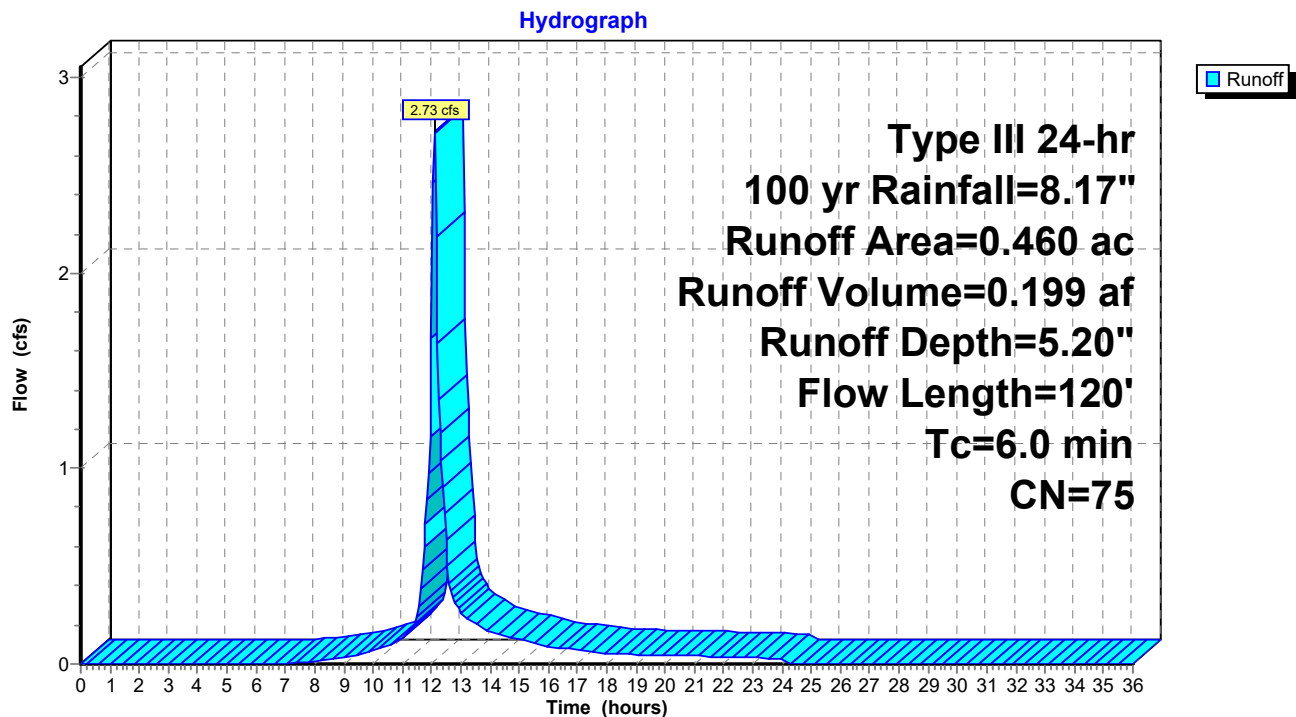

Summary for Subcatchment PR-1D: PR-1D

Runoff = 11.76 cfs @ 12.09 hrs, Volume= 0.992 af, Depth= 7.93"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 100 yr Rainfall=8.17"

Area (ac)	CN	Description
1.501	98	Roofs, HSG B
1.501		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-1D: PR-1D

Hydrograph

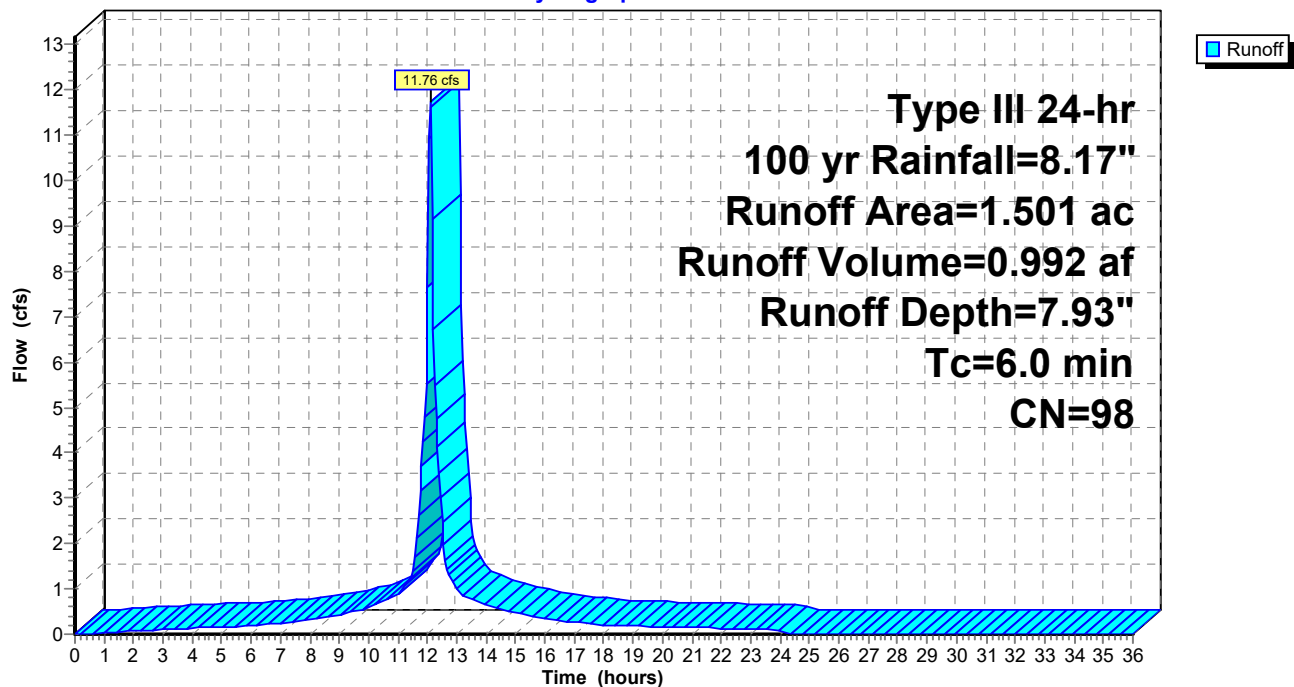

Summary for Subcatchment PR-1E: PR-1E


Runoff = 7.37 cfs @ 12.17 hrs, Volume= 0.649 af, Depth= 5.08"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 100 yr Rainfall=8.17"

Area (ac)	CN	Description
1.000	61	>75% Grass cover, Good, HSG B
0.533	98	Paved parking, HSG B
1.533	74	Weighted Average
1.000		65.23% Pervious Area
0.533		34.77% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.8	50	0.0050	0.09		Sheet Flow, 50' SF
					Grass: Short n= 0.150 P2= 3.20"
2.5	170	0.0050	1.14		Shallow Concentrated Flow, 170' SCF
					Unpaved Kv= 16.1 fps
12.3	220	Total			

Subcatchment PR-1E: PR-1E

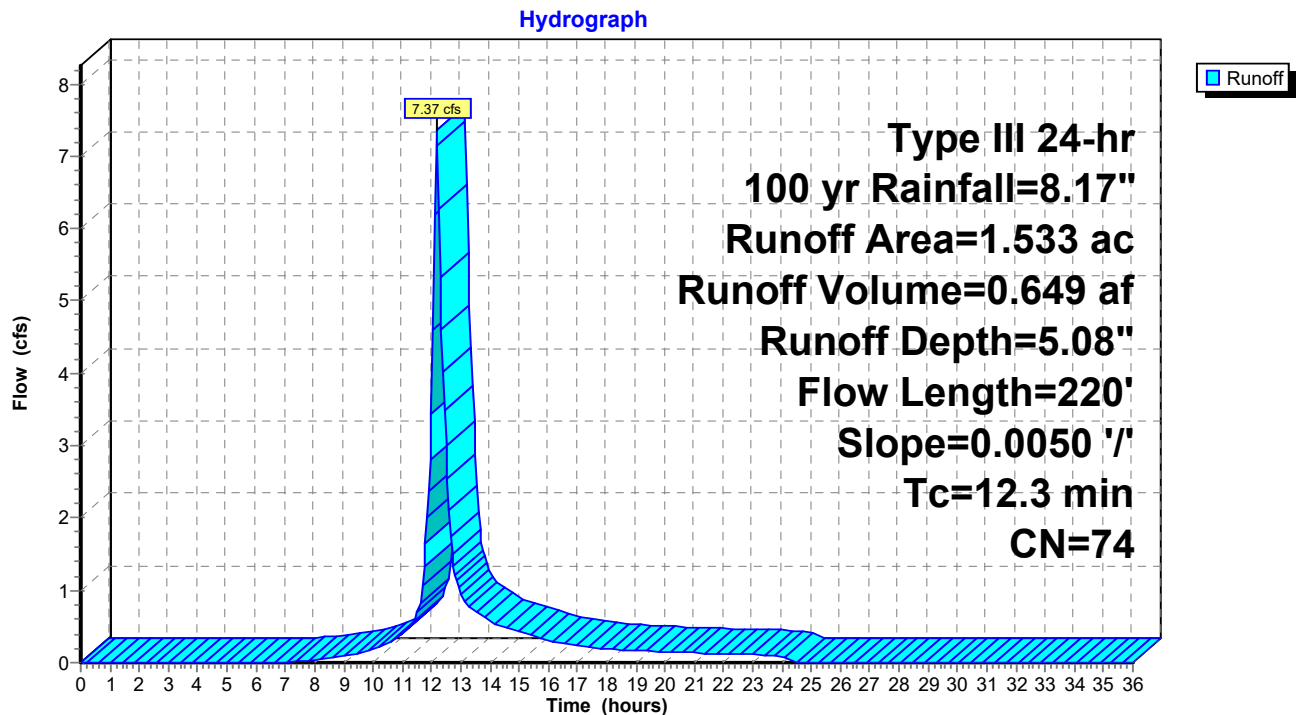

Summary for Subcatchment PR-2: PR-2

Runoff = 9.55 cfs @ 12.09 hrs, Volume= 0.708 af, Depth= 5.90"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
Type III 24-hr 100 yr Rainfall=8.17"

Area (ac)	CN	Description
0.672	61	>75% Grass cover, Good, HSG B
0.768	98	Paved parking, HSG B
1.440	81	Weighted Average
0.672		46.67% Pervious Area
0.768		53.33% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-2: PR-2

Hydrograph

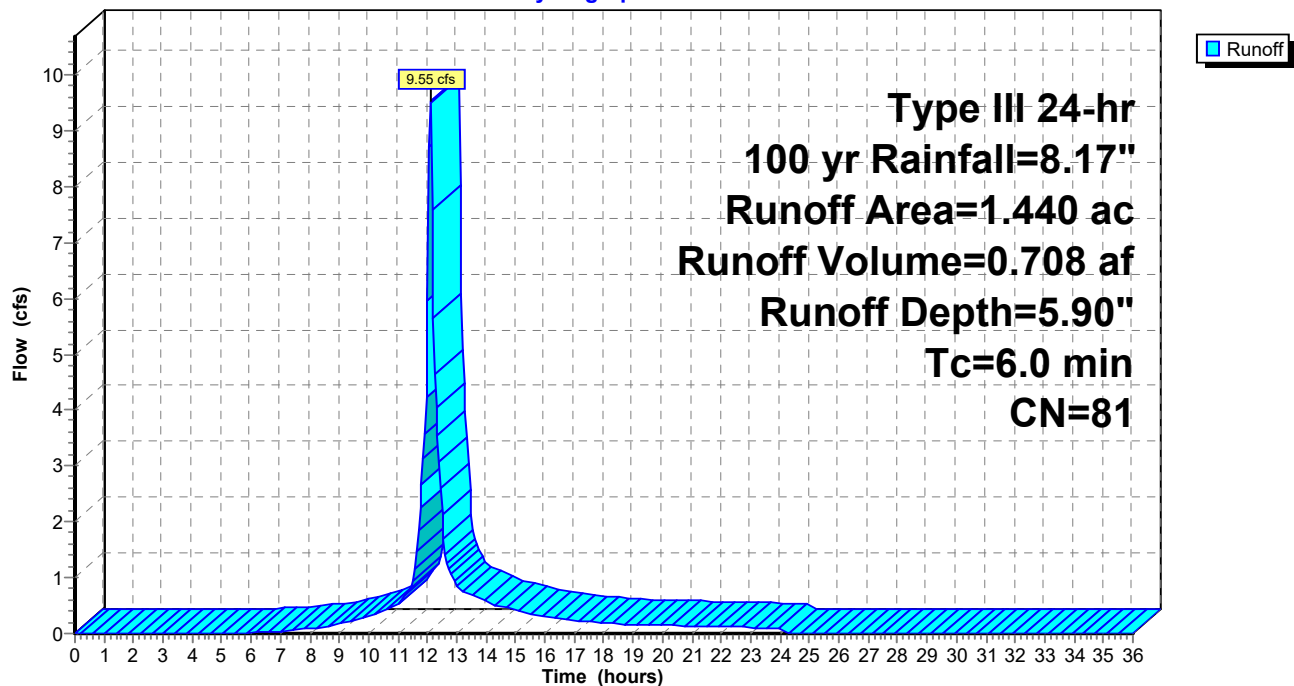

Summary for Subcatchment PR-2B: PR-2B

Runoff = 2.08 cfs @ 12.09 hrs, Volume= 0.175 af, Depth= 7.93"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 100 yr Rainfall=8.17"

Area (ac)	CN	Description
0.265	98	Roofs, HSG B
0.265		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-2B: PR-2B

Hydrograph

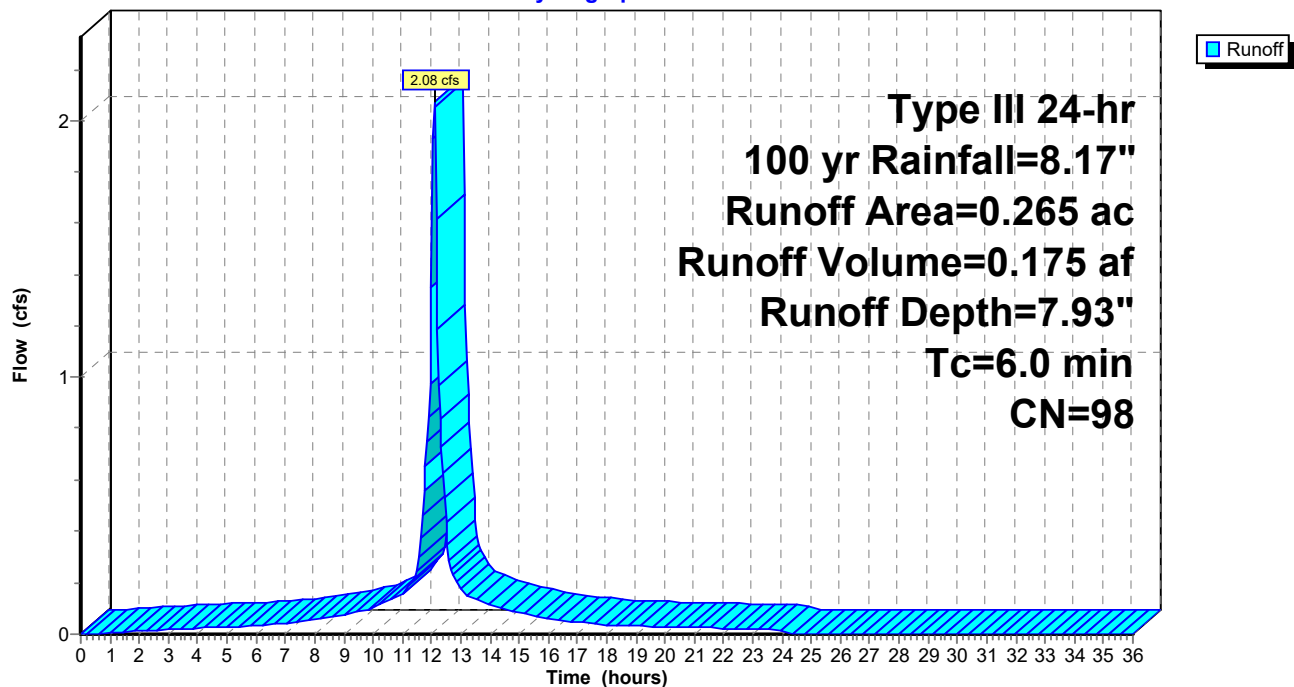

Summary for Subcatchment PR-3A: PR-3A


Runoff = 5.10 cfs @ 12.09 hrs, Volume= 0.385 af, Depth= 6.38"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 100 yr Rainfall=8.17"

Area (ac)	CN	Description
0.249	61	>75% Grass cover, Good, HSG B
0.476	98	Paved parking, HSG B
0.725	85	Weighted Average
0.249		34.34% Pervious Area
0.476		65.66% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-3A: PR-3A

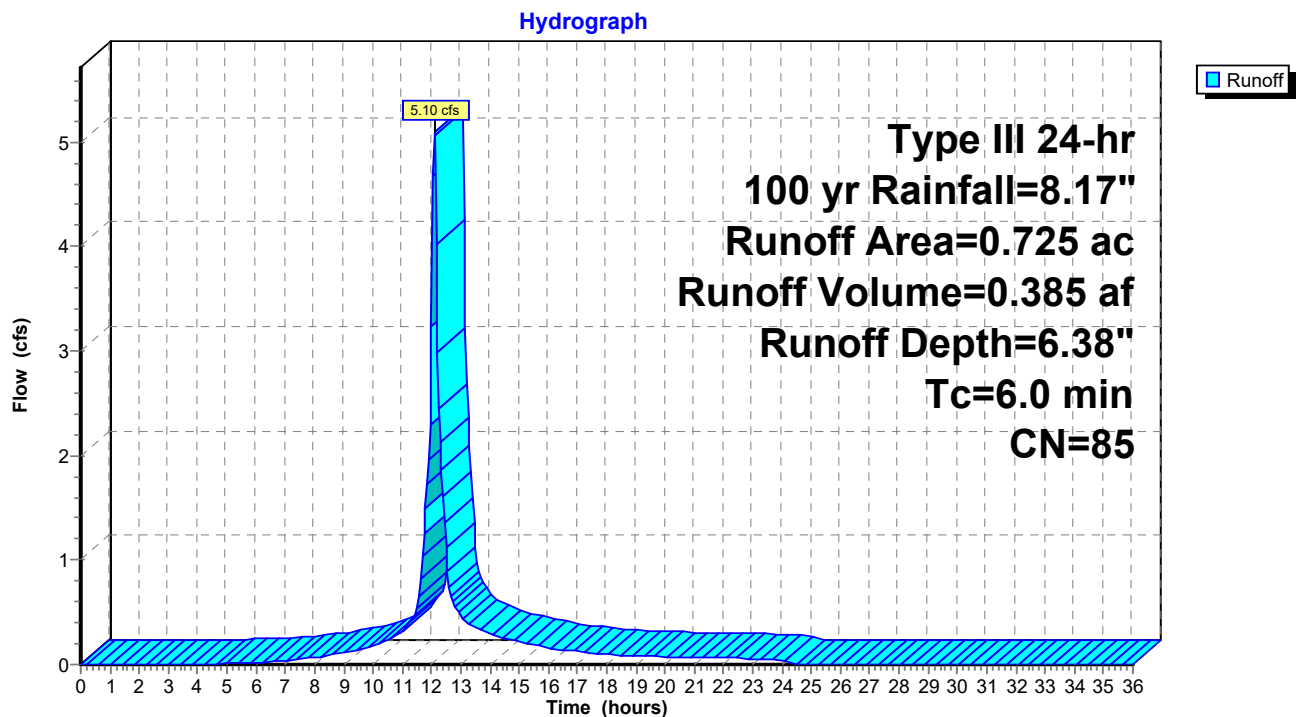

Summary for Subcatchment PR-3B: PR-3B


Runoff = 1.54 cfs @ 12.09 hrs, Volume= 0.114 af, Depth= 5.67"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 100 yr Rainfall=8.17"

Area (ac)	CN	Description
0.124	61	>75% Grass cover, Good, HSG B
0.117	98	Paved parking, HSG B
0.241	79	Weighted Average
0.124		51.45% Pervious Area
0.117		48.55% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-3B: PR-3B

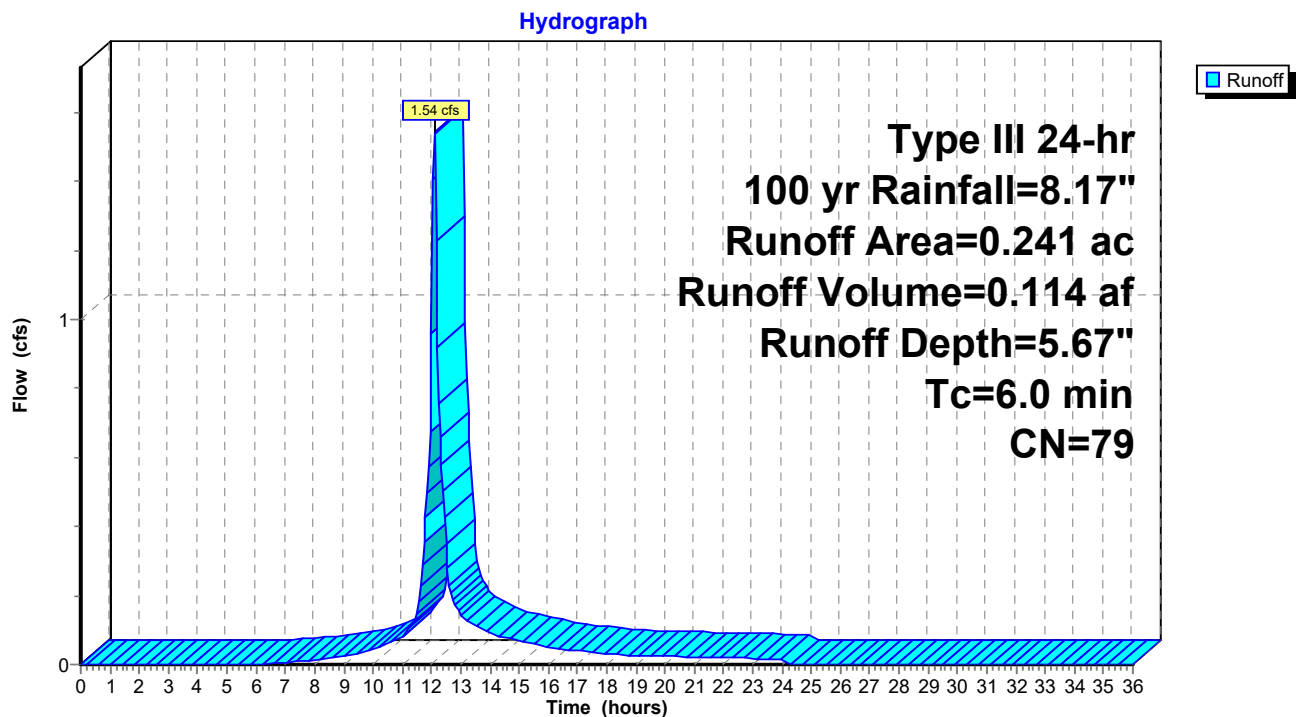

Summary for Subcatchment PR-3C: PR-3C

Runoff = 0.76 cfs @ 12.10 hrs, Volume= 0.055 af, Depth= 3.57"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 100 yr Rainfall=8.17"

Area (ac)	CN	Description
0.186	61	>75% Grass cover, Good, HSG B
0.186		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment PR-3C: PR-3C

Hydrograph

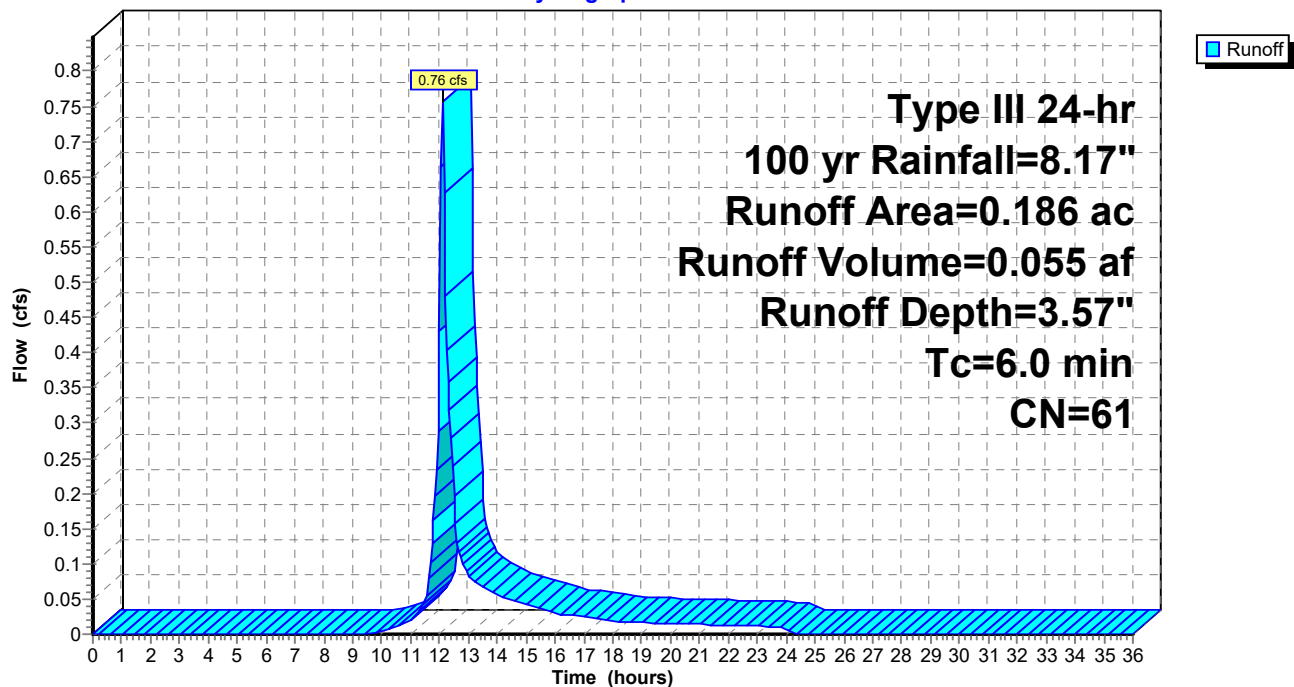

Summary for Subcatchment PR-4A: SB 01 A


Runoff = 3.23 cfs @ 12.57 hrs, Volume= 0.500 af, Depth= 6.38"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 100 yr Rainfall=8.17"

Area (sf)	CN	Description
* 41,000	85	SYNTHETIC TURF- PAD- LINER
41,000		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
39.6	110	0.0055	0.05		Sheet Flow, Through Turf Section Grass: Bermuda n= 0.410 P2= 3.20"
3.7	100	0.0001	0.45	0.16	Pipe Channel, TRENCH DRAIN LEVEL 8.0" Round Area= 0.3 sf Perim= 2.1' r= 0.17' n= 0.010
43.3	210	Total			

Subcatchment PR-4A: SB 01 A

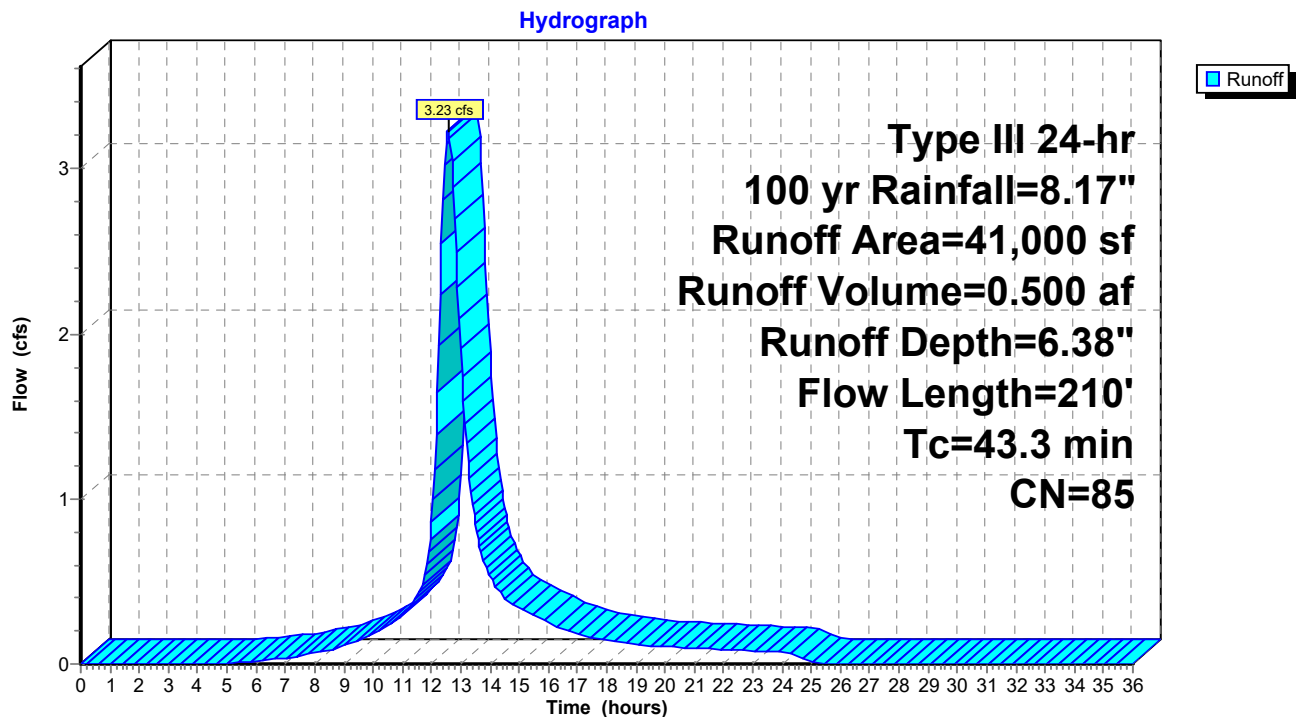

Summary for Subcatchment PR-4B: SB 11 A


Runoff = 3.22 cfs @ 12.50 hrs, Volume= 0.464 af, Depth= 6.38"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 100 yr Rainfall=8.17"

Area (sf)	CN	Description
* 38,000	85	SYNTHETIC TURF- PAD- LINER
38,000		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
33.7	90	0.0055	0.04		Sheet Flow, Through Turf Section Grass: Bermuda n= 0.410 P2= 3.20"
3.7	100	0.0001	0.45	0.16	Pipe Channel, TRENCH DRAIN LEVEL 8.0" Round Area= 0.3 sf Perim= 2.1' r= 0.17' n= 0.010
37.4	190	Total			

Subcatchment PR-4B: SB 11 A

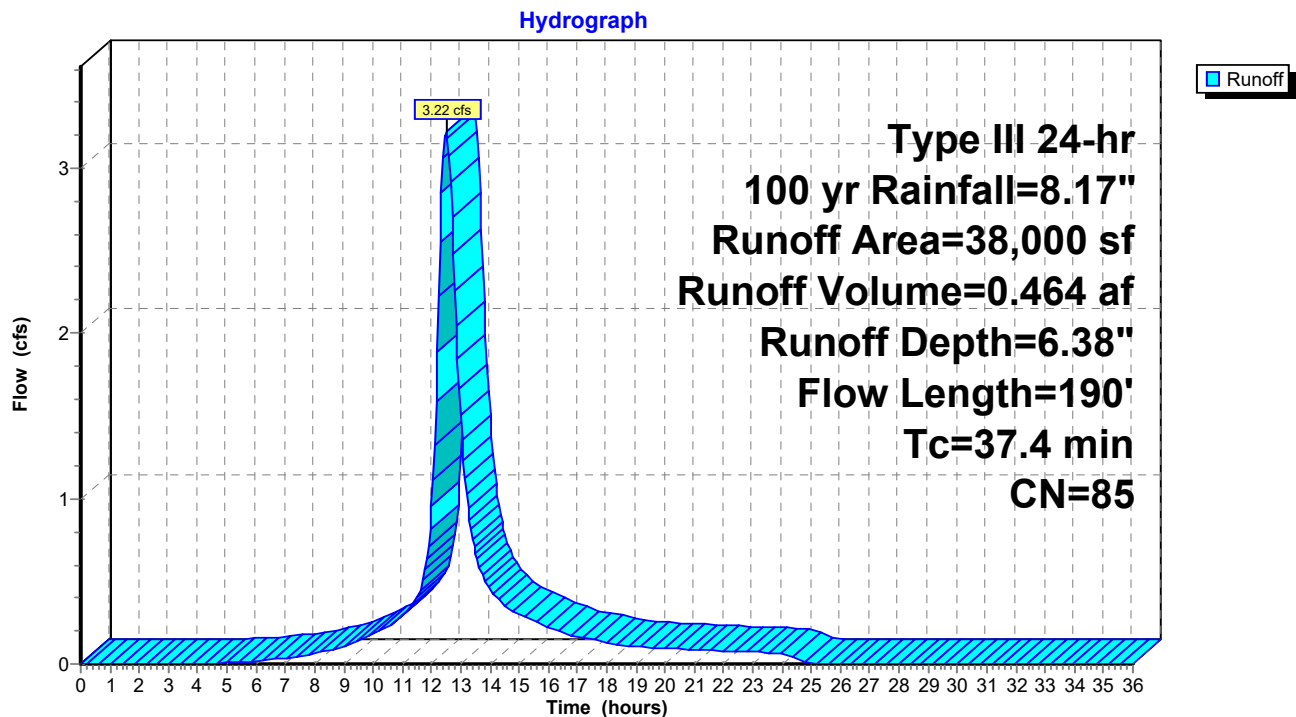

Summary for Subcatchment PR-4C: SB 00 DPW SLOPE


Runoff = 0.67 cfs @ 12.09 hrs, Volume= 0.049 af, Depth= 5.43"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 100 yr Rainfall=8.17"

Area (sf)	CN	Adj	Description
1,100	98		Unconnected pavement, HSG A
3,600	74		>75% Grass cover, Good, HSG C
4,700	80	77	Weighted Average, UI Adjusted
3,600			76.60% Pervious Area
1,100			23.40% Impervious Area
1,100			100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.3	25	0.5000	0.32		Sheet Flow, SLOPING LAND
					Grass: Dense n= 0.240 P2= 3.20"
1.3	25	Total, Increased to minimum Tc = 6.0 min			

Subcatchment PR-4C: SB 00 DPW SLOPE

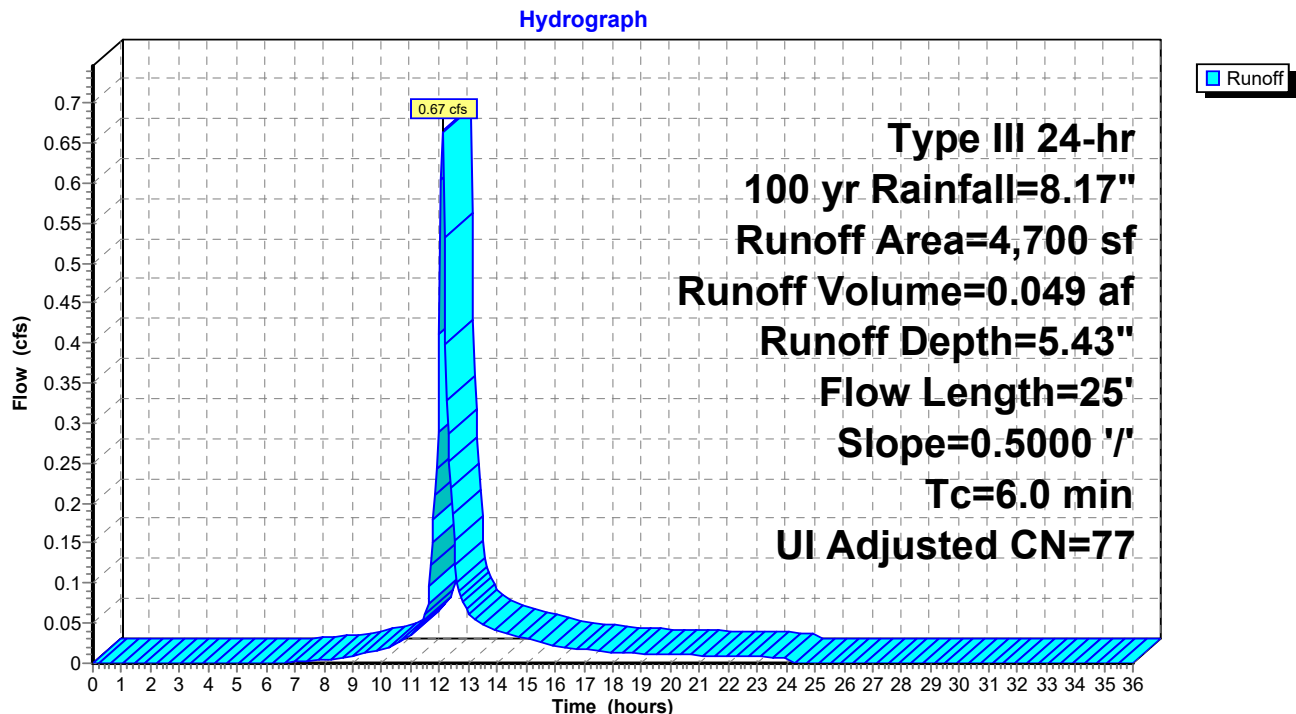

Summary for Subcatchment PR-5A: BB 01 A


Runoff = 2.75 cfs @ 12.27 hrs, Volume= 0.299 af, Depth= 6.38"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 100 yr Rainfall=8.17"

Area (sf)	CN	Description
* 24,500	85	SYNTHETIC TURF- PAD- LINER
24,500		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
18.2	46	0.0067	0.04		Sheet Flow, Through Turf Section Grass: Bermuda n= 0.410 P2= 3.20"
1.7	47	0.0001	0.45	0.16	Pipe Channel, TRENCH DRAIN LEVEL 8.0" Round Area= 0.3 sf Perim= 2.1' r= 0.17' n= 0.010
19.9	93	Total			

Subcatchment PR-5A: BB 01 A

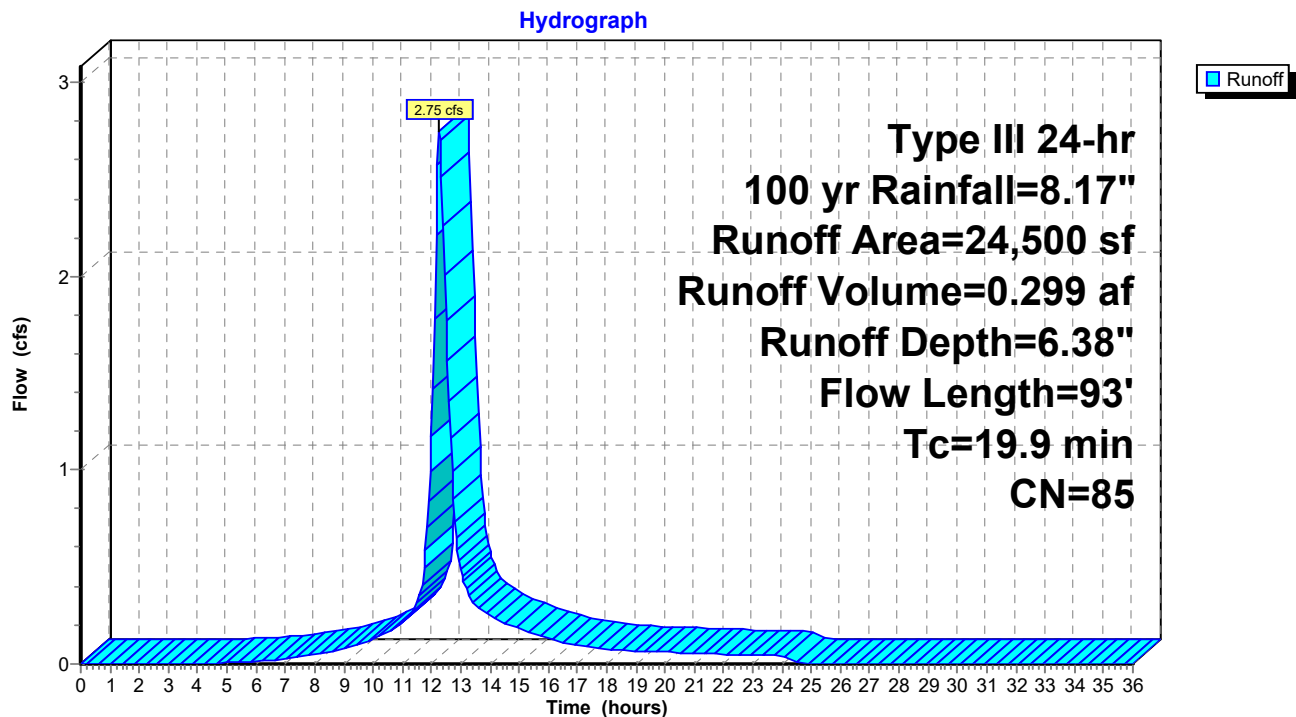

Summary for Subcatchment PR-5B: BB 11 A


Runoff = 4.52 cfs @ 12.86 hrs, Volume= 0.893 af, Depth= 6.38"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 100 yr Rainfall=8.17"

Area (sf)	CN	Description
* 73,200	85	SYNTHETIC TURF- PAD- LINER
73,200		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
22.1	53	0.0055	0.04		Sheet Flow, Through Turf Section Grass: Bermuda n= 0.410 P2= 3.20"
43.1	150	0.0083	0.06		Sheet Flow, SYNTHETIC TURF Grass: Bermuda n= 0.410 P2= 3.20"
1.7	47	0.0001	0.45	0.16	Pipe Channel, TRENCH DRAIN LEVEL 8.0" Round Area= 0.3 sf Perim= 2.1' r= 0.17' n= 0.010
66.9	250	Total			

Subcatchment PR-5B: BB 11 A

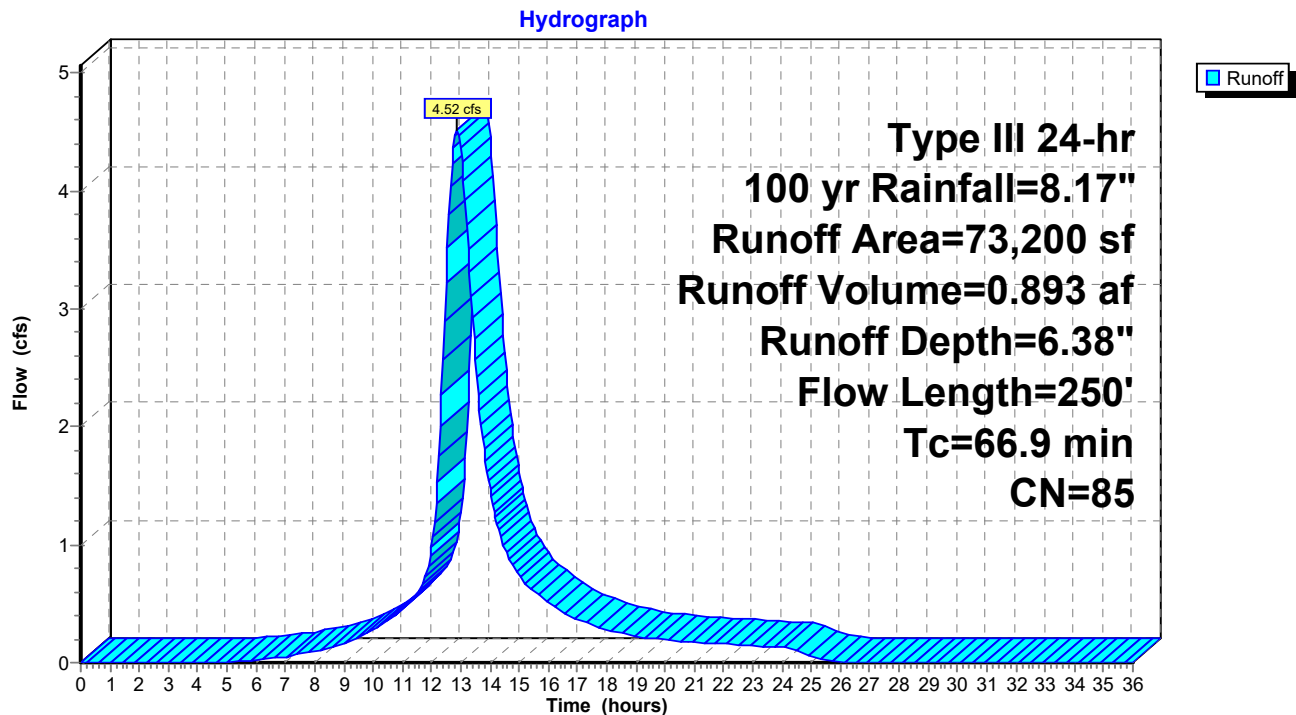


Summary for Subcatchment PR-5C: SLOPE

Runoff = 1.05 cfs @ 12.00 hrs, Volume= 0.066 af, Depth= 5.20"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Type III 24-hr 100 yr Rainfall=8.17"

Area (sf)	CN	Adj	Description
600	98		Unconnected roofs, HSG C
6,000	74		>75% Grass cover, Good, HSG C
6,600	76	75	Weighted Average, UI Adjusted
6,000			90.91% Pervious Area
600			9.09% Impervious Area
600			100.00% Unconnected

Subcatchment PR-5C: SLOPE

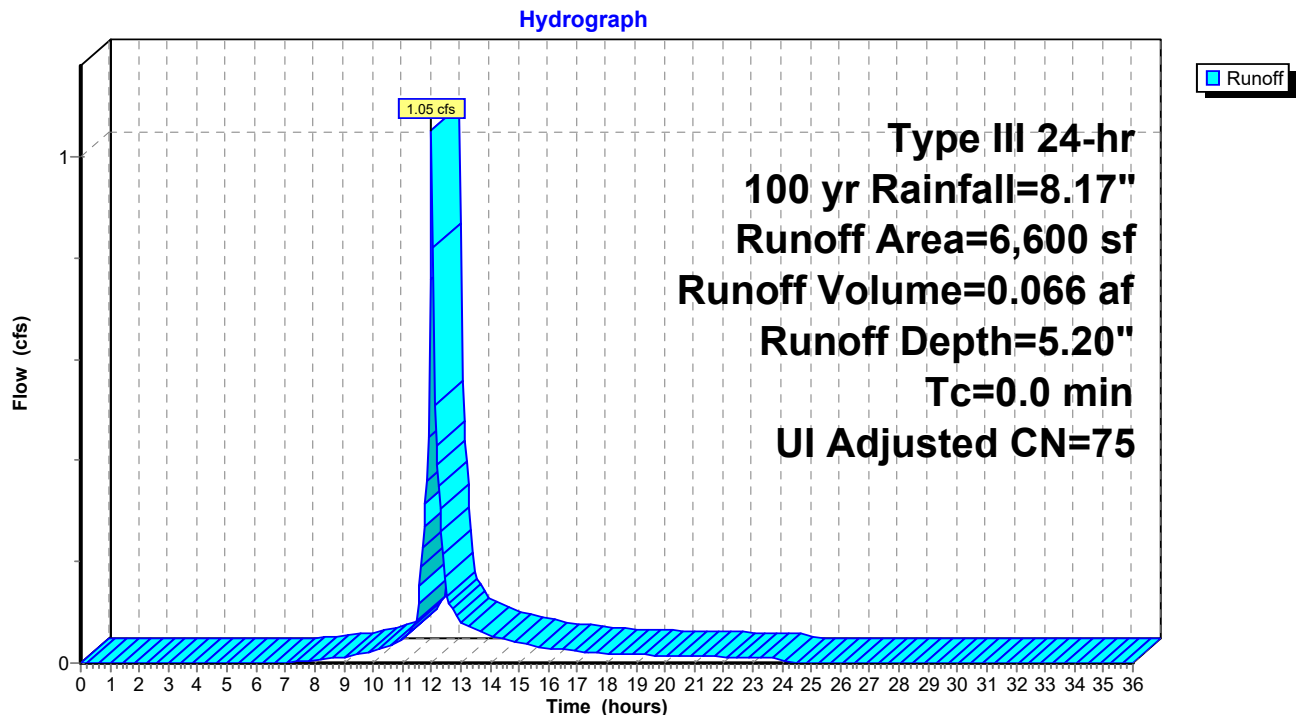

Summary for Pond 2P: rain garden#2 cascading

Inflow Area = 0.966 ac, 61.39% Impervious, Inflow Depth > 6.15" for 100 yr event
 Inflow = 6.66 cfs @ 12.09 hrs, Volume= 0.495 af
 Outflow = 6.67 cfs @ 12.10 hrs, Volume= 0.478 af, Atten= 0%, Lag= 0.5 min
 Primary = 0.03 cfs @ 12.10 hrs, Volume= 0.051 af
 Secondary = 6.64 cfs @ 12.10 hrs, Volume= 0.427 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 54.73' @ 12.10 hrs Surf.Area= 1,153 sf Storage= 1,445 cf
 Flood Elev= 55.00' Surf.Area= 1,326 sf Storage= 1,784 cf

Plug-Flow detention time= 63.7 min calculated for 0.478 af (97% of inflow)
 Center-of-Mass det. time= 36.9 min (855.7 - 818.8)

Volume	Invert	Avail.Storage	Storage Description
#1	51.00'	1,557 cf	Rain Garden Envelope (Prismatic) Listed below (Recalc) 2,357 cf Overall - 800 cf Embedded = 1,557 cf
#2	51.00'	80 cf	crush stone (Prismatic) Listed below (Recalc) Inside #1 200 cf Overall x 40.0% Voids
#3	51.50'	133 cf	Bio Media (Prismatic) Listed below (Recalc) Inside #1 532 cf Overall x 25.0% Voids
#4	52.83'	14 cf	Mulch (Prismatic) Listed below (Recalc) Inside #1 68 cf Overall x 20.0% Voids
1,784 cf			Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
51.00	400	0	0
53.00	400	800	800
54.00	694	547	1,347
55.00	1,326	1,010	2,357

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
51.00	400	0	0
51.50	400	200	200

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
51.50	400	0	0
52.83	400	532	532


Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
52.83	400	0	0
53.00	400	68	68

Device	Routing	Invert	Outlet Devices
#1	Device 3	51.00'	1.020 in/hr Exfiltration over Surface area 25.0' long x 3.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 Coef. (English) 2.44 2.58 2.68 2.67 2.65 2.64 2.64 2.68 2.68 2.72 2.81 2.92 2.97 3.07 3.32
#2	Secondary	54.50'	
#3	Primary	51.00'	12.0" Round Culvert L= 25.0' Ke= 0.500 Inlet / Outlet Invert= 51.00' / 50.88' S= 0.0048 '/ Cc= 0.900 n= 0.012, Flow Area= 0.79 sf

Primary OutFlow Max=0.03 cfs @ 12.10 hrs HW=54.73' TW=50.32' (Dynamic Tailwater)
 ↳ **3=Culvert** (Passes 0.03 cfs of 6.79 cfs potential flow)
 ↳ **1=Exfiltration** (Exfiltration Controls 0.03 cfs)

Secondary OutFlow Max=6.64 cfs @ 12.10 hrs HW=54.73' TW=50.32' (Dynamic Tailwater)
 ↳ **2=Broad-Crested Rectangular Weir** (Weir Controls 6.64 cfs @ 1.17 fps)

Pond 2P: rain garden#2 cascading

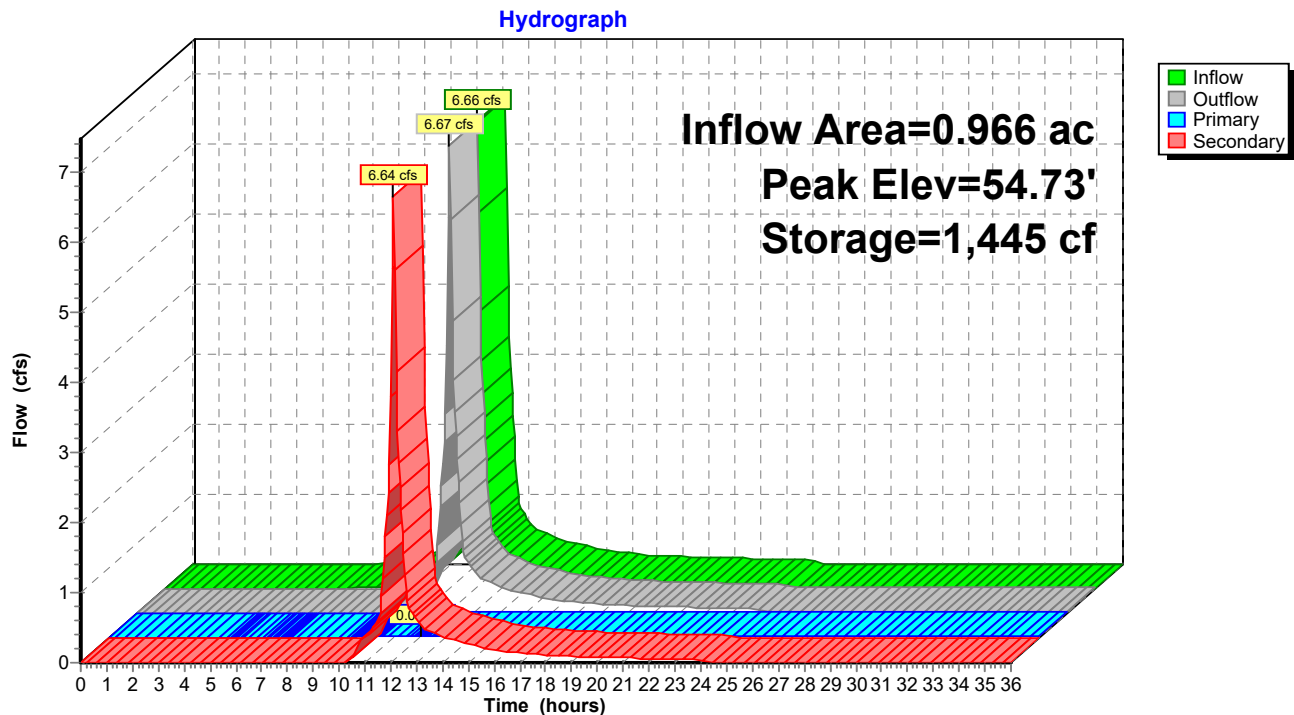

Summary for Pond 3P: rain garden#3 cascading

Inflow Area = 1.152 ac, 51.48% Impervious, Inflow Depth > 5.56" for 100 yr event
 Inflow = 7.43 cfs @ 12.10 hrs, Volume= 0.534 af
 Outflow = 7.30 cfs @ 12.11 hrs, Volume= 0.492 af, Atten= 2%, Lag= 0.8 min
 Primary = 7.30 cfs @ 12.11 hrs, Volume= 0.492 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 50.32' @ 12.11 hrs Surf.Area= 1,582 sf Storage= 2,763 cf
 Flood Elev= 50.00' Surf.Area= 1,373 sf Storage= 2,283 cf

Plug-Flow detention time= 100.4 min calculated for 0.491 af (92% of inflow)
 Center-of-Mass det. time= 42.4 min (896.7 - 854.4)

Volume	Invert	Avail.Storage	Storage Description
#1	46.00'	2,710 cf	Rain Garden Envelope (Prismatic) Listed below (Recalc) 3,911 cf Overall - 1,200 cf Embedded = 2,710 cf
#2	46.00'	120 cf	crush stone (Prismatic) Listed below (Recalc) Inside #1 300 cf Overall x 40.0% Voids
#3	46.50'	199 cf	Bio Media (Prismatic) Listed below (Recalc) Inside #1 798 cf Overall x 25.0% Voids
#4	47.83'	20 cf	Mulch (Prismatic) Listed below (Recalc) Inside #1 102 cf Overall x 20.0% Voids
3,050 cf			Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
46.00	600	0	0
48.00	600	1,200	1,200
49.00	957	779	1,979
50.00	1,373	1,165	3,144
50.50	1,695	767	3,911

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
46.00	600	0	0
46.50	600	300	300

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
46.50	600	0	0
47.83	600	798	798

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
47.83	600	0	0
48.00	600	102	102

17211.00 Arlington HS - Proposed Conditions - NOI ReType III 24-hr 100 yr Rainfall=8.17"

Prepared by Samiotes Engineering

Printed 5/28/2020

HydroCAD® 10.00-24 s/n 03575 © 2018 HydroCAD Software Solutions LLC


Page 158

Device	Routing	Invert	Outlet Devices
#1	Device 3	46.00'	1.020 in/hr Exfiltration over Surface area
#2	Device 3	50.00'	24.0" x 48.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#3	Primary	46.00'	15.0" Round Culvert L= 26.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 46.00' / 45.87' S= 0.0050 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

Primary OutFlow Max=7.10 cfs @ 12.11 hrs HW=50.32' TW=0.00' (Dynamic Tailwater)

- 3=Culvert (Passes 7.10 cfs of 8.97 cfs potential flow)
- 1=Exfiltration (Exfiltration Controls 0.04 cfs)
- 2=Orifice/Grate (Weir Controls 7.06 cfs @ 1.85 fps)

Pond 3P: rain garden#3 cascading

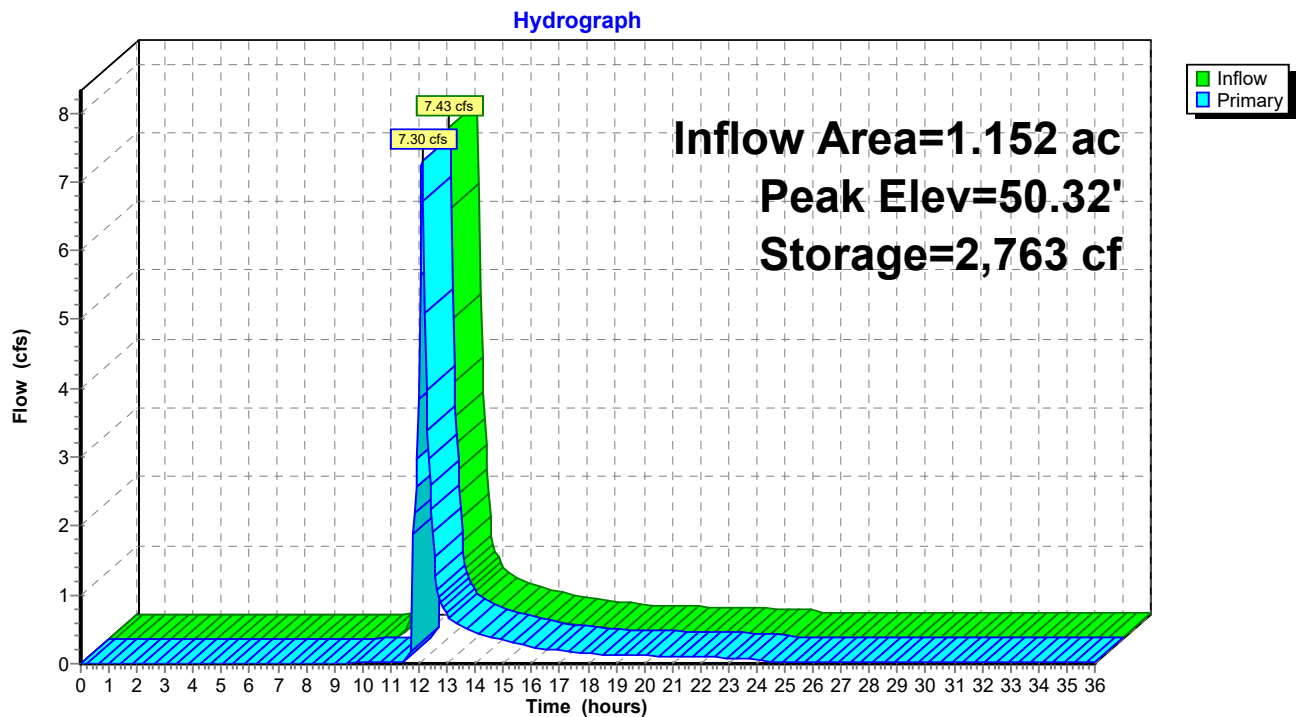

Summary for Pond 4P: UGS-1

Inflow Area = 1.705 ac, 60.59% Impervious, Inflow Depth = 6.22" for 100 yr event
 Inflow = 11.62 cfs @ 12.09 hrs, Volume= 0.883 af
 Outflow = 11.63 cfs @ 12.10 hrs, Volume= 0.845 af, Atten= 0%, Lag= 0.5 min
 Discarded = 0.04 cfs @ 6.65 hrs, Volume= 0.107 af
 Primary = 11.59 cfs @ 12.10 hrs, Volume= 0.738 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 44.18' @ 12.10 hrs Surf.Area= 1,672 sf Storage= 4,815 cf

Plug-Flow detention time= 96.7 min calculated for 0.844 af (96% of inflow)
 Center-of-Mass det. time= 72.8 min (860.9 - 788.1)

Volume	Invert	Avail.Storage	Storage Description
#1A	39.50'	2,099 cf	29.92'W x 55.89'L x 5.50'H Field A 9,196 cf Overall - 3,198 cf Embedded = 5,998 cf x 35.0% Voids
#2A	40.25'	3,198 cf	ADS_StormTech MC-3500 d +Cap x 28 Inside #1 Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap 28 Chambers in 4 Rows Cap Storage= +14.9 cf x 2 x 4 rows = 119.2 cf
		5,297 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	39.25'	24.0" Round Culvert L= 50.0' Ke= 0.500 Inlet / Outlet Invert= 39.25' / 38.75' S= 0.0100 '/' Cc= 0.900 n= 0.012, Flow Area= 3.14 sf
#2	Device 1	43.67'	5.0' long x 4.00' rise Sharp-Crested Rectangular Weir 2 End Contraction(s)
#3	Discarded	39.50'	1.020 in/hr Exfiltration over Surface area
#4	Device 1	42.42'	9.0" Vert. Orifice/Grate X 3 rows with 6.0" cc spacing C= 0.600

Discarded OutFlow Max=0.04 cfs @ 6.65 hrs HW=39.59' (Free Discharge)
 ↑ **3=Exfiltration** (Exfiltration Controls 0.04 cfs)

Primary OutFlow Max=11.51 cfs @ 12.10 hrs HW=44.17' TW=0.00' (Dynamic Tailwater)
 ↑ **1=Culvert** (Passes 11.51 cfs of 29.96 cfs potential flow)
 ↑ **2=Sharp-Crested Rectangular Weir** (Weir Controls 5.71 cfs @ 2.32 fps)
 ↑ **4=Orifice/Grate** (Orifice Controls 5.80 cfs @ 4.37 fps)

Pond 4P: UGS-1 - Chamber Wizard Field A

Chamber Model = ADS_StormTechMC-3500 d +Cap (ADS StormTech®MC-3500 d rev 03/14 with Cap volume)

Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf

Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap

Cap Storage= +14.9 cf x 2 x 4 rows = 119.2 cf

77.0" Wide + 9.0" Spacing = 86.0" C-C Row Spacing

7 Chambers/Row x 7.17' Long +1.85' Cap Length x 2 = 53.89' Row Length +12.0" End Stone x 2 = 55.89' Base Length

4 Rows x 77.0" Wide + 9.0" Spacing x 3 + 12.0" Side Stone x 2 = 29.92' Base Width

9.0" Base + 45.0" Chamber Height + 12.0" Cover = 5.50' Field Height

28 Chambers x 110.0 cf + 14.9 cf Cap Volume x 2 x 4 Rows = 3,197.9 cf Chamber Storage

9,196.2 cf Field - 3,197.9 cf Chambers = 5,998.4 cf Stone x 35.0% Voids = 2,099.4 cf Stone Storage

Chamber Storage + Stone Storage = 5,297.3 cf = 0.122 af



Overall Storage Efficiency = 57.6%

Overall System Size = 55.89' x 29.92' x 5.50'


28 Chambers

340.6 cy Field

222.2 cy Stone

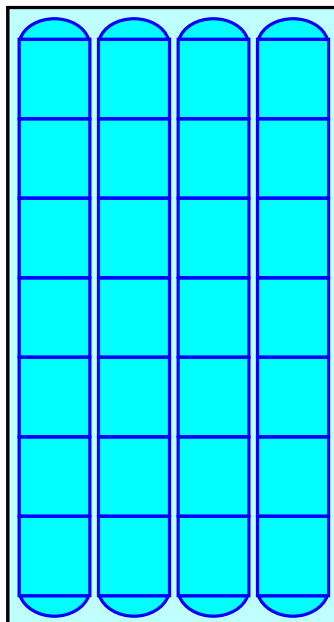

Pond 4P: UGS-1

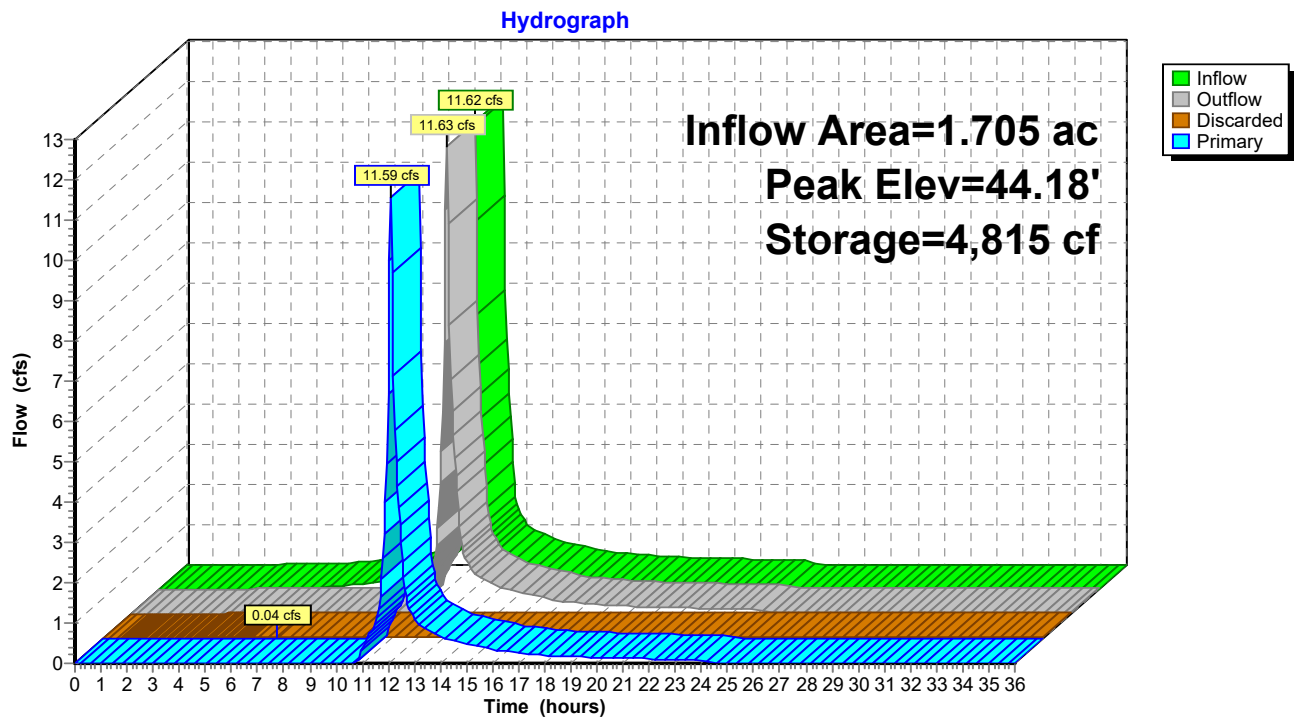

Summary for Pond 5P: rain garden#1 cascading

Inflow Area = 0.725 ac, 65.66% Impervious, Inflow Depth = 6.38" for 100 yr event
 Inflow = 5.10 cfs @ 12.09 hrs, Volume= 0.385 af
 Outflow = 5.12 cfs @ 12.09 hrs, Volume= 0.381 af, Atten= 0%, Lag= 0.3 min
 Primary = 0.01 cfs @ 12.09 hrs, Volume= 0.026 af
 Secondary = 5.10 cfs @ 12.09 hrs, Volume= 0.356 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 62.19' @ 12.09 hrs Surf.Area= 533 sf Storage= 650 cf
 Flood Elev= 63.00' Surf.Area= 660 sf Storage= 1,132 cf

Plug-Flow detention time= 39.2 min calculated for 0.381 af (99% of inflow)
 Center-of-Mass det. time= 33.4 min (823.1 - 789.8)

Volume	Invert	Avail.Storage	Storage Description
#1	58.50'	1,048 cf	Rain Garden Envelope (Prismatic) Listed below (Recalc) 1,348 cf Overall - 300 cf Embedded = 1,048 cf
#2	58.50'	30 cf	crush stone (Prismatic) Listed below (Recalc) Inside #1 75 cf Overall x 40.0% Voids
#3	59.00'	50 cf	Bio Media (Prismatic) Listed below (Recalc) Inside #1 199 cf Overall x 25.0% Voids
#4	60.33'	5 cf	Mulch (Prismatic) Listed below (Recalc) Inside #1 26 cf Overall x 20.0% Voids
1,132 cf			Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
58.50	150	0	0
60.50	150	300	300
61.00	236	97	397
62.00	503	370	766
63.00	660	582	1,348

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
58.50	150	0	0
59.00	150	75	75

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
59.00	150	0	0
60.33	150	199	199

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
60.33	150	0	0
60.50	150	26	26

17211.00 Arlington HS - Proposed Conditions - NOI ReType III 24-hr 100 yr Rainfall=8.17"

Prepared by Samiotes Engineering

Printed 5/28/2020

HydroCAD® 10.00-24 s/n 03575 © 2018 HydroCAD Software Solutions LLC

Page 163

Device	Routing	Invert	Outlet Devices
#1	Device 3	58.50'	1.020 in/hr Exfiltration over Surface area
#2	Secondary	62.00'	25.0' long x 3.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 Coef. (English) 2.44 2.58 2.68 2.67 2.65 2.64 2.64 2.68 2.68 2.72 2.81 2.92 2.97 3.07 3.32
#3	Primary	58.50'	8.0" Round Culvert L= 20.0' Ke= 0.500 Inlet / Outlet Invert= 58.50' / 58.40' S= 0.0050 '/' Cc= 0.900 n= 0.012, Flow Area= 0.35 sf

Primary OutFlow Max=0.01 cfs @ 12.09 hrs HW=62.19' TW=54.72' (Dynamic Tailwater)


↑ **3=Culvert** (Passes 0.01 cfs of 3.08 cfs potential flow)

↑ **1=Exfiltration** (Exfiltration Controls 0.01 cfs)

Secondary OutFlow Max=5.01 cfs @ 12.09 hrs HW=62.19' TW=54.72' (Dynamic Tailwater)

↑ **2=Broad-Crested Rectangular Weir** (Weir Controls 5.01 cfs @ 1.06 fps)

Pond 5P: rain garden#1 cascading

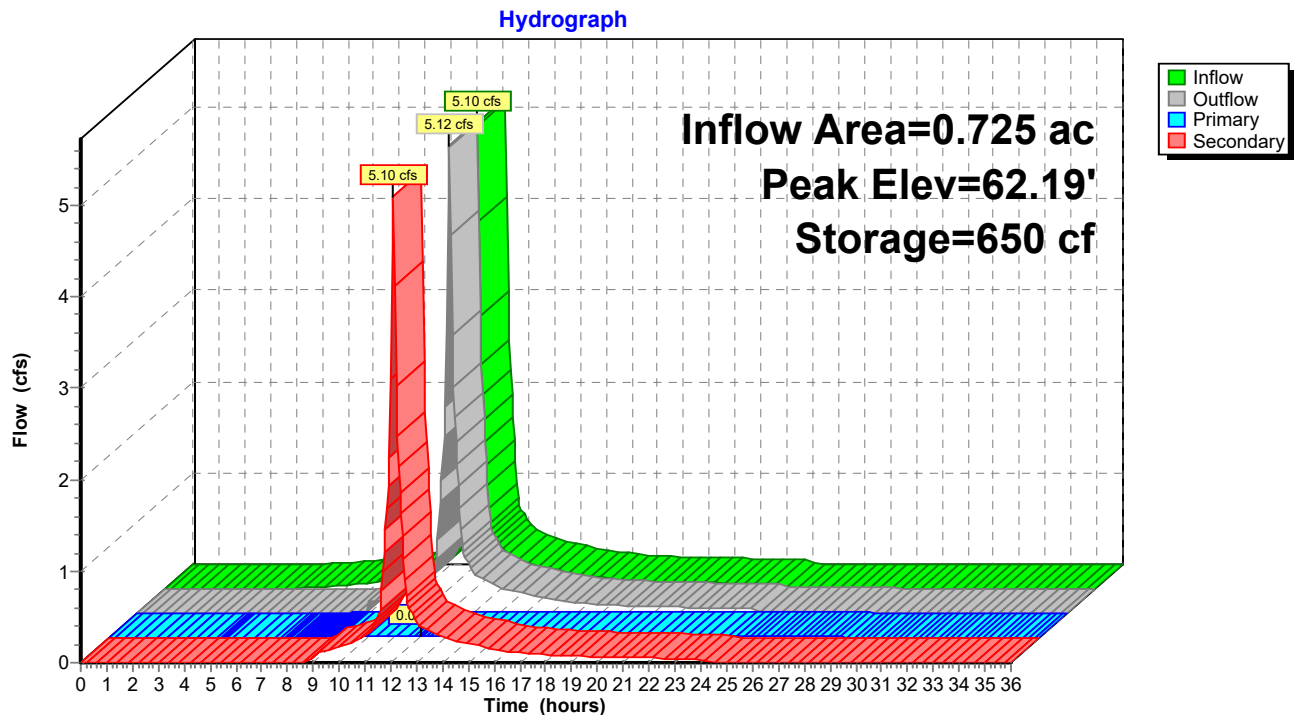

Summary for Pond BB 01 B: BB 01 B


Inflow Area = 0.714 ac, 1.93% Impervious, Inflow Depth = 6.13" for 100 yr event
 Inflow = 3.09 cfs @ 12.25 hrs, Volume= 0.365 af
 Outflow = 3.09 cfs @ 12.25 hrs, Volume= 0.365 af, Atten= 0%, Lag= 0.0 min
 Primary = 3.09 cfs @ 12.25 hrs, Volume= 0.365 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 48.96' @ 12.25 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	47.63'	12.0" Round Culvert L= 5.0' CMP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 47.63' / 47.58' S= 0.0100 '/ Cc= 0.900 n= 0.010, Flow Area= 0.79 sf

Primary OutFlow Max=3.08 cfs @ 12.25 hrs HW=48.95' TW=47.09' (Dynamic Tailwater)
 1=Culvert (Barrel Controls 3.08 cfs @ 3.93 fps)

Pond BB 01 B: BB 01 B

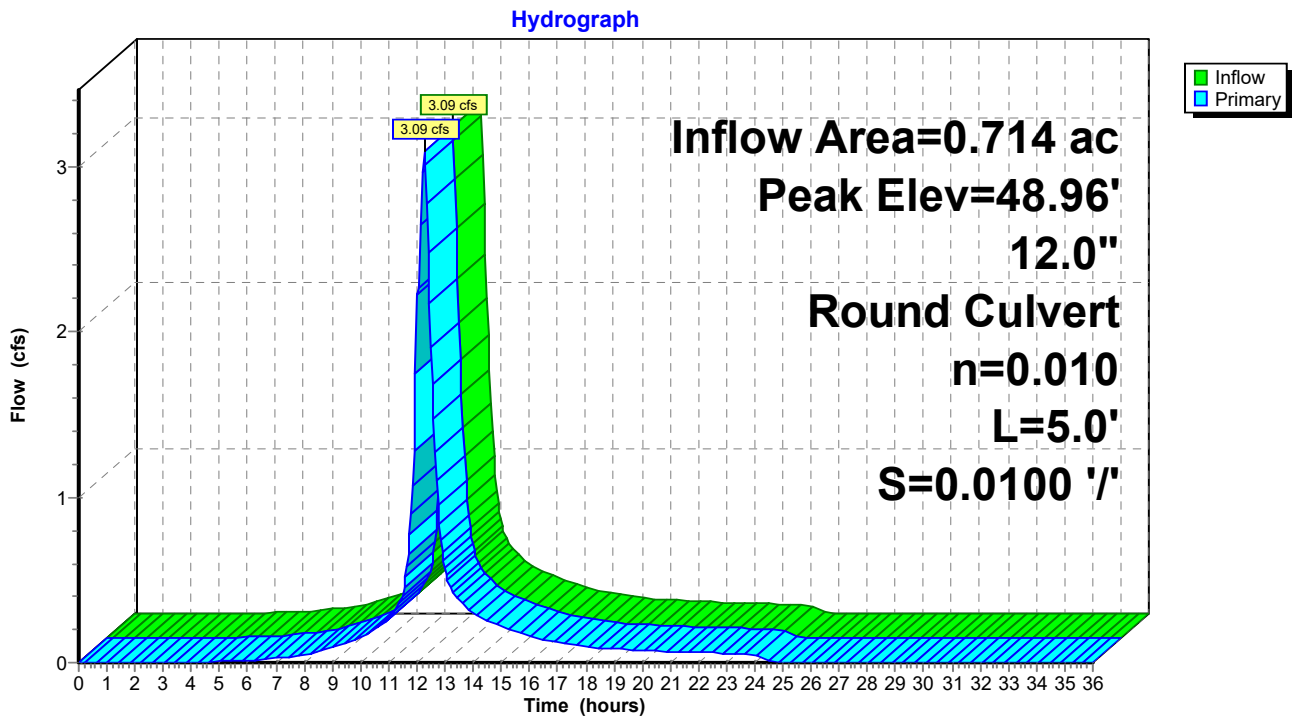

Summary for Pond BB 01 S: BB 01 S

Inflow Area = 0.714 ac, 1.93% Impervious, Inflow Depth = 6.13" for 100 yr event
 Inflow = 3.09 cfs @ 12.25 hrs, Volume= 0.365 af
 Outflow = 0.78 cfs @ 12.83 hrs, Volume= 0.365 af, Atten= 75%, Lag= 34.5 min
 Primary = 0.78 cfs @ 12.83 hrs, Volume= 0.365 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 47.45' @ 12.83 hrs Surf.Area= 0 sf Storage= 6,588 cf

Plug-Flow detention time= 175.1 min calculated for 0.364 af (100% of inflow)
 Center-of-Mass det. time= 175.0 min (978.6 - 803.6)


Volume	Invert	Avail.Storage	Storage Description
#1	45.65'	8,017 cf	Custom Stage Data Listed below

Elevation (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
45.65	0	0
46.48	16	16
46.98	3,378	3,394
47.48	3,405	6,799
47.98	1,218	8,017

Device	Routing	Invert	Outlet Devices
#1	Primary	45.65'	2.5" Vert. Orifice/Grate C= 0.600
#2	Primary	46.98'	4.0" Vert. Orifice/Grate C= 0.600
#3	Primary	46.98'	5.0" Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=0.78 cfs @ 12.83 hrs HW=47.45' TW=45.72' (Dynamic Tailwater)
 1=Orifice/Grate (Orifice Controls 0.21 cfs @ 6.27 fps)
 2=Orifice/Grate (Orifice Controls 0.23 cfs @ 2.65 fps)
 3=Orifice/Grate (Orifice Controls 0.34 cfs @ 2.46 fps)

Pond BB 01 S: BB 01 S

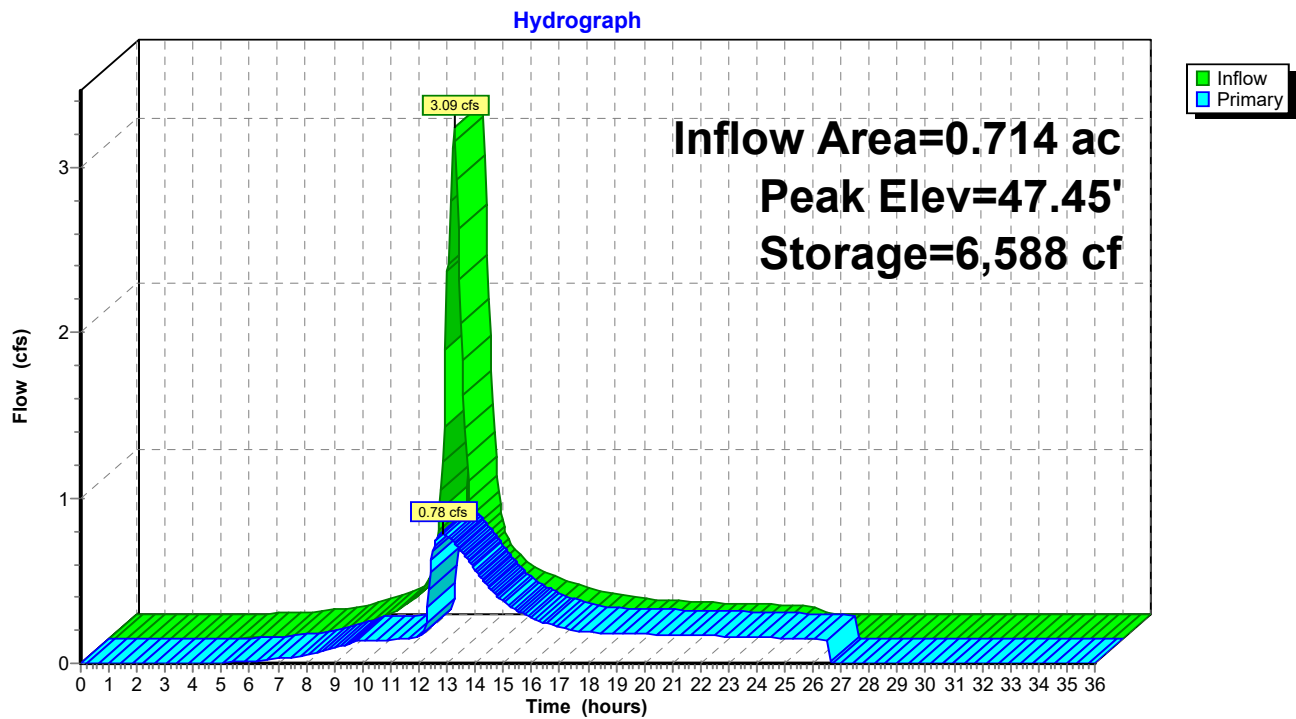

Summary for Pond BB 06 B: BB 06 B


Inflow Area = 0.714 ac, 1.93% Impervious, Inflow Depth = 6.13" for 100 yr event
 Inflow = 0.78 cfs @ 12.83 hrs, Volume= 0.365 af
 Outflow = 0.78 cfs @ 12.83 hrs, Volume= 0.365 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.78 cfs @ 12.83 hrs, Volume= 0.365 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 45.72' @ 12.83 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	45.25'	12.0" Round Culvert L= 112.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 45.25' / 44.69' S= 0.0050 '/ Cc= 0.900 n= 0.010, Flow Area= 0.79 sf

Primary OutFlow Max=0.78 cfs @ 12.83 hrs HW=45.72' TW=44.98' (Dynamic Tailwater)
 1=Culvert (Barrel Controls 0.78 cfs @ 3.15 fps)

Pond BB 06 B: BB 06 B

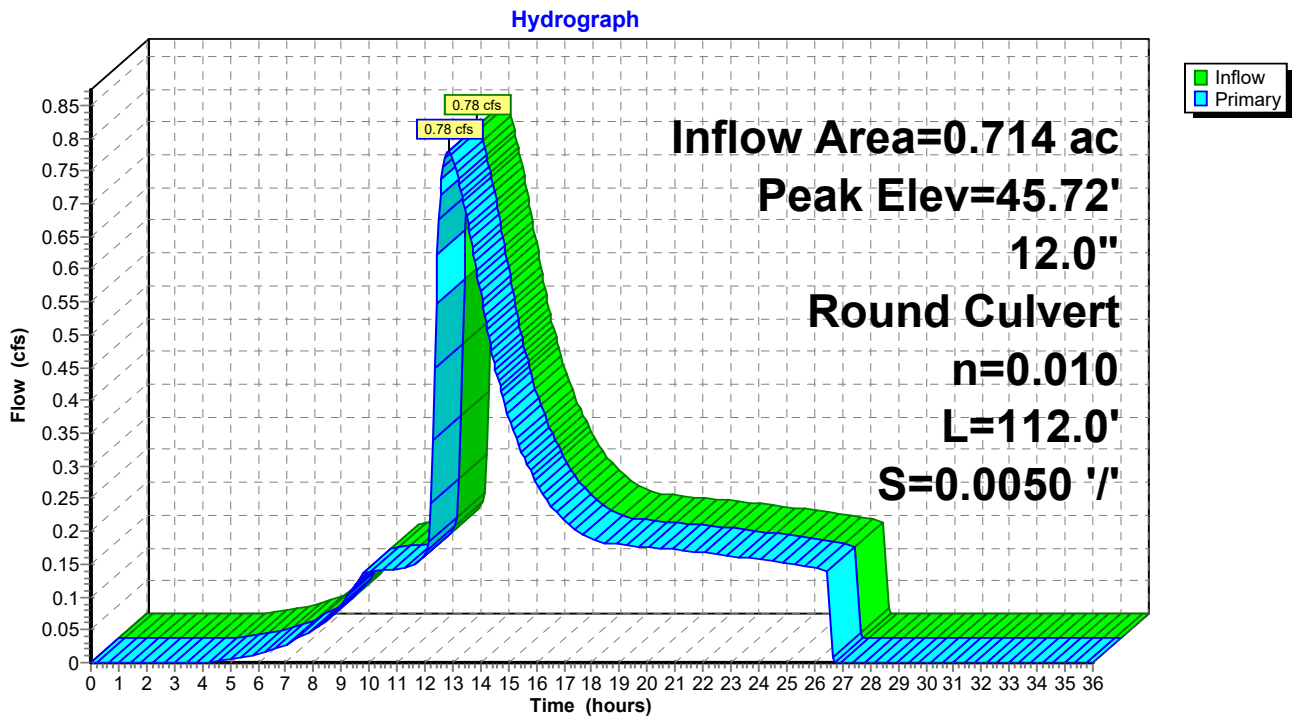

Summary for Pond BB 07 B: BB 07 B


Inflow Area = 0.714 ac, 1.93% Impervious, Inflow Depth = 6.13" for 100 yr event
 Inflow = 0.78 cfs @ 12.83 hrs, Volume= 0.365 af
 Outflow = 0.78 cfs @ 12.83 hrs, Volume= 0.365 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.78 cfs @ 12.83 hrs, Volume= 0.365 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 45.03' @ 13.31 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	44.50'	12.0" Round Culvert L= 88.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 44.50' / 44.06' S= 0.0050 '/ Cc= 0.900 n= 0.010, Flow Area= 0.79 sf

Primary OutFlow Max=0.76 cfs @ 12.83 hrs HW=44.98' TW=44.46' (Dynamic Tailwater)
 1=Culvert (Outlet Controls 0.76 cfs @ 2.99 fps)

Pond BB 07 B: BB 07 B

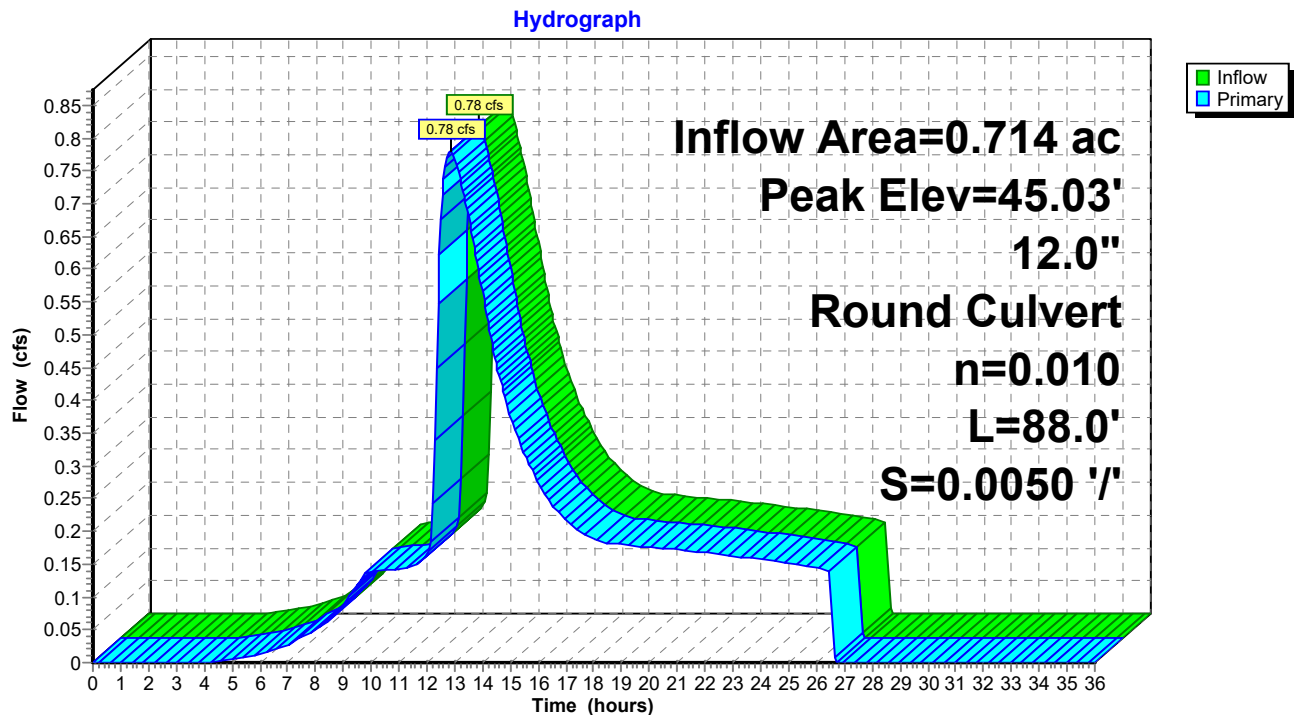

Summary for Pond BB 11 B: BB 11 B


Inflow Area = 1.680 ac, 0.00% Impervious, Inflow Depth = 6.38" for 100 yr event
 Inflow = 4.52 cfs @ 12.86 hrs, Volume= 0.893 af
 Outflow = 4.52 cfs @ 12.86 hrs, Volume= 0.893 af, Atten= 0%, Lag= 0.0 min
 Primary = 4.52 cfs @ 12.86 hrs, Volume= 0.893 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 47.20' @ 12.86 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	45.25'	12.0" Round Culvert L= 8.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 45.25' / 45.12' S= 0.0163 '/' Cc= 0.900 n= 0.020, Flow Area= 0.79 sf

Primary OutFlow Max=4.51 cfs @ 12.86 hrs HW=47.19' TW=45.75' (Dynamic Tailwater)
 1=Culvert (Barrel Controls 4.51 cfs @ 5.75 fps)

Pond BB 11 B: BB 11 B

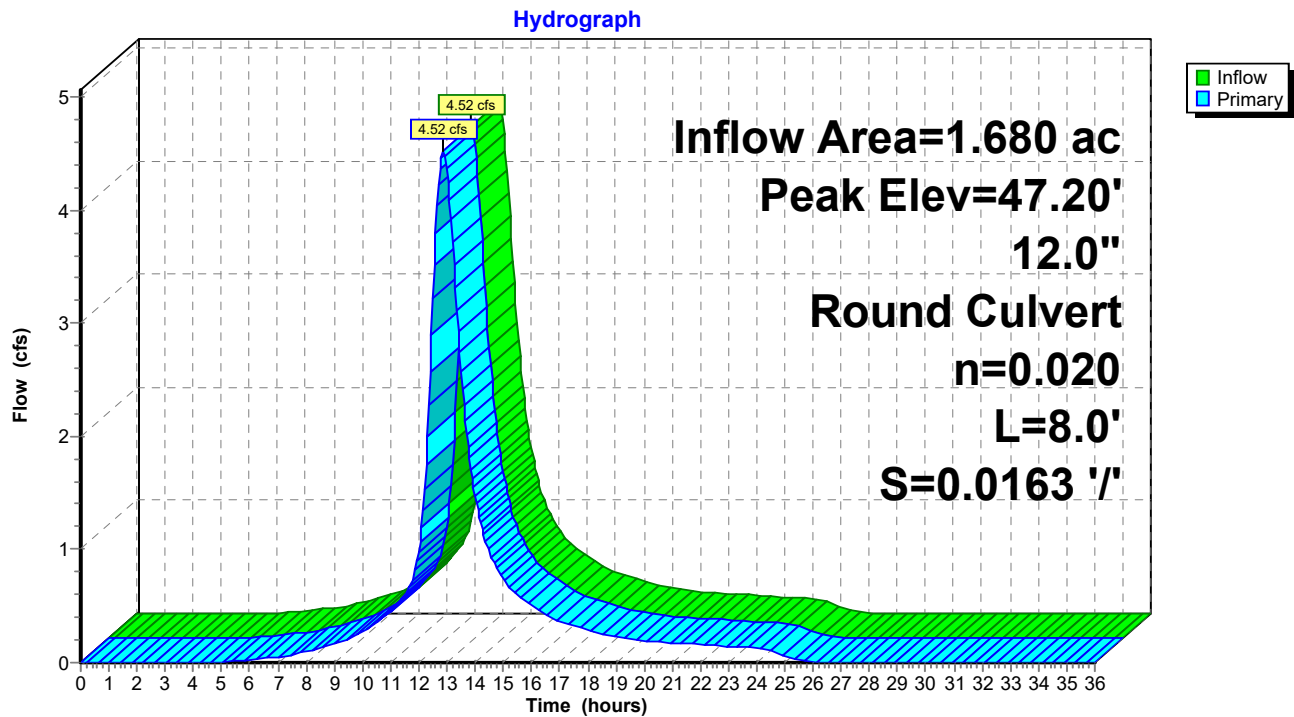

Summary for Pond BB 11 S: BB 11 S

Inflow Area = 1.680 ac, 0.00% Impervious, Inflow Depth = 6.38" for 100 yr event
 Inflow = 4.52 cfs @ 12.86 hrs, Volume= 0.893 af
 Outflow = 3.07 cfs @ 13.36 hrs, Volume= 0.893 af, Atten= 32%, Lag= 29.8 min
 Primary = 3.07 cfs @ 13.36 hrs, Volume= 0.893 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 46.37' @ 13.36 hrs Surf.Area= 0 sf Storage= 7,197 cf

Plug-Flow detention time= (not calculated: outflow precedes inflow)
 Center-of-Mass det. time= 23.2 min (869.4 - 846.2)


Volume	Invert	Avail.Storage	Storage Description
#1	44.14'	7,432 cf	Custom Stage Data Listed below

Elevation (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
44.14	0	0
44.97	16	16
45.47	3,131	3,147
45.97	3,156	6,303
46.47	1,129	7,432

Device	Routing	Invert	Outlet Devices
#1	Primary	44.14'	2.5" Vert. Orifice/Grate C= 0.600
#2	Primary	44.47'	8.0" Vert. Orifice/Grate C= 0.600
#3	Primary	45.47'	6.0" Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=3.07 cfs @ 13.36 hrs HW=46.36' TW=44.70' (Dynamic Tailwater)
 1=Orifice/Grate (Orifice Controls 0.21 cfs @ 6.21 fps)
 2=Orifice/Grate (Orifice Controls 2.10 cfs @ 6.02 fps)
 3=Orifice/Grate (Orifice Controls 0.76 cfs @ 3.87 fps)

Pond BB 11 S: BB 11 S

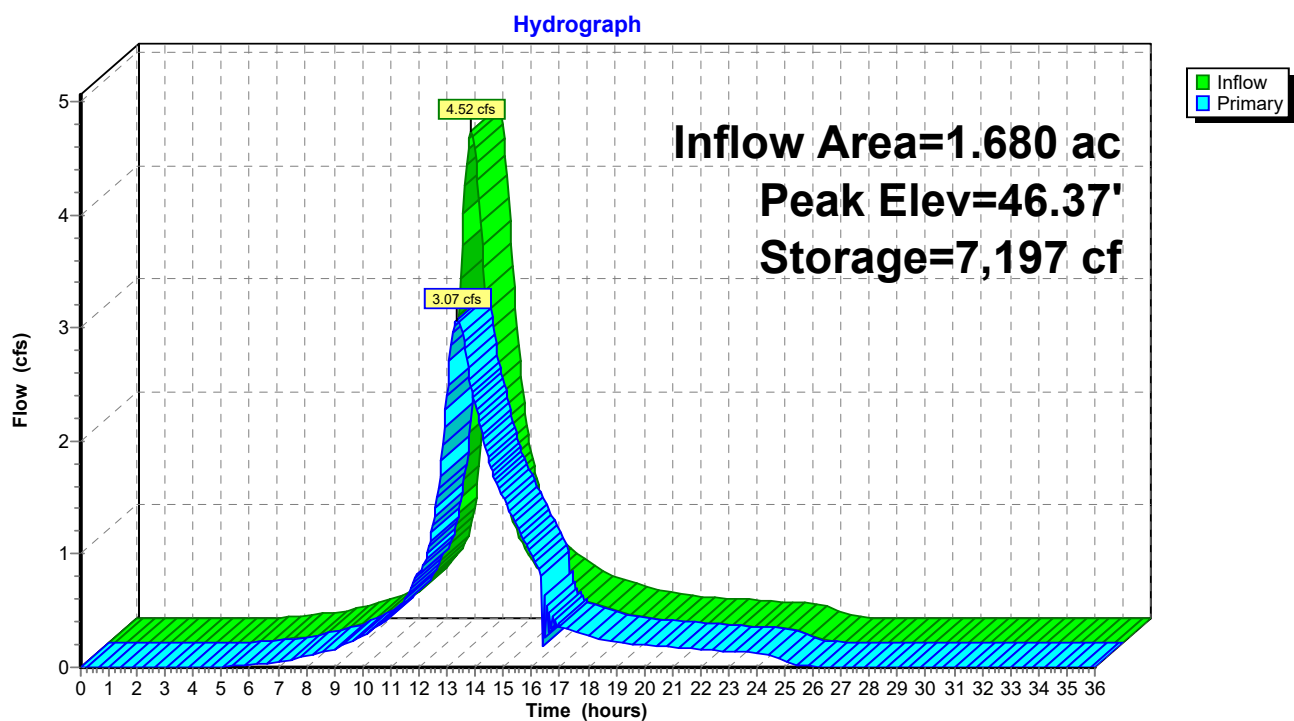

Summary for Pond PR-4: SB 01 DMH


Inflow Area = 1.921 ac, 1.31% Impervious, Inflow Depth = 6.32" for 100 yr event
 Inflow = 5.02 cfs @ 12.80 hrs, Volume= 1.013 af
 Outflow = 5.02 cfs @ 12.80 hrs, Volume= 1.013 af, Atten= 0%, Lag= 0.0 min
 Primary = 5.02 cfs @ 12.80 hrs, Volume= 1.013 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 50.56' @ 12.80 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	48.30'	12.0" Round Culvert L= 50.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 48.30' / 47.80' S= 0.0100 '/ Cc= 0.900 n= 0.010, Flow Area= 0.79 sf

Primary OutFlow Max=5.01 cfs @ 12.80 hrs HW=50.56' TW=0.00' (Dynamic Tailwater)
 1=Culvert (Inlet Controls 5.01 cfs @ 6.38 fps)

Pond PR-4: SB 01 DMH

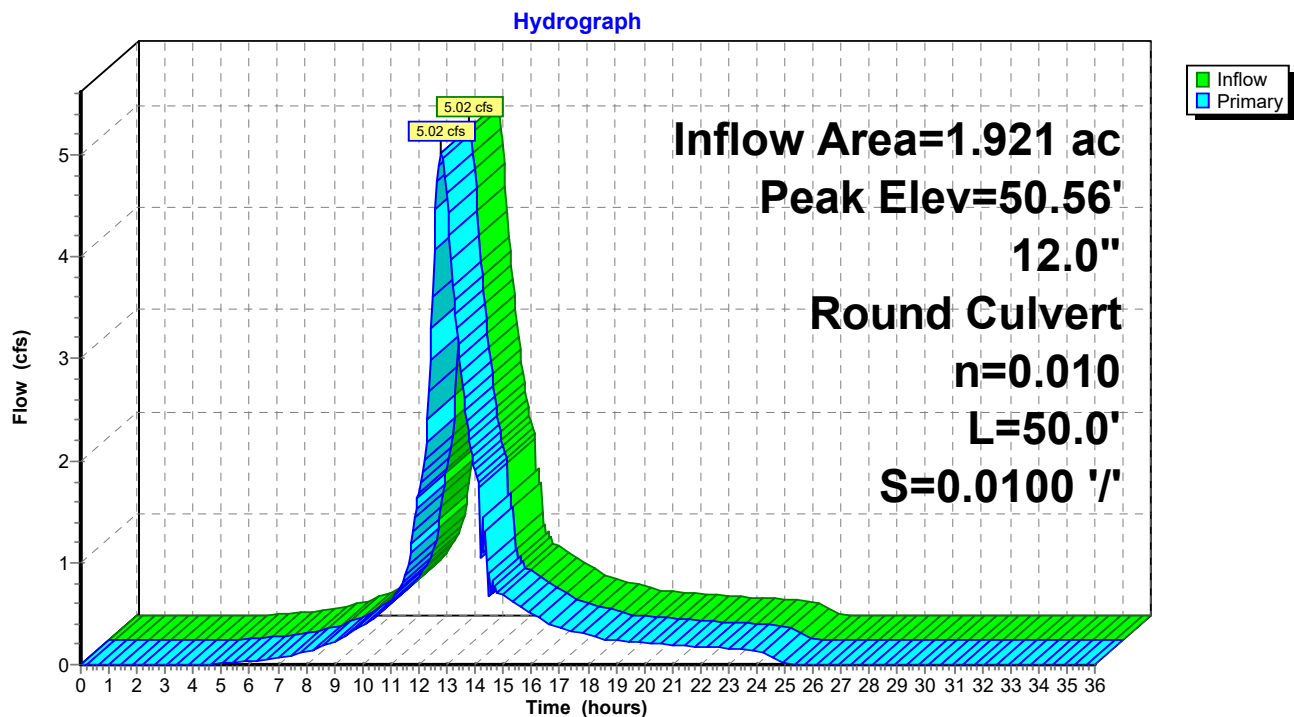

Summary for Pond PR-5: DMH 1


Inflow Area = 2.394 ac, 0.58% Impervious, Inflow Depth = 6.30" for 100 yr event
 Inflow = 3.78 cfs @ 13.34 hrs, Volume= 1.258 af
 Outflow = 3.78 cfs @ 13.34 hrs, Volume= 1.258 af, Atten= 0%, Lag= 0.0 min
 Primary = 3.78 cfs @ 13.34 hrs, Volume= 1.258 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 44.70' @ 13.34 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	43.50'	15.0" Round Culvert L= 10.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 43.50' / 43.40' S= 0.0100 '/ Cc= 0.900 n= 0.010, Flow Area= 1.23 sf

Primary OutFlow Max=3.78 cfs @ 13.34 hrs HW=44.70' TW=0.00' (Dynamic Tailwater)
 1=Culvert (Barrel Controls 3.78 cfs @ 4.00 fps)

Pond PR-5: DMH 1

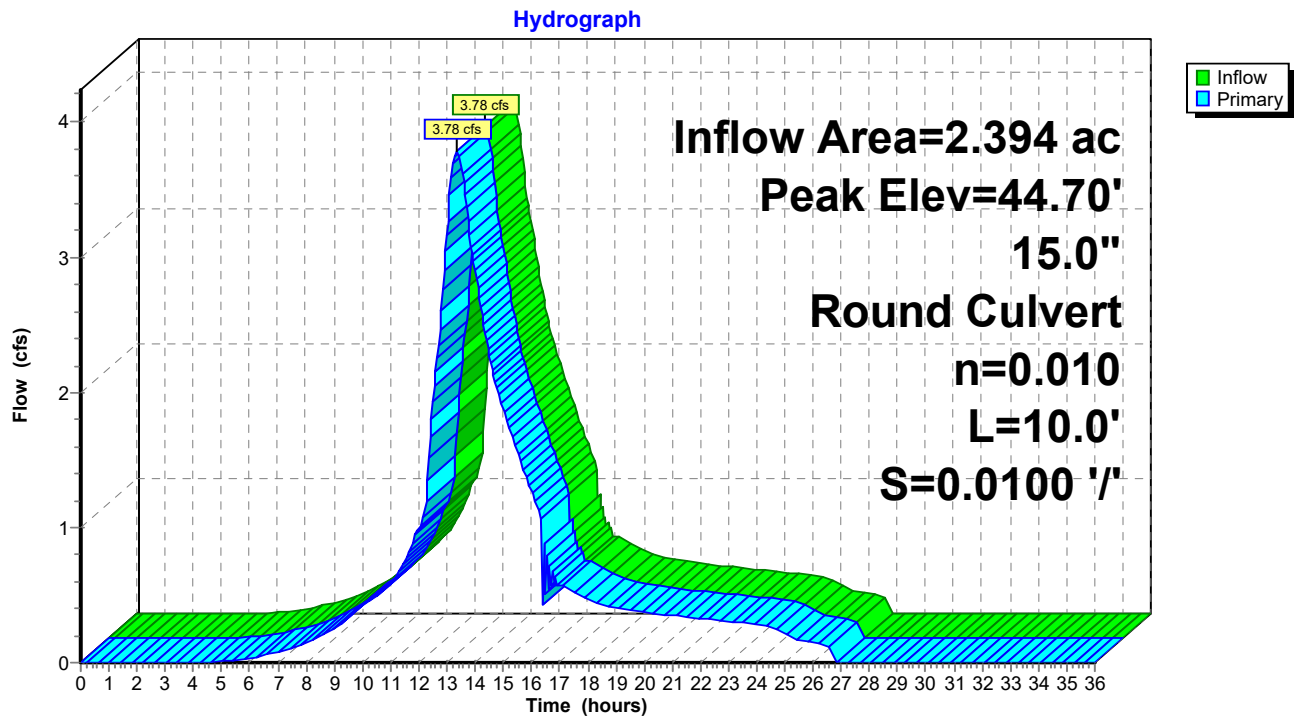

Summary for Pond SB 01 B: SB 01 B


Inflow Area = 1.049 ac, 2.41% Impervious, Inflow Depth = 6.28" for 100 yr event
 Inflow = 3.35 cfs @ 12.55 hrs, Volume= 0.549 af
 Outflow = 3.35 cfs @ 12.55 hrs, Volume= 0.549 af, Atten= 0%, Lag= 0.0 min
 Primary = 3.35 cfs @ 12.55 hrs, Volume= 0.549 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 56.30' @ 12.55 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	52.00'	8.0" Round Culvert L= 8.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 52.00' / 51.92' S= 0.0100 '/ Cc= 0.900 n= 0.010, Flow Area= 0.35 sf

Primary OutFlow Max=3.34 cfs @ 12.55 hrs HW=56.29' TW=52.07' (Dynamic Tailwater)
 1=Culvert (Inlet Controls 3.34 cfs @ 9.58 fps)

Pond SB 01 B: SB 01 B

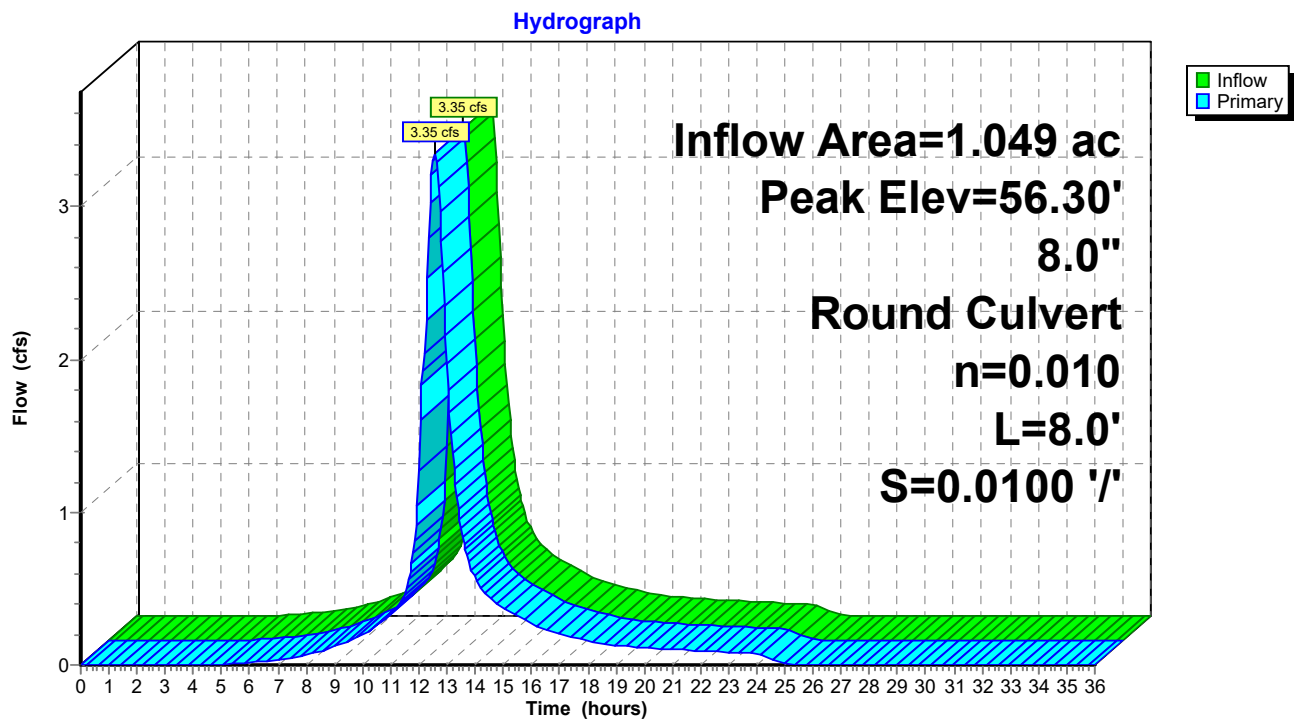

Summary for Pond SB 01 S: SB 01 S

Inflow Area = 1.049 ac, 2.41% Impervious, Inflow Depth = 6.28" for 100 yr event
 Inflow = 3.35 cfs @ 12.55 hrs, Volume= 0.549 af
 Outflow = 2.73 cfs @ 12.81 hrs, Volume= 0.549 af, Atten= 18%, Lag= 15.2 min
 Primary = 2.73 cfs @ 12.81 hrs, Volume= 0.549 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 52.36' @ 12.81 hrs Surf.Area= 0 sf Storage= 2,881 cf

Plug-Flow detention time= (not calculated: outflow precedes inflow)
 Center-of-Mass det. time= 9.1 min (832.0 - 823.0)

Volume	Invert	Avail.Storage	Storage Description
#1	50.64'	3,084 cf	Custom Stage Data Listed below


Elevation (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
50.64	0	0
51.47	16	16
51.97	2,170	2,186
52.47	898	3,084

Device	Routing	Invert	Outlet Devices
#1	Primary	50.64'	4.0" Vert. Orifice/Grate C= 0.600
#2	Primary	50.97'	6.0" Vert. Orifice/Grate C= 0.600
#3	Primary	51.47'	8.0" Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=2.73 cfs @ 12.81 hrs HW=52.36' TW=51.08' (Dynamic Tailwater)

1=Orifice/Grate (Orifice Controls 0.47 cfs @ 5.44 fps)
 2=Orifice/Grate (Orifice Controls 1.01 cfs @ 5.13 fps)
 3=Orifice/Grate (Orifice Controls 1.25 cfs @ 3.58 fps)

Pond SB 01 S: SB 01 S

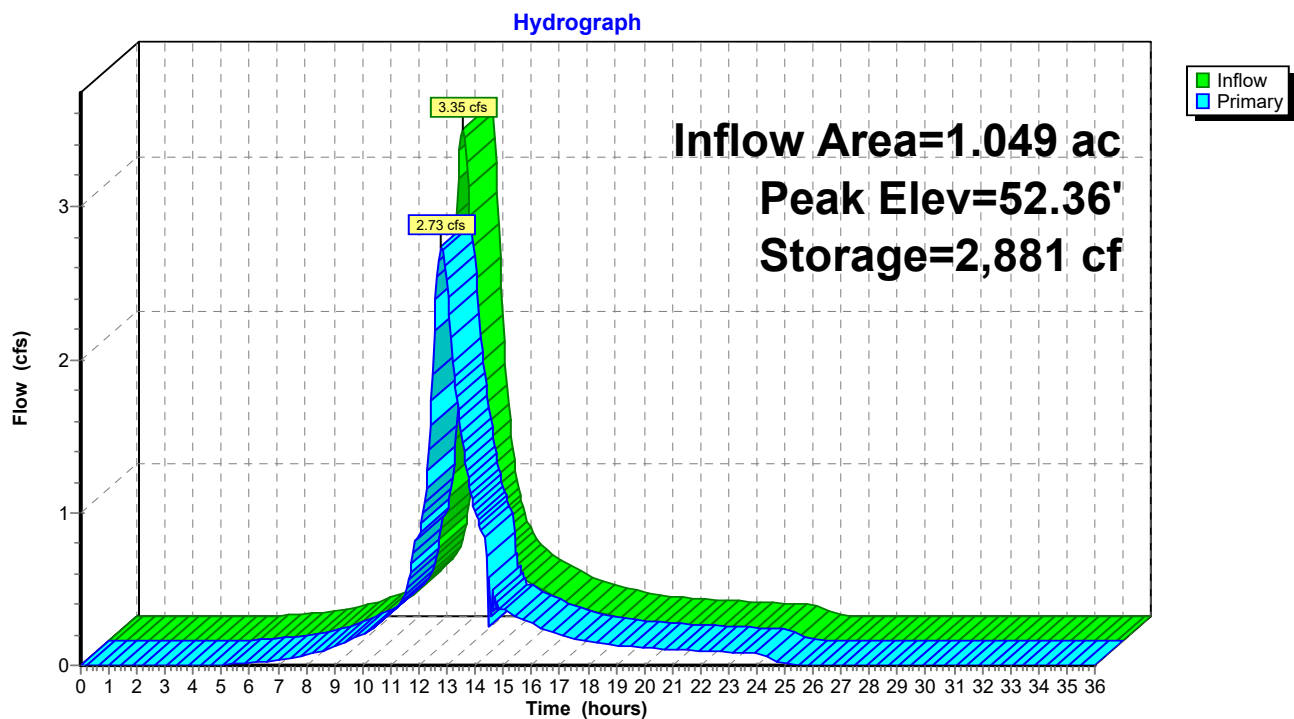

Summary for Pond SB 02 B: SB 02 B


Inflow Area = 1.049 ac, 2.41% Impervious, Inflow Depth = 6.28" for 100 yr event
 Inflow = 2.73 cfs @ 12.81 hrs, Volume= 0.549 af
 Outflow = 2.73 cfs @ 12.81 hrs, Volume= 0.549 af, Atten= 0%, Lag= 0.0 min
 Primary = 2.73 cfs @ 12.81 hrs, Volume= 0.549 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 51.08' @ 12.81 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	49.97'	12.0" Round Culvert L= 12.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 49.97' / 49.85' S= 0.0100 '/ Cc= 0.900 n= 0.010, Flow Area= 0.79 sf

Primary OutFlow Max=2.73 cfs @ 12.81 hrs HW=51.08' TW=50.56' (Dynamic Tailwater)
 1=Culvert (Barrel Controls 2.73 cfs @ 3.91 fps)

Pond SB 02 B: SB 02 B

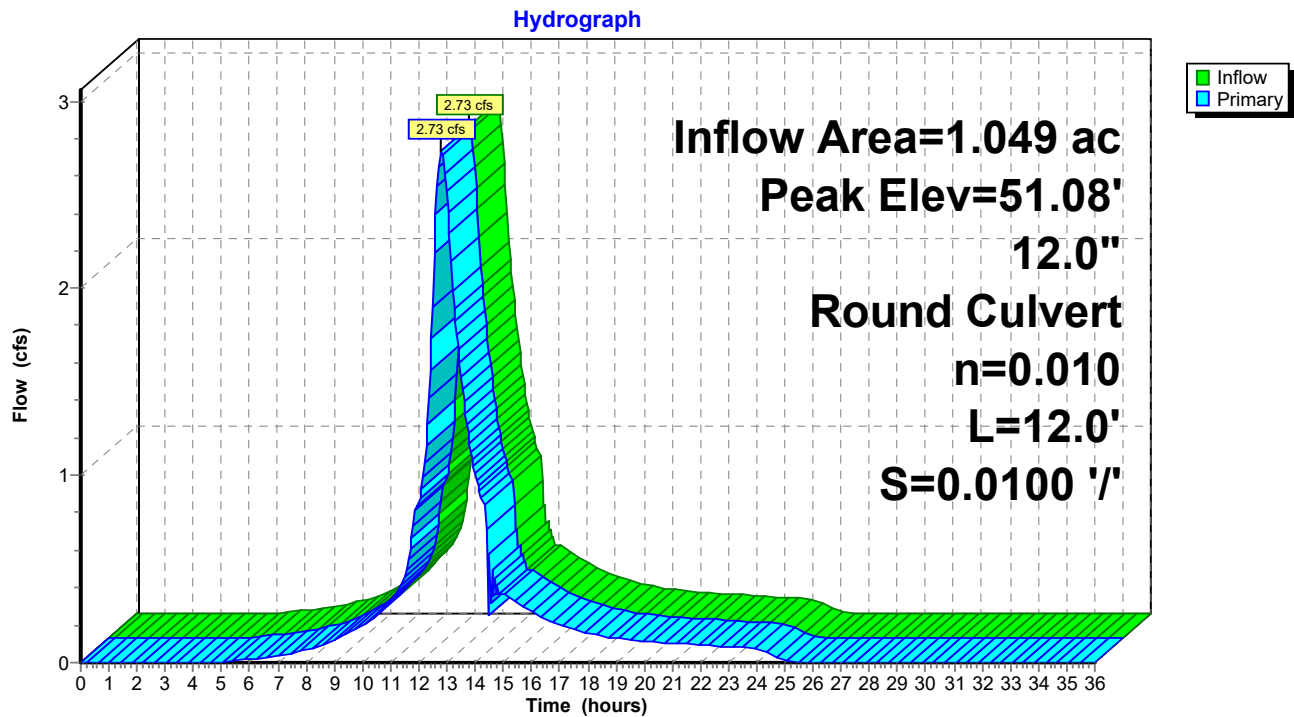

Summary for Pond SB 11 B: SB 11 B


Inflow Area = 0.872 ac, 0.00% Impervious, Inflow Depth = 6.38" for 100 yr event
 Inflow = 3.22 cfs @ 12.50 hrs, Volume= 0.464 af
 Outflow = 3.22 cfs @ 12.50 hrs, Volume= 0.464 af, Atten= 0%, Lag= 0.0 min
 Primary = 3.22 cfs @ 12.50 hrs, Volume= 0.464 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 56.01' @ 12.50 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	52.00'	8.0" Round Culvert L= 24.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 52.00' / 51.76' S= 0.0100 '/ Cc= 0.900 n= 0.010, Flow Area= 0.35 sf

Primary OutFlow Max=3.22 cfs @ 12.50 hrs HW=56.01' TW=52.14' (Dynamic Tailwater)
 1=Culvert (Inlet Controls 3.22 cfs @ 9.23 fps)

Pond SB 11 B: SB 11 B

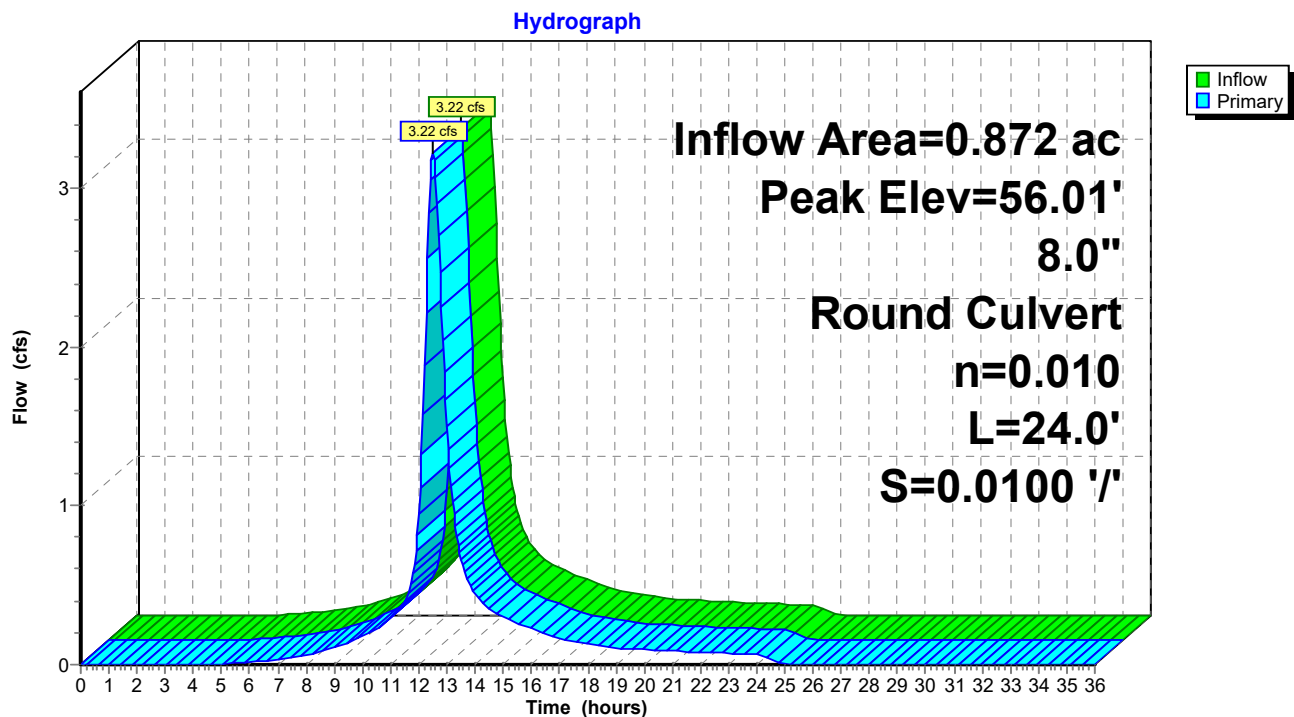

Summary for Pond SB 11 S: SB 11 S

Inflow Area = 0.872 ac, 0.00% Impervious, Inflow Depth = 6.38" for 100 yr event
 Inflow = 3.22 cfs @ 12.50 hrs, Volume= 0.464 af
 Outflow = 2.28 cfs @ 12.78 hrs, Volume= 0.464 af, Atten= 29%, Lag= 16.8 min
 Primary = 2.28 cfs @ 12.78 hrs, Volume= 0.464 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 52.58' @ 12.80 hrs Surf.Area= 0 sf Storage= 2,745 cf

Plug-Flow detention time= (not calculated: outflow precedes inflow)
 Center-of-Mass det. time= 9.0 min (827.9 - 818.9)

Volume	Invert	Avail.Storage	Storage Description
#1	50.84'	2,892 cf	Custom Stage Data Listed below


Elevation (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
50.84	0	0
51.67	16	16
52.17	2,035	2,051
52.67	841	2,892

Device	Routing	Invert	Outlet Devices
#1	Primary	50.84'	4.0" Vert. Orifice/Grate C= 0.600
#2	Primary	51.17'	6.0" Vert. Orifice/Grate C= 0.600
#3	Primary	51.67'	6.0" Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=2.28 cfs @ 12.78 hrs HW=52.58' TW=51.22' (Dynamic Tailwater)

1=Orifice/Grate (Orifice Controls 0.49 cfs @ 5.62 fps)
 2=Orifice/Grate (Orifice Controls 1.02 cfs @ 5.18 fps)
 3=Orifice/Grate (Orifice Controls 0.77 cfs @ 3.91 fps)

Pond SB 11 S: SB 11 S

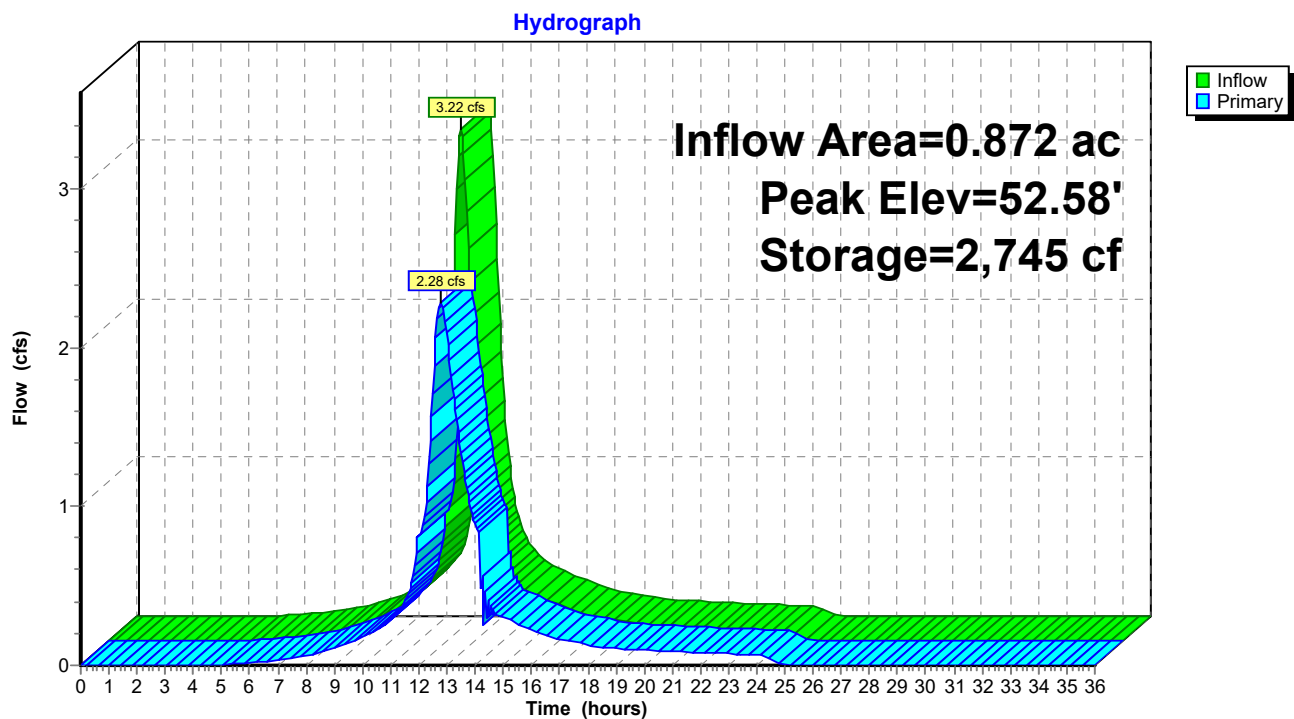

Summary for Pond SB 12 B: SB 12 B


Inflow Area = 0.872 ac, 0.00% Impervious, Inflow Depth = 6.38" for 100 yr event
 Inflow = 2.28 cfs @ 12.78 hrs, Volume= 0.464 af
 Outflow = 2.28 cfs @ 12.78 hrs, Volume= 0.464 af, Atten= 0%, Lag= 0.0 min
 Primary = 2.28 cfs @ 12.78 hrs, Volume= 0.464 af

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 Peak Elev= 51.23' @ 12.83 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	50.17'	12.0" Round Culvert L= 160.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 50.17' / 48.57' S= 0.0100 '/ Cc= 0.900 n= 0.010, Flow Area= 0.79 sf

Primary OutFlow Max=2.22 cfs @ 12.78 hrs HW=51.22' TW=50.55' (Dynamic Tailwater)
 1=Culvert (Outlet Controls 2.22 cfs @ 3.36 fps)

Pond SB 12 B: SB 12 B

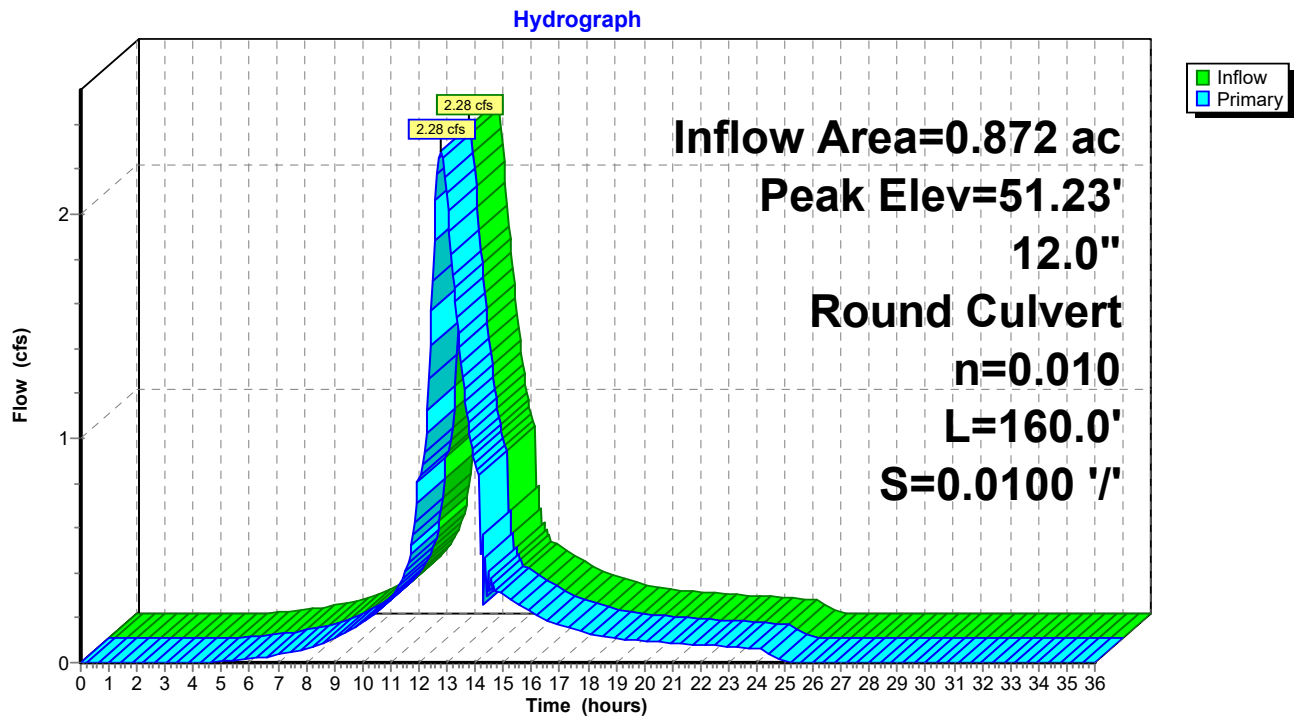


Summary for Link POA: POA

Inflow Area = 17.400 ac, 49.60% Impervious, Inflow Depth > 6.25" for 100 yr event
Inflow = 86.42 cfs @ 12.11 hrs, Volume= 9.057 af
Primary = 86.42 cfs @ 12.11 hrs, Volume= 9.057 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Link POA: POA

Hydrograph

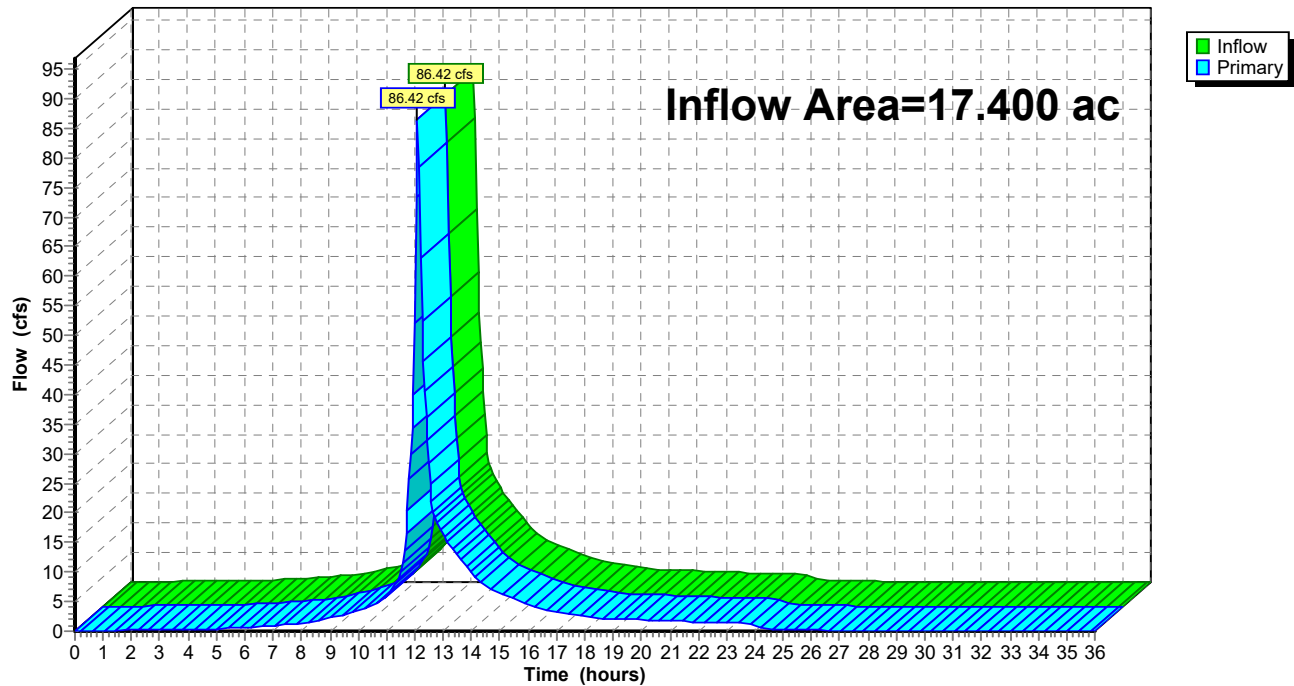

APPENDIX 3:
Test Pit Logs
Soils Report



Commonwealth of Massachusetts
City/Town of Arlington

Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

A. Facility Information

Town of Arlington

Owner Name

869 Massachusetts Ave

Street Address

Arlington

City

MA

State

53-2-4

Map/Lot #

02476

Zip Code

B. Site Information

1. (Check one) ☐ New Construction ☐ Upgrade ☐ Repair

2. Soil Survey Available? ☒ Yes ☐ No If yes:

USDA
Source

656
Soil Map Unit

Udorthents

Soil Name

Soil Limitations

Loamy alluvium and/or sandy glaciofluvial deposits
and/or loamy glaciolacustrine deposits

Urban Land
Landform

3. Surficial Geological Report Available? ☒ Yes ☐ No

If yes: 2018/Stone
Year Published/Source

Artificial Fill
Map Unit

Earth materials and manmade materials that have been artificially emplaced.

Description of Geologic Map Unit:

4. Flood Rate Insurance Map Within a regulatory floodway? ☐ Yes ☒ No

5. Within a velocity zone? ☐ Yes ☒ No

6. Within a Mapped Wetland Area? ☐ Yes ☒ No

If yes, MassGIS Wetland Data Layer: N/A
Wetland Type

7. Current Water Resource Conditions (USGS):

1015/19
Month/Day/ Year

Range: ☐ Above Normal ☒ Normal ☐ Below Normal

8. Other references reviewed:



**Commonwealth of Massachusetts
City/Town of Arlington**

Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

C. On-Site Review *(minimum of two holes required at every proposed primary and reserve disposal area)*

Deep Observation Hole Number: TP-1 10/14/19 11:00 Sunny, 50's
Hole # Date Time Weather Latitude Longitude:
 1. Land Use Landscaped area Grass None
(e.g., woodland, agricultural field, vacant lot, etc.) Vegetation Surface Stones (e.g., cobbles, stones, boulders, etc.) Slope (%)
 Description of Location: _____

2. Soil Parent Material: Loamy alluvium Outwash plain BS
Landform Position on Landscape (SU, SH, BS, FS, TS)

3. Distances from: Open Water Body 100'+ feet Drainage Way 100'+ feet Wetlands 100'+ feet
 Property Line 20'+ feet Drinking Water Well 100'+ feet Other _____ feet

4. Unsuitable Materials Present: ☒ Yes ☐ No If Yes: ☐ Disturbed Soil ☒ Fill Material ☐ Weathered/Fractured Rock ☐ Bedrock

5. Groundwater Observed: ☒ Yes ☐ No If yes: 90" Depth Weeping from Pit 96" Depth Standing Water in Hole

Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
0-36	Fill										
36-48	Ab	Sandy Loam	10YR3/1						Granular	Friable	
48-96	C1	Sandy Loam	2.5Y 5/4				3%	3%	Massive	Friable	

Additional Notes:

NRCS Hydrologic Soil Group B; ESHGW=37.00



Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

C. On-Site Review *(minimum of two holes required at every proposed primary and reserve disposal area)*

Deep Observation Hole Number:

Hole #

Date

Time

Weather

Latitude

Longitude:

1. Land Use: (e.g., woodland, agricultural field, vacant lot, etc.) Vegetation Surface Stones (e.g., cobbles, stones, boulders, etc.) Slope (%)

Description of Location:

2. Soil Parent Material: Landform Position on Landscape (SU, SH, BS, FS, TS)

3. Distances from: Open Water Body _____ feet Drainage Way _____ feet Wetlands _____ feet
Property Line _____ feet Drinking Water Well _____ feet Other _____ feet

4. Unsuitable

Materials Present: ☐ Yes ☐ No If Yes: ☐ Disturbed Soil ☐ Fill Material ☐ Weathered/Fractured Rock ☐ Bedrock

5. Groundwater Observed: ☐ Yes ☐ No If yes: _____ Depth Weeping from Pit _____ Depth Standing Water in Hole

Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			

Additional Notes:



Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

D. Determination of High Groundwater Elevation

1. Method Used:

☐ Depth observed standing water in observation hole

Obs. Hole # TP-1

Obs. Hole # _____

_____ inches

_____ inches

☒ Depth weeping from side of observation hole

90" inches

_____ inches

☐ Depth to soil redoximorphic features (mottles)

_____ inches

_____ inches

☐ Depth to adjusted seasonal high groundwater (S_h)
(USGS methodology)

_____ inches

_____ inches

Index Well Number _____

Reading Date _____

$$S_h = S_c - [S_r \times (OW_c - OW_{max}) / OW_r]$$

Obs. Hole/Well# _____ S_c _____ S_r _____ OW_c _____ OW_{max} _____ OW_r _____ S_h _____

2. Estimated Depth to High Groundwater: 90" inches

E. Depth of Pervious Material

1. Depth of Naturally Occurring Pervious Material

a. Does at least four feet of naturally occurring pervious material exist in all areas observed throughout the area proposed for the soil absorption system?

☒ Yes ☐ No

b. If yes, at what depth was it observed (exclude A and O Horizons)?

Upper boundary: 48"
inches

Lower boundary: 96"
inches

c. If no, at what depth was impervious material observed?

Upper boundary: _____
inches

Lower boundary: _____
inches



Commonwealth of Massachusetts
City/Town of Arlington

Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

F. Certification

I certify that I am currently approved by the Department of Environmental Protection pursuant to 310 CMR 15.017 to conduct soil evaluations and that the above analysis has been performed by me consistent with the required training, expertise and experience described in 310 CMR 15.017. I further certify that the results of my soil evaluation, as indicated in the attached Soil Evaluation Form, are accurate and in accordance with 310 CMR 15.100 through 15.107.

David Scharlacken

Signature of Soil Evaluator

David Scharlacken SE#14279

Typed or Printed Name of Soil Evaluator / License #

10-15-19

Date

12/1/2021

Expiration Date of License

Name of Approving Authority Witness

Approving Authority

Note: In accordance with 310 CMR 15.018(2) this form must be submitted to the approving authority within 60 days of the date of field testing, and to the designer and the property owner with [Percolation Test Form 12](#).

Field Diagrams: Use this area for field diagrams:

Hydrologic Soil Group—Middlesex County, Massachusetts



Map Scale: 1:5,100 if printed on A landscape (11" x 8.5") sheet.

0 50 100 200 300 Meters

0 200 400 800 1200 Feet

Map projection: Web Mercator Corner coordinates: WGS84 Edge tics: UTM Zone 19N WGS84




Natural Resources
Conservation Service

Web Soil Survey
National Cooperative Soil Survey

8/21/2019
Page 1 of 4


MAP LEGEND

Area of Interest (AOI)









 Area of Interest (AOI)

Soils

Soil Rating Polygons





 A
 A/D
 B
 B/D
 C
 C/D
 D
 Not rated or not available

Soil Rating Lines

 A
 A/D
 B
 B/D
 C
 C/D
 D
 Not rated or not available

Soil Rating Points



 A
 A/D
 B
 B/D

 C
 C/D
 D
 Not rated or not available


Water Features

 Streams and Canals

Transportation

 Rails
 Interstate Highways
 US Routes
 Major Roads
 Local Roads

Background

 Aerial Photography

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:25,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service
 Web Soil Survey URL:
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Middlesex County, Massachusetts
 Survey Area Data: Version 18, Sep 7, 2018

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Aug 10, 2014—Aug 25, 2014

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Hydrologic Soil Group

Map unit symbol	Map unit name	Rating	Acres in AOI	Percent of AOI
602	Urban land		44.3	33.9%
626B	Merrimac-Urban land complex, 0 to 8 percent slopes	A	20.3	15.5%
629C	Canton-Charlton-Urban land complex, 3 to 15 percent slopes	A	18.5	14.1%
631C	Charlton-Urban land-Hollis complex, 3 to 15 percent slopes, rocky	A	17.4	13.3%
655	Udorthents, wet substratum		11.1	8.5%
656	Udorthents-Urban land complex		19.1	14.6%
Totals for Area of Interest			130.7	100.0%

Description

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:

Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.

Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.

Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.

If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.

Rating Options

Aggregation Method: Dominant Condition

Component Percent Cutoff: None Specified

Tie-break Rule: Higher

APPENDIX 4:
Operations and Maintenance Plan

**ARLINGTON HIGH SCHOOL
CONSTRUCTION PERIOD POLLUTION PREVENTION PLAN AND EROSION CONTROL
OPERATION AND MAINTENANCE PLAN
MAY 2020**

During The Construction Period the General Contractor shall be responsible for the following:

1. Erosion Control

Erosion control barriers will be placed along down-gradient portion of the site as indicated on the project plans. Additional erosion control barriers will be placed at the limit of work as needed and in any sensitive areas as work progresses.

A stockpile of additional erosion control barriers shall be kept on site at all times

2. Site Access

Site access, for construction equipment will be from Massachusetts Ave. and Mill Brook Drive via an existing access drive as shown on the phased Demolition and Soil Erosion Plans, and all construction entrances will be installed at the onset of the project.

3. Construction Staging

A construction staging area will be established by the Contractor.

4. Site Grading/Site Work

The site activities may only commence when the site is stable from erosion and all required control measures are in place and functional.

5. Slope Stabilization

All surfaces and slopes shall be checked at least once every 7 calendar days and within 24 hours of the occurrence of a storm event 0.25 inches or greater to see that vegetation is in good condition. Any rills or damage from erosion shall be repaired immediately to avoid further damage. If seeps develop on the slopes, the area will be evaluated to determine if the seep will cause an unstable condition and shall be stabilized immediately if necessary. Problems found during the inspections by the General Contractor shall be repaired promptly. Areas requiring re-vegetation shall be replanted immediately or stabilized in a manner acceptable to the Conservation Commission if it is outside of the growing season. Slopes and other exposed surfaces receiving vegetation will be maintained as necessary to support healthy vegetation. If stabilization is required during the non-growing season, straw mulch, or a commercially manufactured blanket must be employed to prevent erosion.

6. Permanent Stabilization

Disturbed portions of the site where construction activities permanently cease shall be stabilized with permanent seed no later than 14 days after the last construction activity. The permanent seed mix, fertilizer, and mulch shall be specified on the project plans. Permanent seeding shall occur in the Spring or Fall.

7. Drainage Structures (Catch Basins, Area Drains, Manholes, WQU's)

All structures shall be inspected on a bi-weekly basis and/or after every rain storm and repairs made as necessary. Sediment shall be removed from the sump after the sediment has reached a maximum of one half the depth of the sump. The sediment shall be removed from the site and properly disposed of. Drainage structures/sumps shall be cleaned completely at the end of construction.

8. Dust and Sediment Control

Siltsacks:

Catch basin/Area drain filters shall be placed at all inlets to drainage structures as structures are installed and prior to pavement removal. Outlet protection work shall be constructed before runoff is allowed to enter the drainage system. Construction and location of catch basin filters shall be as indicated on the Drawings.

Straw Wattles:

Straw bales shall be installed as indicated on the Drawings.

Bales shall be placed in a row with ends tightly abutting the adjacent wattles. Each roll shall be securely anchored in place by 2 stakes or re-bars driven through the wattles. The first stake in each roll shall be angled toward the previously laid straw wattle to force them together.

Construction Entrance:

The area of the construction entrance should be cleared of all vegetation, roots, and other objectionable material. The filter fabric should be placed on the subgrade prior to the gravel placement. The gravel shall be placed to the specified dimensions depicted on the plans.

The Construction entrance shall be a minimum of 50-feet in length and 20-feet wide.

Dust Control:

A mechanical street sweeper shall be utilized to clean the existing paved areas on an as-needed basis.

For emergency control of dust apply water to affected areas. The source of supply and the method of application for water are the responsibility of the contractor.

Pollution Prevention Measures

1. Before, during, and after construction, functional erosion and sedimentation controls shall be implemented to prevent the silting of the wetland areas down-gradient of the site. Straw bales, crushed stone, temporary stabilization and other controls shall be properly maintained and are not to be removed until the site is permanently stabilized. Other controls shall be added as warranted during construction to protect environmentally-sensitive areas. Sufficient extra materials (e.g. straw bales and other control materials) shall be stored on site for emergencies.
2. Silt sacks and straw bale check dams shall be installed at all existing and proposed infiltration areas to protect from soils and sediment.
3. Casting of excavated materials shall be stored away from wetland areas and sensitive land areas.
4. Any stockpiling of loose materials shall be properly stabilized to prevent erosion and siltation. Preventative controls such as straw wattles, temporary seeding/mulching and jute covering shall be implemented to prevent such an occurrence.
5. There shall be no flooding, ponding, or flood related damage caused by the project or surface run-off emanating from the project on lands of an abutter, nearby or down-gradient of the site.

6. There shall be no contaminant migration caused by the project to nearby and down-gradient properties, nearby aquifers, and nearby resource areas.
7. The contractor shall make sufficient provisions to control any unexpected drainage and erosion conditions that may arise during construction that may create damage on abutting properties. Said control measures are to be implemented at once.
8. During construction flood prevention, erosion, and sedimentation controls shall be in place before the natural ground cover is disturbed. Said controls shall be in place prior to other construction work and shall be monitored and approved by the Contractor. They shall be properly maintained and are not to be removed until the site is stabilized.
9. The Contractor shall designate a person or persons to inspect and supervise the erosion controls for the project. The Conservation Commission shall be notified as to the means to contact said individual or individuals on a 24-hour basis on all working and non-working days of the project. Said means of contact shall include at least 2 separate telephone number of said designated person or persons.
10. There shall be periodic inspection of straw wattles, and other erosion controls by the Contractor's Designee to assure their continued effectiveness.
11. The Contractor shall make adequate provisions for controlling erosion and sediment from activities that might yield water at high volumes with high suspended solid contents, such as dewatering excavations.
12. Street sweeping shall be used to keep public ways free and clear of sediment and dirt from the site activities.

Other Control Measures

Waste Materials. All trash and construction debris from the site will be hauled to an approved landfill or recycling facility. No construction waste material will be buried on the site. All personnel will receive instructions regarding the correct procedure for waste disposal. Notices describing these practices will be posted in the construction office. The site superintendent will be responsible for seeing that these procedures are followed. Employee waste and other loose materials will be collected so as to prevent the release of floatables during rainfall events.

Hazardous Waste. No Hazardous materials are expected to be encountered. The mandated State and Local permits for removal of such materials, if located, will be implemented when such materials are encountered.

After Construction, the owner shall be responsible for the following:

General Land Grading and Slopes Stabilization

All surfaces and slopes shall be checked bi-annually to see that vegetation is in good condition. Any rills or damage from erosion shall be repaired immediately to avoid further damage. If seeps develop on the slopes, the area will be evaluated to determine if the seep will cause an unstable condition and shall be stabilized immediately if necessary. Problems found during the inspections by the Owner shall be repaired promptly. Areas requiring re-vegetation shall be replanted immediately. Slopes and other exposed surfaces receiving vegetation will be maintained as necessary to support healthy vegetation.

Areas of steep slopes (2.5:1 or greater) shall be stabilized using jute mesh or a similar approved erosion blanket.

Erosion Controls

Erosion controls shall not be removed or dismantled without approval from the Engineer or Conservation Commission. Sediment deposits that are removed or left in place after the barriers have been dismantled shall be graded manually to conform to the existing topography and vegetated using seeding or other long term cover as approved in the Landscape Plan. Bare ground that cannot be permanently stabilized within 30 days shall be stabilized by temporary measures.

Street Sweeping (\$500 per sweeping)

It is proposed that the parking and drive areas be swept with a wet brush street sweeper on a semi-annual basis, with at least two sweepings per year. One sweep shall be done at the end of the winter season (prior to the heavy rains), and the other sweep at the end of autumn (prior to snowfall).

Stormwater Management System

Catch Basins, Area Drains, and Drain Manholes (\$500 per CB structure per inspection/cleaning):

The catch basins, drain manholes, WQU's, infiltration systems, and area drains shall be inspected semi-annually, and cleaned out when sumps are approximately one foot full. The use of "clam shells" for sediment removal shall not be allowed; a vacuum truck shall be the approved method of cleaning. Integrity and functionality of oil hoods shall also be checked at the time of the inspection.

Water Quality Unit (WQU) (\$1000 per structure per inspection/cleaning):

Water Quality Unit shall be as follows and per manufacturer's recommendations:

- Units should be inspected post-construction, prior to being put into service.
- Inspect every six months for the first year of operation to determine the oil and sediment accumulation rate. In subsequent years, inspections can be based on first-year observations
- Cleaning is required once the sediment depth reaches 15% of storage capacity, (generally taking one year or longer).
- Inspect the unit immediately after an oil, fuel or chemical spill.
- A licensed waste management company should remove captured petroleum waste products from any oil, chemical or fuel spills and dispose responsibly

Rain Garden (\$750 per cleaning):

Inspection and Maintenance of Rain Gardens shall be conducted per the Bioretention Maintenance Schedule provided below from the Massachusetts Stormwater Handbook:

Bioretention Maintenance Schedule		
<i>Activity</i>	<i>Time of Year</i>	<i>Frequency</i>
Inspect & remove trash	Year round	Monthly
Mulch	Spring	Annually
Remove dead vegetation	Fall or Spring	Annually
Replace dead vegetation	Spring	Annually
Prune	Spring or Fall	Annually
Replace entire media & all vegetation	Late Spring/early Summer	As needed*

** Paying careful attention to pretreatment and operation & maintenance can extend the life of the soil media*

Infiltration System (\$2,500 per cleaning; \$1,000 per inspection)

The proposed infiltration system shall be inspected semi-annually, and shall follow the suggested schedule for routine maintenance during the regular operation of the stormwater system:

Inlets and Outlets	Every 3 years	<ul style="list-style-type: none"> Obtain documentation that the inlets, outlets and vents have been cleaned and will function as intended.
	Spring and Fall	<ul style="list-style-type: none"> Check inlet and outlets for clogging and remove any debris as required.
Stormwater Chambers	2 years after commissioning	<ul style="list-style-type: none"> Inspect the interior of the stormwater management chambers through inspection port for deficiencies using CCTV or comparable technique. Obtain documentation that the stormwater management chambers and feed connectors will function as anticipated.
	9 years after commissioning every 9 years following	<ul style="list-style-type: none"> Clean stormwater management chambers and feed connectors of any debris. Inspect the interior of the stormwater management structures for deficiencies using CCTV or comparable technique. Obtain documentation that the stormwater management chambers and feed connectors have been cleaned and will function as intended.
	45 years after commissioning	<ul style="list-style-type: none"> Clean stormwater management chambers and feed connectors of any debris. Determine the remaining life expectancy of the stormwater management chambers and recommended schedule and actions to rehabilitate the stormwater management chambers as required. Inspect the interior of the stormwater management chambers for deficiencies using CCTV or comparable technique. Replace or restore the stormwater management chambers in accordance with the schedule determined at the 45-year inspection. Attain the appropriate approvals as required. Establish a new operation and maintenance schedule.
Surrounding Site	Monthly in 1 st year	<ul style="list-style-type: none"> Check for depressions in areas over and surrounding the stormwater management system.
	Spring and Fall	<ul style="list-style-type: none"> Check for depressions in areas over and surrounding the stormwater management system.
	Yearly	<ul style="list-style-type: none"> Confirm that no unauthorized modifications have been performed to the site.

Maintenance and Emergency Repairs

Any maintenance or emergency repairs to the system will be the responsibility of the Owner.

INSPECTION REPORT FORM FOR STORM WATER SYSTEM

Project: Arlington High School, Arlington, MA
869 Massachusetts Avenue, Arlington, MA 02476

INSPECTOR: _____ **DATE:** _____

Regular Inspection: ☐
Inspection after Rainfall: ☐ **Amount of Rainfall:** _____ inches

BMP	Functioning Correctly	Notes/Action Taken
	Y/N	
	Y/N	
	Y/N	
	Y/N	
	Y/N	
	Y/N	
	Y/N	

Additional Observations: _____

Action Required: _____

To be performed by: _____ **On or Before:** _____

APPENDIX 5:

Calculations



NOAA Atlas 14, Volume 10, Version 3
Location name: Arlington, Massachusetts, USA*
Latitude: 42.4182°, Longitude: -71.1617°
Elevation: 49.76 ft**
 * source: ESRI Maps
 ** source: USGS



POINT PRECIPITATION FREQUENCY ESTIMATES

Sanja Perica, Sandra Pavlovic, Michael St. Laurent, Carl Trypaluk, Dale Unruh, Orlan Wilhite

NOAA, National Weather Service, Silver Spring, Maryland

[PF tabular](#) | [PF graphical](#) | [Maps & aerals](#)


PF tabular

PDS-based point precipitation frequency estimates with 90% confidence intervals (in inches) ¹										
Duration	Average recurrence interval (years)									
	1	2	5	10	25	50	100	200	500	1000
5-min	0.304 (0.236-0.386)	0.373 (0.289-0.474)	0.485 (0.376-0.619)	0.578 (0.445-0.742)	0.705 (0.526-0.953)	0.800 (0.586-1.11)	0.901 (0.644-1.30)	1.02 (0.687-1.50)	1.20 (0.779-1.84)	1.36 (0.858-2.11)
10-min	0.431 (0.335-0.547)	0.528 (0.410-0.671)	0.686 (0.531-0.876)	0.817 (0.629-1.05)	0.998 (0.746-1.35)	1.13 (0.830-1.57)	1.28 (0.913-1.85)	1.45 (0.974-2.13)	1.70 (1.10-2.60)	1.92 (1.22-2.99)
15-min	0.507 (0.394-0.644)	0.621 (0.482-0.790)	0.808 (0.625-1.03)	0.962 (0.740-1.24)	1.18 (0.877-1.59)	1.33 (0.976-1.85)	1.50 (1.07-2.17)	1.70 (1.15-2.51)	2.00 (1.30-3.06)	2.26 (1.43-3.52)
30-min	0.694 (0.539-0.881)	0.851 (0.661-1.08)	1.11 (0.858-1.41)	1.32 (1.02-1.70)	1.62 (1.21-2.19)	1.84 (1.35-2.55)	2.07 (1.48-3.00)	2.35 (1.58-3.47)	2.78 (1.80-4.25)	3.15 (1.99-4.91)
60-min	0.881 (0.685-1.12)	1.08 (0.840-1.38)	1.41 (1.09-1.80)	1.68 (1.30-2.16)	2.06 (1.54-2.79)	2.34 (1.72-3.25)	2.64 (1.89-3.83)	3.00 (2.02-4.42)	3.56 (2.31-5.44)	4.04 (2.56-6.31)
2-hr	1.15 (0.897-1.45)	1.41 (1.10-1.78)	1.84 (1.43-2.33)	2.19 (1.70-2.80)	2.69 (2.02-3.62)	3.05 (2.26-4.21)	3.44 (2.49-4.98)	3.94 (2.66-5.75)	4.71 (3.06-7.14)	5.39 (3.42-8.33)
3-hr	1.34 (1.05-1.68)	1.64 (1.29-2.06)	2.14 (1.67-2.70)	2.55 (1.99-3.24)	3.12 (2.36-4.19)	3.54 (2.63-4.88)	4.00 (2.91-5.78)	4.59 (3.10-6.66)	5.50 (3.58-8.28)	6.30 (4.01-9.68)
6-hr	1.73 (1.37-2.16)	2.12 (1.68-2.65)	2.76 (2.17-3.46)	3.29 (2.57-4.15)	4.02 (3.06-5.34)	4.55 (3.40-6.21)	5.14 (3.75-7.35)	5.88 (3.99-8.46)	7.04 (4.59-10.5)	8.05 (5.13-12.2)
12-hr	2.20 (1.76-2.73)	2.70 (2.15-3.35)	3.51 (2.78-4.37)	4.18 (3.29-5.23)	5.10 (3.90-6.73)	5.78 (4.34-7.81)	6.52 (4.78-9.22)	7.44 (5.07-10.6)	8.86 (5.81-13.1)	10.1 (6.46-15.2)
24-hr	2.64 (2.12-3.25)	3.28 (2.63-4.04)	4.31 (3.44-5.33)	5.17 (4.10-6.43)	6.35 (4.89-8.32)	7.22 (5.46-9.69)	8.17 (6.02-11.5)	9.36 (6.41-13.2)	11.2 (7.38-16.4)	12.8 (8.24-19.1)
2-day	3.01 (2.43-3.68)	3.80 (3.07-4.65)	5.10 (4.10-6.26)	6.17 (4.93-7.62)	7.65 (5.94-9.98)	8.73 (6.66-11.7)	9.93 (7.40-13.9)	11.5 (7.89-16.1)	14.0 (9.22-20.3)	16.2 (10.4-23.9)
3-day	3.30 (2.68-4.01)	4.15 (3.37-5.06)	5.55 (4.48-6.78)	6.71 (5.38-8.24)	8.30 (6.47-10.8)	9.46 (7.25-12.6)	10.8 (8.05-15.0)	12.5 (8.57-17.3)	15.2 (10.0-21.9)	17.6 (11.4-25.9)
4-day	3.57 (2.91-4.33)	4.45 (3.62-5.41)	5.90 (4.78-7.19)	7.09 (5.71-8.69)	8.74 (6.83-11.3)	9.94 (7.63-13.2)	11.3 (8.46-15.7)	13.0 (8.99-18.1)	15.9 (10.5-22.8)	18.4 (11.9-26.9)
7-day	4.33 (3.55-5.23)	5.25 (4.30-6.34)	6.75 (5.50-8.18)	8.00 (6.48-9.74)	9.71 (7.63-12.5)	11.0 (8.44-14.4)	12.4 (9.28-17.0)	14.2 (9.81-19.5)	17.1 (11.3-24.3)	19.6 (12.7-28.4)
10-day	5.03 (4.14-6.05)	5.98 (4.91-7.19)	7.52 (6.15-9.08)	8.80 (7.15-10.7)	10.6 (8.31-13.5)	11.9 (9.14-15.5)	13.3 (9.96-18.1)	15.1 (10.5-20.6)	17.9 (11.9-25.3)	20.4 (13.2-29.4)
20-day	7.03 (5.83-8.39)	8.06 (6.67-9.63)	9.74 (8.03-11.7)	11.1 (9.12-13.4)	13.1 (10.3-16.4)	14.5 (11.2-18.6)	16.0 (11.9-21.2)	17.8 (12.4-24.0)	20.3 (13.6-28.4)	22.4 (14.6-31.9)
30-day	8.69 (7.23-10.3)	9.78 (8.13-11.6)	11.6 (9.58-13.8)	13.1 (10.7-15.7)	15.1 (11.9-18.8)	16.7 (12.8-21.1)	18.2 (13.5-23.8)	19.9 (14.0-26.8)	22.2 (14.9-30.9)	24.0 (15.7-34.1)
45-day	10.8 (9.01-12.8)	11.9 (9.97-14.1)	13.8 (11.5-16.5)	15.4 (12.7-18.4)	17.6 (13.9-21.7)	19.3 (14.9-24.2)	20.9 (15.5-27.0)	22.6 (15.9-30.1)	24.7 (16.6-34.0)	26.2 (17.1-36.9)
60-day	12.6 (10.5-14.8)	13.8 (11.5-16.3)	15.8 (13.1-18.7)	17.4 (14.4-20.7)	19.7 (15.6-24.1)	21.5 (16.6-26.7)	23.2 (17.1-29.6)	24.8 (17.5-32.9)	26.7 (18.0-36.7)	28.1 (18.4-39.4)

¹ Precipitation frequency (PF) estimates in this table are based on frequency analysis of partial duration series (PDS). Numbers in parenthesis are PF estimates at lower and upper bounds of the 90% confidence interval. The probability that precipitation frequency estimates (for a given duration and average recurrence interval) will be greater than the upper bound (or less than the lower bound) is 5%. Estimates at upper bounds are not checked against probable maximum precipitation (PMP) estimates and may be higher than currently valid PMP values. Please refer to NOAA Atlas 14 document for more information.

[Back to Top](#)


PF graphical

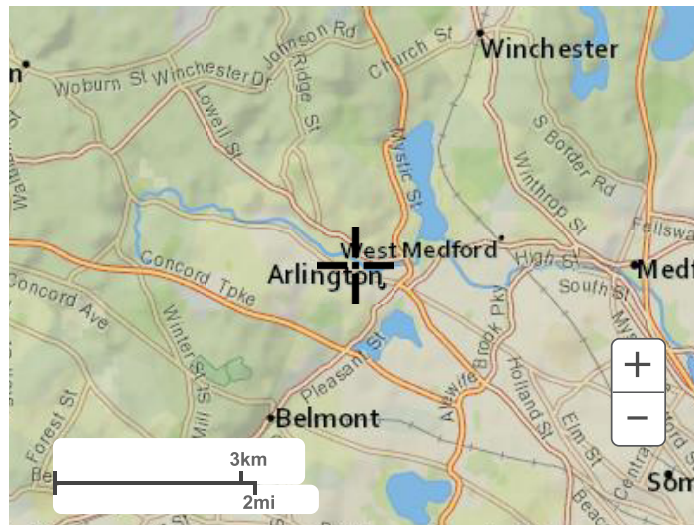

Large scale terrain



Large scale map

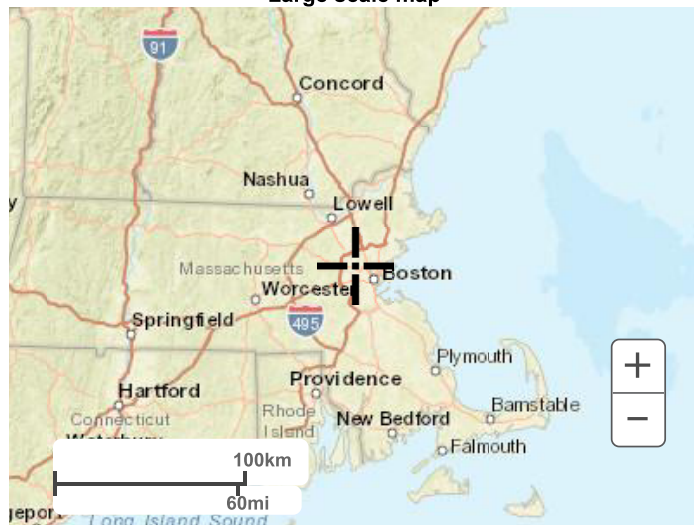

Large scale aerial

STORM DRAIN COMPUTATION SHEET

5/7/2020

Section 1: Direct Inlet "Branch" Segments (Area Drains, Catch Basins, etc.)

SEGMENT			WATERSHED CHARACTERISTICS					PIPE CHARACTERISTICS				MANNING'S VALUES					
			Design Frequency		25-year							Pipe Design Depth				1.00 D	
No.	Start	End	Drain Area	Runoff Coeff.	Time of Conc. min	Rainfall Intens.	Q (min) cfs	Pipe Diameter D in	Pipe Material	Pipe Length ft	Pipe Slope	n	A sf	R ft	Q (max)	Head above invert ft	Velocity fps
(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(10)	(11)	(12)	(13)	(14)	(15)	(16)	(17)	(18)	(19)
1	CB1	DMH1	0.123	0.95	6.0	5.90	0.70	12	HDPE	177	0.015	0.011	0.785	0.250	5.17	-	0.0 fps
2	CB2	DMH1	0.117	0.95	6.0	5.90	0.66	12	HDPE	6	0.010	0.011	0.785	0.250	4.22	-	3.6 fps
3	CB3	DMH12	0.443	0.58	6.0	5.90	1.54	12	HDPE	171	0.005	0.011	0.785	0.250	2.99	-	4.0 fps
4	CB4	RG2	0.372	0.95	6.0	5.90	2.31	12	HDPE	128	0.050	0.011	0.785	0.250	9.44	-	9.4 fps
5	CB5	DMH3	0.474	0.90	6.0	5.90	2.53	12	HDPE	183	0.050	0.010	0.785	0.250	10.38	-	11.5 fps
6	CB6	DMH11	0.305	0.80	6.0	5.90	1.45	12	HDPE	52	0.042	0.011	0.785	0.250	8.65	-	7.7 fps
7	CB7	DMH11	0.641	0.94	6.0	5.90	3.57	12	HDPE	60	0.009	0.011	0.785	0.250	4.01	-	5.1 fps
8	CB8	WQU1	0.200	0.95	6.0	5.90	1.13	12	HDPE	11	0.020	0.011	0.785	0.250	5.97	-	7.6 fps
9	CB9	WQU1	0.157	0.80	6.0	5.90	0.74	12	HDPE	76	0.010	0.011	0.785	0.250	4.22	-	5.4 fps
10	CB10	DMH3	0.502	0.86	6.0	5.90	2.57	12	HDPE	21	0.030	0.011	0.785	0.250	7.31	-	9.3 fps
11	CB11	DMH5	0.727	0.57	6.0	5.90	2.49	12	HDPE	47	0.010	0.011	0.785	0.250	4.22	-	5.4 fps
12	CB12	DMH7	1.070	0.70	6.0	5.90	4.43	12	HDPE	46	0.020	0.011	0.785	0.250	5.97	-	7.6 fps
13	CB13	MILL BRK	0.309	0.84	6.0	5.90	1.55	12	HDPE	45	0.030	0.011	0.785	0.250	7.31	-	9.3 fps
14	TD-2	DMH2	0.237	0.92	6.0	5.90	1.29	12	HDPE	107	0.010	0.011	0.785	0.250	4.22	-	5.4 fps
15	AD-3	DMH1	0.101	0.42	6.0	5.90	0.25	8	HDPE	48	0.005	0.011	0.349	0.167	1.01	-	2.9 fps
16	AD-5	DMH14	0.034	0.95	6.0	5.90	0.19	8	HDPE	20	0.100	0.011	0.349	0.167	4.53	-	13.0 fps
17	AD-6	DMH4	0.046	0.52	6.0	5.90	0.14	8	HDPE	5	0.010	0.011	0.349	0.167	1.43	-	4.1 fps
18	AD-7	DMH5	0.023	0.25	6.0	5.90	0.03	8	HDPE	12	0.010	0.011	0.349	0.167	1.43	-	4.1 fps
19	RD-1	DMH13	0.656	0.95	6.0	5.90	3.71	12	HDPE	150	0.010	0.011	0.785	0.250	4.22	-	5.4 fps
20	RD-2	DMH13	0.576	0.95	6.0	5.90	3.25	12	HDPE	14	0.025	0.011	0.785	0.250	6.68	-	8.5 fps
21	RD-3	DMH8	0.232	0.95	6.0	5.90	1.31	10	HDPE	20	0.030	0.011	0.545	0.208	4.50	-	8.2 fps
22	RD-4	DMH6	0.862	0.95	6.0	5.90	4.87	12	HDPE	52	0.020	0.011	0.785	0.250	5.97	-	7.6 fps
23	RD-5	DMH5	0.709	0.95	6.0	5.90	4.01	12	HDPE	49	0.010	0.011	0.785	0.250	4.22	-	5.4 fps
24	RD-6	DMH4	0.333	0.95	6.0	5.90	1.88	12	HDPE	8	0.010	0.011	0.785	0.250	4.22	-	5.4 fps
25	RD-7	DMH14	0.186	0.95	6.0	5.90	1.05	12	HDPE	7	0.010	0.011	0.785	0.250	4.22	-	5.4 fps
26	AD15	DMH3	0.307	0.22	6.0	5.90	0.40	6	PVC	106	0.015	0.010	0.196	0.125	0.90	-	4.6 fps
27	AD10	DMH8	0.132	0.71	6.0	5.90	0.56	6	PVC	200	0.016	0.010	0.196	0.125	0.93	-	4.7 fps

STORM DRAIN COMPUTATION SHEET

Section 2: Main Line "Trunk" Segments (Drain Basins, Manholes, etc.)

SEGMENT			WATERSHED CHARACTERISTICS	PIPE CHARACTERISTICS				MANNING'S VALUES						
			Design Frequency	25-year					Pipe Design Depth		1.00 D			
No.	Start	End	Q (min)		Pipe Diameter	Pipe Material	Pipe Length	Pipe Slope	n	A	R	Q (max)	Head above invert	Velocity
1	DMH1	DMH2	1.36		12	HDPE	46	0.010	0.011	0.785	0.250	4.22	-	4.6 fps
2	DMH2	RG1	2.65		12	HDPE	99	0.050	0.011	0.785	0.250	9.44	-	9.7 fps
3	DMH14	DMH3	1.24		12	HDPE	33	0.010	0.011	0.785	0.250	4.22	-	4.4 fps
4	DMH3	DMH4	10.18		24	HDPE	81	0.005	0.011	3.142	0.500	18.96	-	6.2 fps
5	DMH4	DMH5	12.20		24	HDPE	90	0.005	0.011	3.142	0.500	18.96	-	6.5 fps
6	DMH5	DMH6	21.10		30	HDPE	108	0.005	0.011	4.909	0.625	34.37	-	7.5 fps
7	DMH6	DMH7	25.97		30	HDPE	74	0.005	0.011	4.909	0.625	34.37	-	7.0 fps
8	DMH7	DMH8	30.39		30	HDPE	115	0.005	0.011	4.909	0.625	34.37	-	7.0 fps
9	DMH8	DMH9	32.27		30	HDPE	90	0.005	0.011	4.909	0.625	34.37	-	7.0 fps
10	DMH11	DMH10	5.02		15	HDPE	20	0.005	0.011	1.227	0.313	5.41	-	4.4 fps
11	DMH10	UGS1	6.57		18	HDPE	4	0.005	0.011	1.767	0.375	8.80	-	5.6 fps
12	WQU1	MILL BRK	1.87		12	HDPE	11	0.020	0.011	0.785	0.250	5.97	-	7.6 fps
13	DMH13	DMH15	6.96		12	HDPE	62	0.030	0.011	0.785	0.250	7.31	-	9.3 fps
14	DMH15	DMH12	6.96		12	HDPE	47	0.240	0.011	0.785	0.250	20.68	-	26.3 fps
15	DMH12	DMH16	6.96		12	HDPE	82	0.130	0.011	0.785	0.250	15.22	-	19.4 fps
16	DMH16	DMH17	6.96		15	HDPE	70	0.027	0.011	1.227	0.313	12.58	-	10.2 fps
17	DMH17	DMH18	6.96		15	HDPE	80	0.025	0.011	1.227	0.313	12.10	-	9.9 fps

Stage-Area-Storage for Pond 5P: rain garden#1 cascading

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	
58.50	150	0	61.10	263	206	
58.55	150	3	61.15	276	220	
58.60	150	6	61.20	289	234	
58.65	150	9	61.25	303	249	
58.70	150	12	61.30	316	264	
58.75	150	15	61.35	329	280	
58.80	150	18	61.40	343	297	
58.85	150	21	61.45	356	315	
58.90	150	24	61.50	370	333	
58.95	150	27	61.55	383	352	
59.00	150	30	61.60	396	371	
59.05	150	32	61.65	410	391	
59.10	150	34	61.70	423	412	
59.15	150	36	61.75	436	434	
59.20	150	38	61.80	450	456	
59.25	150	39	61.85	463	479	
59.30	150	41	61.90	476	502	
59.35	150	43	61.95	490	526	
59.40	150	45	62.00	503	551	← STATIC STORAGE
59.45	150	47	62.05	511	576	
59.50	150	49	62.10	519	602	
59.55	150	51	62.15	527	628	
59.60	150	53	62.20	534	655	
59.65	150	54	62.25	542	682	
59.70	150	56	62.30	550	709	
59.75	150	58	62.35	558	737	
59.80	150	60	62.40	566	765	
59.85	150	62	62.45	574	793	
59.90	150	64	62.50	582	822	
59.95	150	66	62.55	589	851	
60.00	150	68	62.60	597	881	
60.05	150	69	62.65	605	911	
60.10	150	71	62.70	613	942	
60.15	150	73	62.75	621	972	
60.20	150	75	62.80	629	1,004	
60.25	150	77	62.85	636	1,035	
60.30	150	79	62.90	644	1,067	
60.35	150	80	62.95	652	1,100	
60.40	150	82	63.00	660	1,132	
60.45	150	83				
60.50	150	85				
60.55	159	93				
60.60	167	101				
60.65	176	109				
60.70	184	118				
60.75	193	128				
60.80	202	138				
60.85	210	148				
60.90	219	159				
60.95	227	170				
61.00	236	181				
61.05	249	194				

Stage-Area-Storage for Pond 2P: rain garden#2 cascading

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	
51.00	400	0	53.60	576	520	
51.05	400	8	53.65	591	549	
51.10	400	16	53.70	606	579	
51.15	400	24	53.75	621	609	
51.20	400	32	53.80	635	641	
51.25	400	40	53.85	650	673	
51.30	400	48	53.90	665	706	
51.35	400	56	53.95	679	739	
51.40	400	64	54.00	694	774	
51.45	400	72	54.05	726	809	
51.50	400	80	54.10	757	846	
51.55	400	85	54.15	789	885	
51.60	400	90	54.20	820	925	
51.65	400	95	54.25	852	967	
51.70	400	100	54.30	884	1,010	
51.75	400	105	54.35	915	1,055	
51.80	400	110	54.40	947	1,102	
51.85	400	115	54.45	978	1,150	
51.90	400	120	54.50	1,010	1,200	— STATIC STORAGE
51.95	400	125	54.55	1,042	1,251	
52.00	400	130	54.60	1,073	1,304	
52.05	400	135	54.65	1,105	1,358	
52.10	400	140	54.70	1,136	1,414	
52.15	400	145	54.75	1,168	1,472	
52.20	400	150	54.80	1,200	1,531	
52.25	400	155	54.85	1,231	1,592	
52.30	400	160	54.90	1,263	1,654	
52.35	400	165	54.95	1,294	1,718	
52.40	400	170	55.00	1,326	1,784	
52.45	400	175				
52.50	400	180				
52.55	400	185				
52.60	400	190				
52.65	400	195				
52.70	400	200				
52.75	400	205				
52.80	400	210				
52.85	400	215				
52.90	400	219				
52.95	400	223				
53.00	400	227				
53.05	415	247				
53.10	429	268				
53.15	444	290				
53.20	459	312				
53.25	474	336				
53.30	488	360				
53.35	503	385				
53.40	518	410				
53.45	532	436				
53.50	547	463				
53.55	562	491				

Stage-Area-Storage for Pond 3P: rain garden#3 cascading

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	
46.00	600	0	48.60	814	764	
46.05	600	12	48.65	832	805	
46.10	600	24	48.70	850	847	
46.15	600	36	48.75	868	890	
46.20	600	48	48.80	886	934	
46.25	600	60	48.85	903	979	
46.30	600	72	48.90	921	1,024	
46.35	600	84	48.95	939	1,071	
46.40	600	96	49.00	957	1,118	
46.45	600	108	49.05	978	1,167	
46.50	600	120	49.10	999	1,216	
46.55	600	127	49.15	1,019	1,267	
46.60	600	135	49.20	1,040	1,318	
46.65	600	142	49.25	1,061	1,371	
46.70	600	150	49.30	1,082	1,424	
46.75	600	158	49.35	1,103	1,479	
46.80	600	165	49.40	1,123	1,534	
46.85	600	173	49.45	1,144	1,591	
46.90	600	180	49.50	1,165	1,649	
46.95	600	188	49.55	1,186	1,708	
47.00	600	195	49.60	1,207	1,767	
47.05	600	202	49.65	1,227	1,828	
47.10	600	210	49.70	1,248	1,890	
47.15	600	217	49.75	1,269	1,953	
47.20	600	225	49.80	1,290	2,017	
47.25	600	233	49.85	1,311	2,082	
47.30	600	240	49.90	1,331	2,148	
47.35	600	248	49.95	1,352	2,215	
47.40	600	255	50.00	1,373	2,283	STATIC STORAGE
47.45	600	263	50.05	1,405	2,353	
47.50	600	270	50.10	1,437	2,424	
47.55	600	277	50.15	1,470	2,497	
47.60	600	285	50.20	1,502	2,571	
47.65	600	292	50.25	1,534	2,647	
47.70	600	300	50.30	1,566	2,724	
47.75	600	308	50.35	1,598	2,803	
47.80	600	315	50.40	1,631	2,884	
47.85	600	322	50.45	1,663	2,966	
47.90	600	328	50.50	1,695	3,050	
47.95	600	334				
48.00	600	340				
48.05	618	370				
48.10	636	402				
48.15	654	434				
48.20	671	467				
48.25	689	501				
48.30	707	536				
48.35	725	572				
48.40	743	608				
48.45	761	646				
48.50	779	685				
48.55	796	724				

Stage-Area-Storage for Pond 4P: UGS-1

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
39.50	1,672	0	44.70	1,672	5,122
39.60	1,672	59	44.80	1,672	5,180
39.70	1,672	117	44.90	1,672	5,239
39.80	1,672	176	45.00	1,672	5,297
39.90	1,672	234	45.10	1,672	5,297
40.00	1,672	293	45.20	1,672	5,297
40.10	1,672	351	45.30	1,672	5,297
40.20	1,672	410	45.40	1,672	5,297
40.30	1,672	508	45.50	1,672	5,297
40.40	1,672	645	45.60	1,672	5,297
40.50	1,672	783	45.70	1,672	5,297
40.60	1,672	919	45.80	1,672	5,297
40.70	1,672	1,055	45.90	1,672	5,297
40.80	1,672	1,190	46.00	1,672	5,297
40.90	1,672	1,325	46.10	1,672	5,297
41.00	1,672	1,459	46.20	1,672	5,297
41.10	1,672	1,592	46.30	1,672	5,297
41.20	1,672	1,724	46.40	1,672	5,297
41.30	1,672	1,855	46.50	1,672	5,297
41.40	1,672	1,986	46.60	1,672	5,297
41.50	1,672	2,116	46.70	1,672	5,297
41.60	1,672	2,244	46.80	1,672	5,297
41.70	1,672	2,372	46.90	1,672	5,297
41.80	1,672	2,498	47.00	1,672	5,297
41.90	1,672	2,623	47.10	1,672	5,297
42.00	1,672	2,747	47.20	1,672	5,297
42.10	1,672	2,870	47.30	1,672	5,297
42.20	1,672	2,991	47.40	1,672	5,297
42.30	1,672	3,110	47.50	1,672	5,297
42.40	1,672	3,228	47.60	1,672	5,297
42.50	1,672	3,344			
42.60	1,672	3,458			
42.70	1,672	3,570			
42.80	1,672	3,680			
42.90	1,672	3,788			
43.00	1,672	3,893			
43.10	1,672	3,995			
43.20	1,672	4,094			
43.30	1,672	4,190			
43.40	1,672	4,282			
43.50	1,672	4,369			
43.60	1,672	4,449			
43.70	1,672	4,522			
43.80	1,672	4,588			
43.90	1,672	4,652			
44.00	1,672	4,712			
44.10	1,672	4,771			
44.20	1,672	4,829			
44.30	1,672	4,888			
44.40	1,672	4,946			
44.50	1,672	5,005			
44.60	1,672	5,063			

— STATIC STORAGE

ARLINGTON HIGH SCHOOL CULVERT RELOCATION

Existing Culvert:

In the existing condition there is a large culvert, consisting of a 36" reinforced concrete pipe (RCP), that flows under the existing building and discharges to the Mill Brook culvert. This culvert carries a large watershed from South of the project site which measures 4,626,374 sf (106.20 Ac). Historically this culvert has been shown to be undersized and has caused flooding and foloor buckling within the basement of the high school and will be relocated and improved under post construction conditions while keeping the flow rates equal to the existing flow rates so that the stormwater doesn't impact areas downstream.

Results/ Summary

Through the use of the rational method to anticipate pipe discharge rates, both the existing and proposed culvert were modeled to show flows for the 25 year storm event.



The watershed that contributes to the culvert is large and holds approximately 40.36 acres,as shown in the chart entitled WATERSHED DRAINAGE CALCULATIONS below.

WATERSHED DRAINAGE CALCULATIONS											
LOCATION	IMPERVIOUS AREA			OTHER			SUM		I	Q	
FROM	TO	A (Ac)	C	CA	A (Ac)	C	CA	CA	Tc (in/hr)	IxCA	DESIGN PERIOD
Watershed	Culvert	40.36	0.9	36.32	65.85	0.3	19.76	56.08	11.6	6.0	25-YEAR
										336.47	

As shown in Table 1, the post development flows are similar to the pre-development flows so that the new culvert will not have an adverse effect to downstream areas.



Existing Culvert 36" RCP											
Ex. MH	Pipe Bend	40.36	0.9	36.32	65.85	0.3	19.76	56.08	11.6	6.0	47.16
Pipe Bend	Ex. MH 1	40.36	0.9	36.32	65.85	0.3	19.76	56.08	11.6	6.0	266.79
	Site Area 1	0.47	0.9	0.42	1.07	0.3	0.32	0.74	11.6	6.0	
Ex. MH 1	Ex. MH 2	40.83	0.9	36.75	66.92	0.3	20.08	56.82	11.6	6.0	152.10
Ex. MH 2	Ex. MH 3	40.83	0.9	36.75	66.92	0.3	20.08	56.82	11.6	6.0	77.21
	Site Area 2	0.56	0.9	0.50	0.74	0.3	0.22	0.73	11.6	6.0	
Ex. MH 3	Ex. MH 4	41.39	0.9	37.25	67.66	0.3	20.30	57.55	11.6	6.0	78.64
	Site Area 3	0.67	0.9	0.60	0.18	0.3	0.05	0.66	11.6	6.0	
Ex. MH 4	Ex. culvert	42.06	0.9	37.85	67.84	0.3	20.35	58.21	11.6	6.0	47.16
Proposed Culvert - 48" / 36" CLDI Blended Option											
Ex. MH	DS-1	40.36	0.9	36.32	65.85	0.3	19.76	56.08	11.6	6.0	47.16
DS-1	ACC PT 1	40.36	0.9	36.32	65.85	0.3	19.76	56.08	11.6	6.0	336.64
ACC PT 1	ACC PT 2	40.36	0.9	36.32	65.85	0.3	19.76	56.08	11.6	6.0	237.46
ACC PT 2	ACC PT 3	40.36	0.9	36.32	65.85	0.3	19.76	56.08	11.6	6.0	156.31
ACC PT 3	DS-2	40.36	0.9	36.32	65.85	0.3	19.76	56.08	11.6	6.0	77.55
DS-2	Ex. culvert	40.36	0.9	36.32	65.85	0.3	19.76	56.08	11.6	6.0	47.16

APPENDIX 6:
Sketches

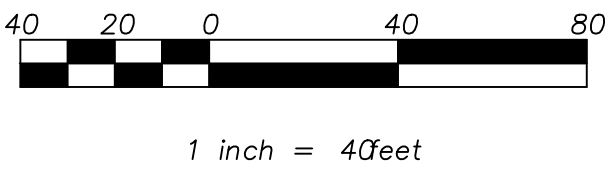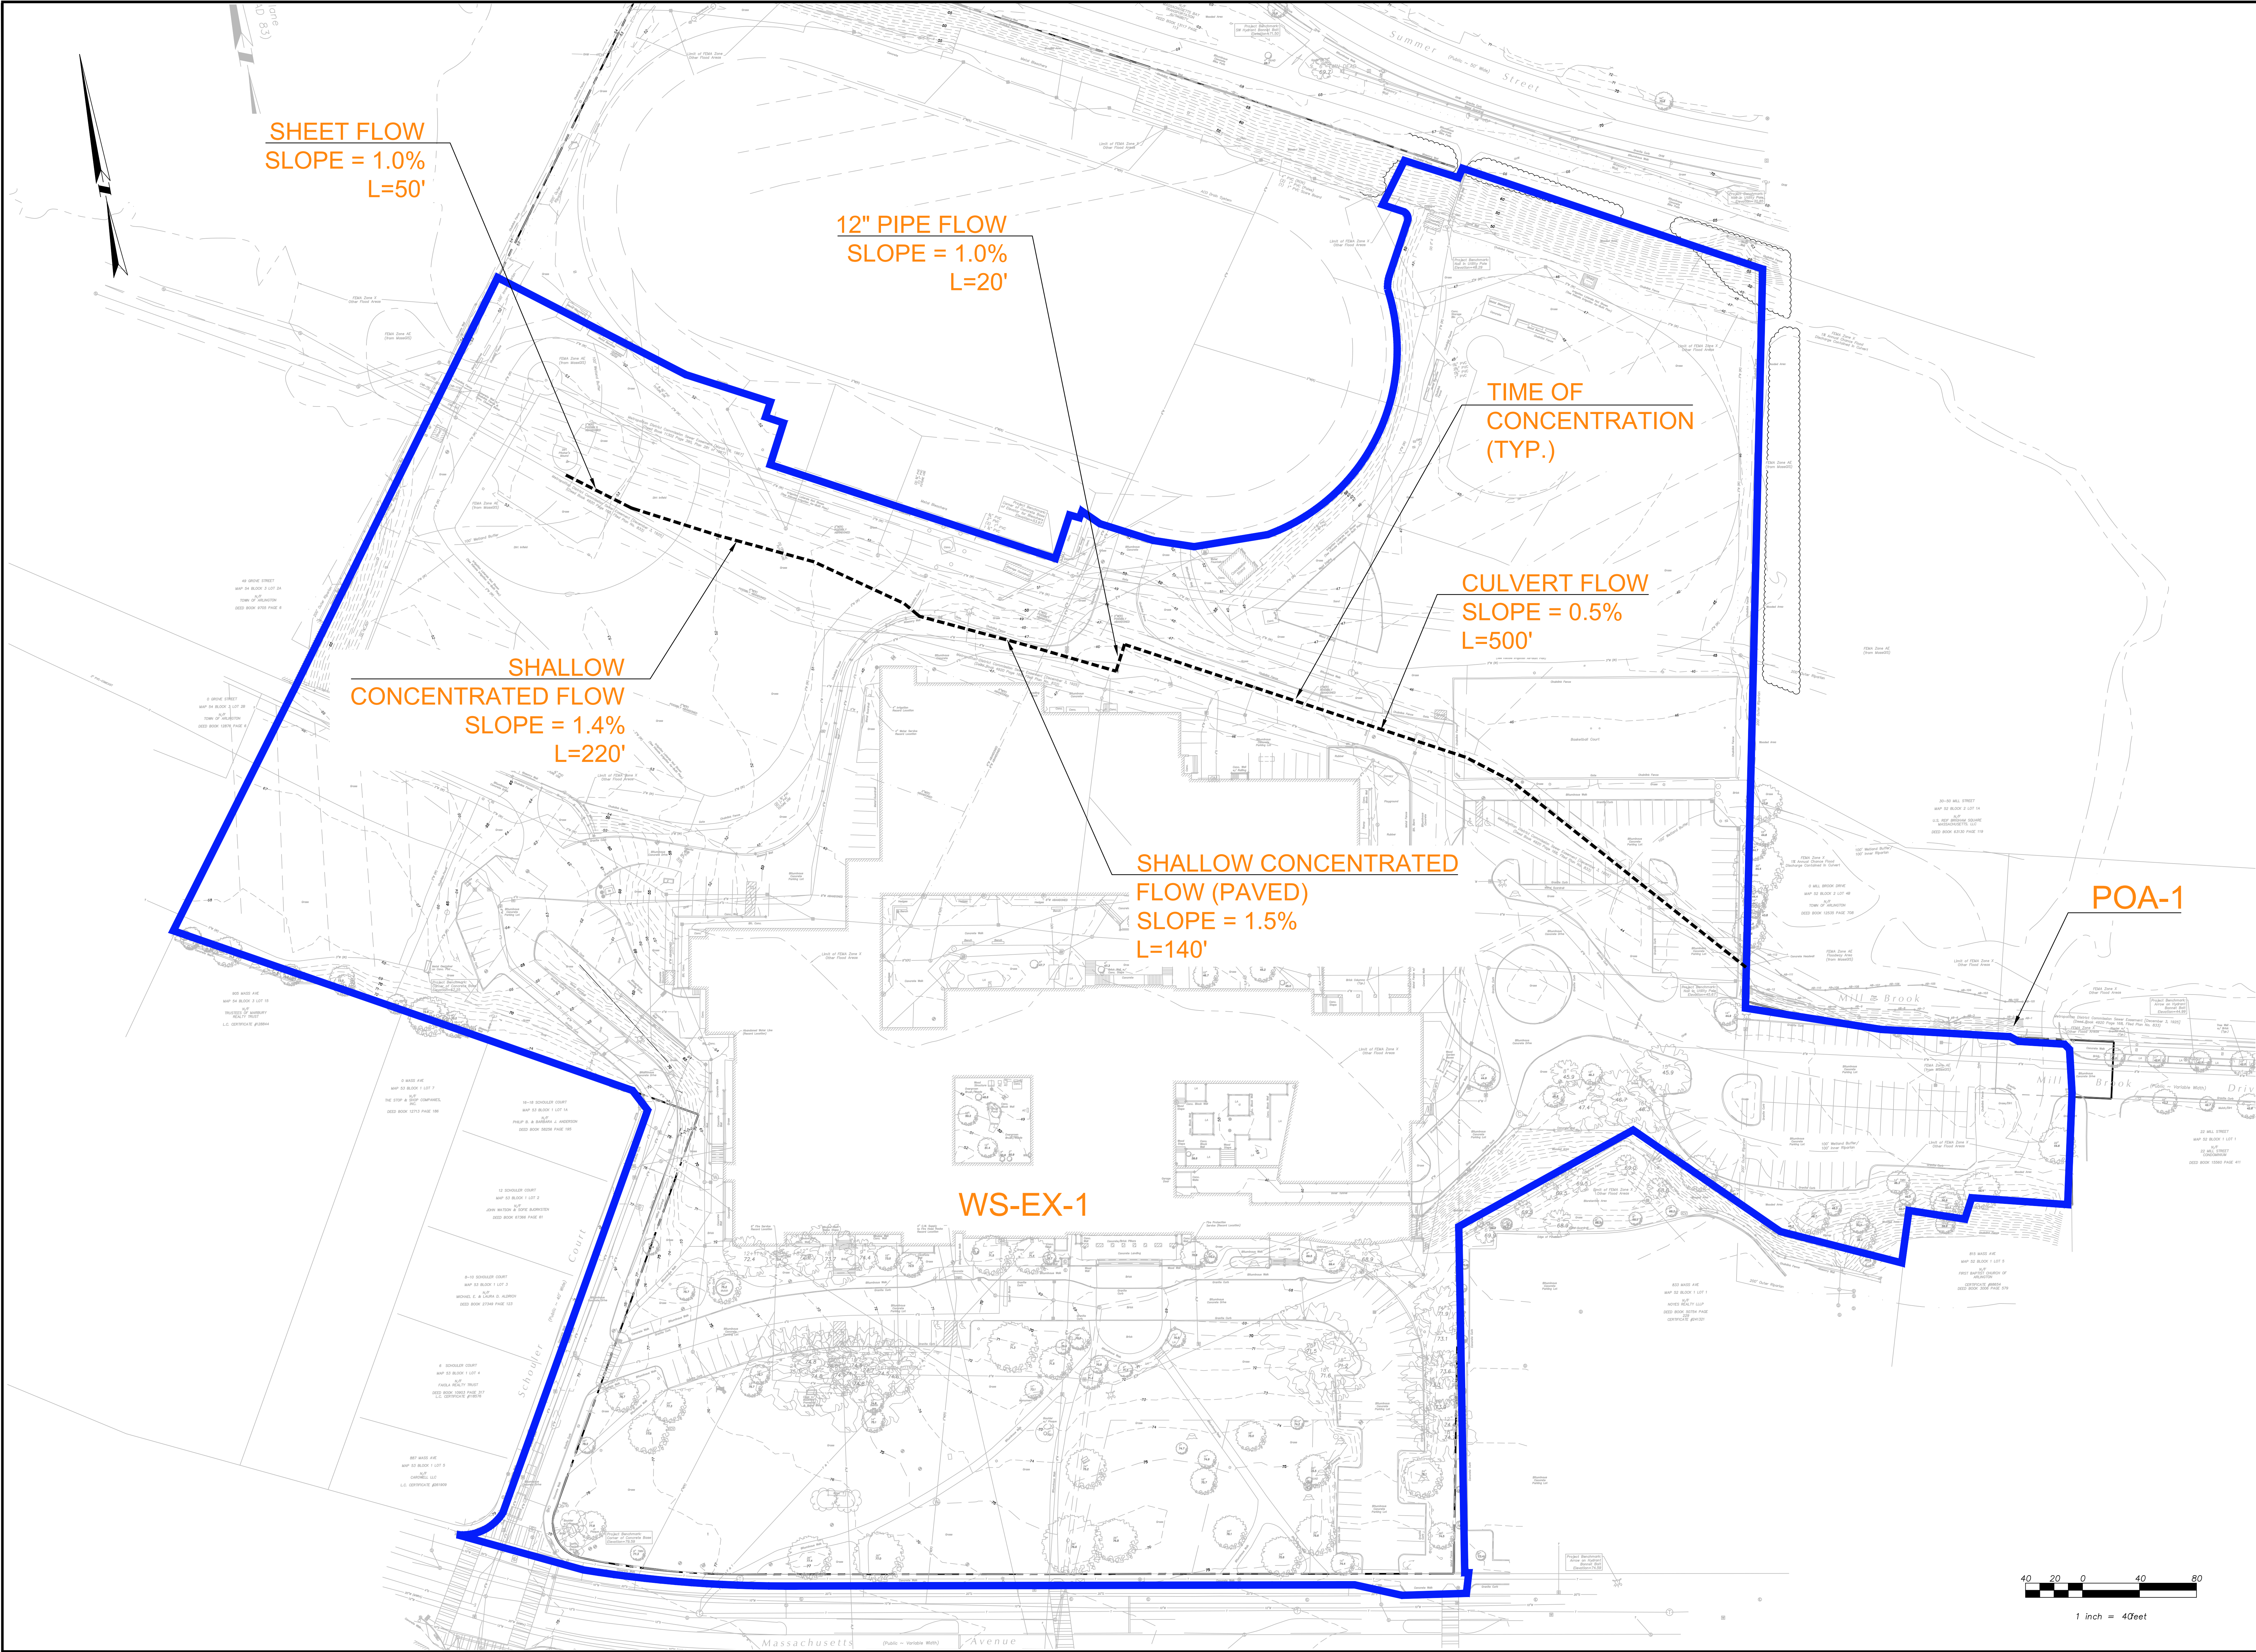

KEYPLAN		
REVISIONS NO.	DATE	REMARKS

BY:
DRAWING NUMBER: **EX-HYD**
JOB NUMBER: 17211

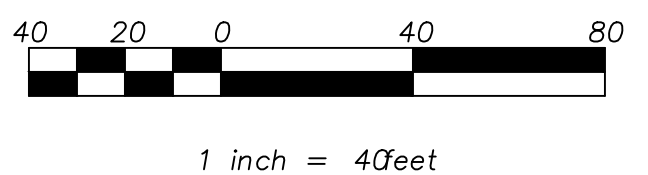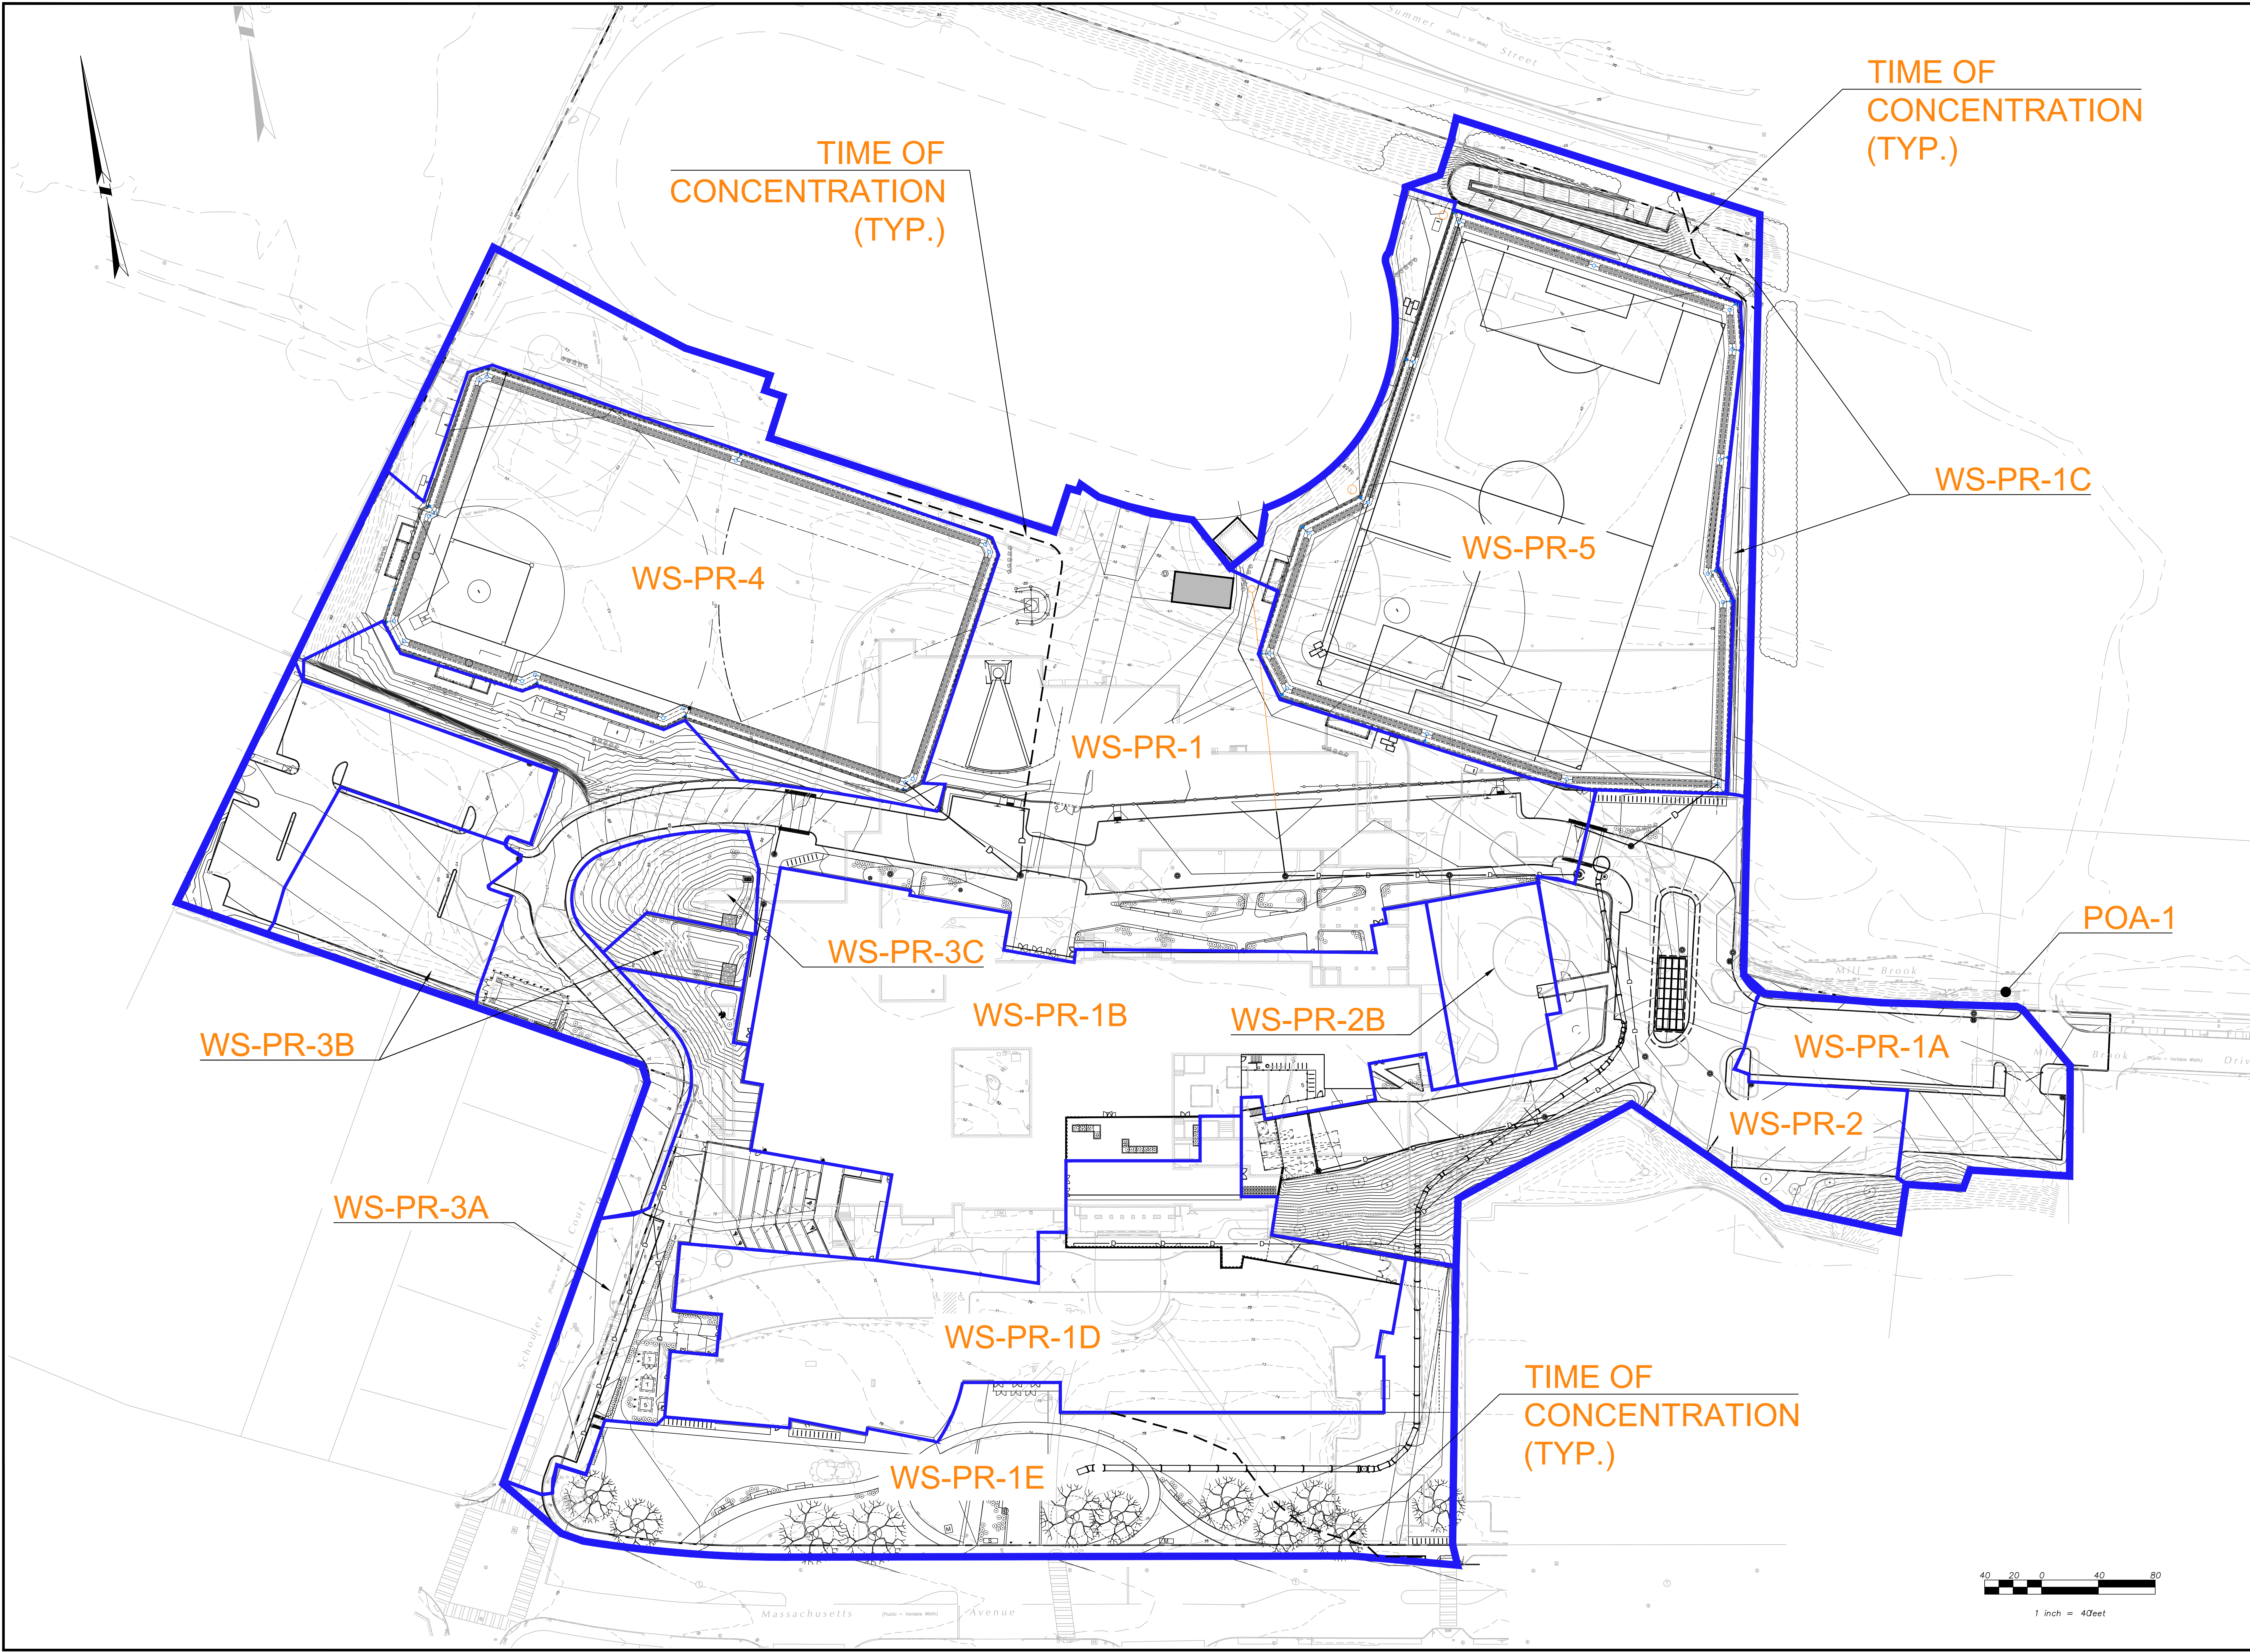

KEYPLAN		
REVISIONS NO.	DATE	REMARKS

Arlington High School
Massachusetts Avenue, Arlington, Massachusetts
PROPOSED CONDITIONS
HYDROLOGY MAP
SCALE

DRAWING NUMBER
P-HYD


CHECKED BY: SM
DRAWN BY: SM

60% CONSTRUCTION DOCUMENTS
PROGRESS SET 05-04-2020

Samioles Consultants Inc.
100 Brookline Avenue
30th Street
Framingham, MA 01701
T 508.877.6688 F 508.877.6849
www.samioles.com



HM
FH
ARCHITECTS
100 Bishop Allen Drive
Cambridge, MA 02139
877.682.2200
info@hmfh.com

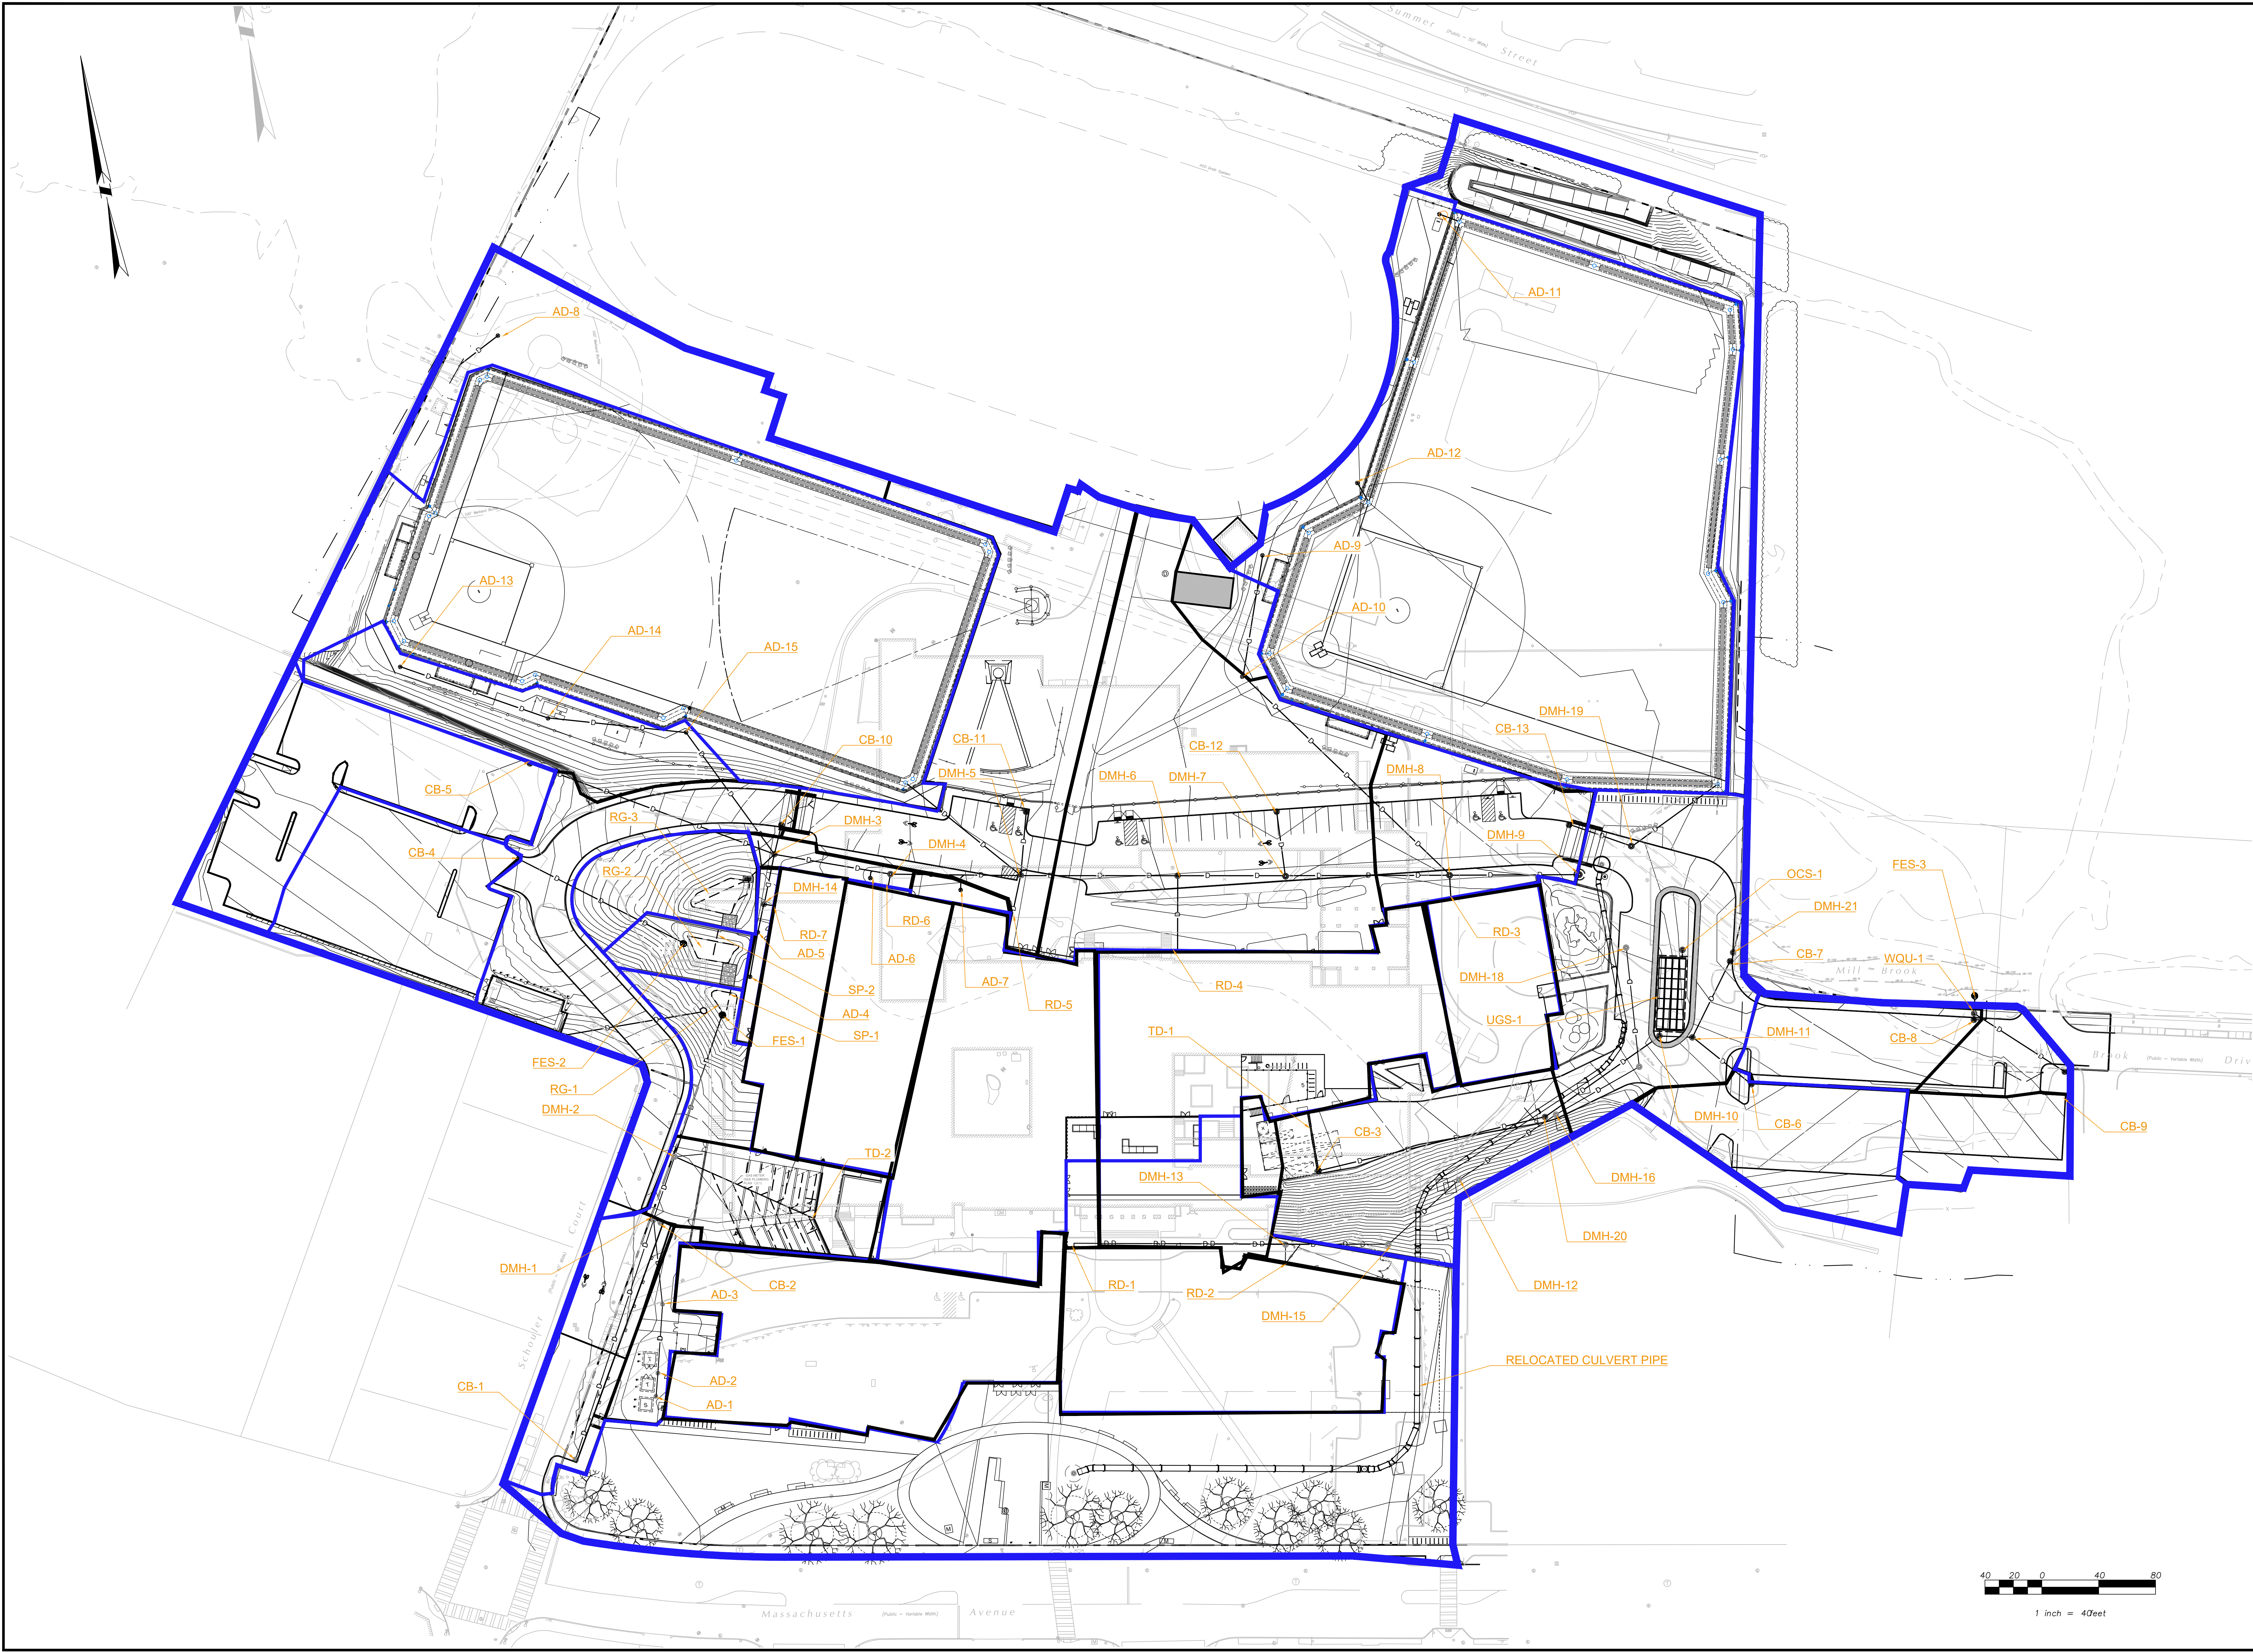

KEYPLAN

REVISIONS NO	DATE	REMARKS

Arlington High School
Worcester Avenue, Arlington, Massachusetts
BMP LOCATION MAP

SCALE
DRAWN BY: SM
CHECKED BY: SG

BMP

17211

60% CONSTRUCTION DOCUMENTS
PROGRESS SET 05-04-2020

samioles

Samioles Consultants Inc.
200 Main Street
Framingham, MA 01701
T 508.877.6688
F 508.877.6688
www.samioles.com

HMFH ARCHITECTS

HMFH
100 Bishop Allen Drive
Cambridge, MA 02139
877.682.2200
info@hmfh.com